

Ordinance No. 2011-03

**PLUMSTEAD TOWNSHIP
STORMWATER MANAGEMENT
ORDINANCE**

**Plumstead Township
Bucks County, Pennsylvania
Revised Draft March 8, 2011
Adopted May 3, 2011**

Table of Contents**Page****A. General Provisions**

Section 26-101	Statement of Findings	1
Section 26-102	Purpose.....	2
Section 26-103	Statutory Authority.....	2
Section 26-104	Applicability	3
Section 26-105	Exemptions	3
Section 26-106	Repealer	7
Section 26-107	Severability	7
Section 26-108	Compatibility with Other Ordinance Requirements	7

B. Definitions

Section 26-111	Definitions	8
----------------	-------------------	---

C. Stormwater Management

Section 26-121	General Requirements	22
Section 26-122	Stormwater Management Districts.....	25
Section 26-123	Volume Control Standards - Neshaminy Creek Watershed	28
Section 26-124	Nonstructural Project Design	30
Section 26-125	Water Quality Requirements (Delaware River South and Tohickon Creek Watersheds)	32
Section 26-126	Additional Requirements Applicable to Infiltration Oriented Stormwater Management Systems (Delaware River South and Tohickon Creek Watersheds)	34
Section 26-127	Stream Bank Erosion Requirements	37
Section 26-128	Design Criteria for Stormwater Management Facilities and Best Management Practices.....	37
Section 26-129	Calculation Methodology	48
Section 26-130	Standards During Land Disturbance.....	50
Section 26-130.1	Water Quality Requirements After Regulated Earth Disturbance Activities are Complete	52
Section 26-130.2	Delaware Canal Areas	52
Section 26-130.3	Other Requirements	52

D. Stormwater Management Plan Requirements

Section 26-131	General Requirement	54
Section 26-132	Stormwater Management Plan Contents	54
Section 26-133	Plan Submission	58
Section 26-134	Stormwater Management Plan Review.....	58
Section 26-135	Retention of Plans at Project Site	59
Section 26-136	Adherence to Approved Plan.....	59
Section 26-137	Certification of Completion	59
Section 26-138	Modification of Plans	60
Section 26-139	Occupancy Permit.....	60

E. Inspections

Section 26-141	Schedule of Inspections	61
Section 26-142	Right of Entry	61

Table of Contents (Cont'd) **Page**

F.	Fees and Expenses		
	Section 26-151	Municipality Stormwater Management Plan Review Fee	62
	Section 26-152	Expenses Covered by Fees	62
	Section 26-153	Itemization of Costs.....	62
G.	Maintenance Responsibilities		
	Section 26-161	Performance Guarantee	63
	Section 26-162	Maintenance Responsibilities	63
	Section 26-163	Municipal Review of Stormwater Facilities and BMP Operations .. and Maintenance (O&M) Plan	64
	Section 26-164	Maintenance Agreement for Privately Owned Stormwater Facilities	64
	Section 26-165	Stormwater Management Easements	64
	Section 26-166	Municipal Stormwater Maintenance Fund.....	64
	Section 26-167	Post-Construction Maintenance Inspections.....	65
H.	Prohibitions		
	Section 26-171	Prohibited Discharges	66
	Section 26-172	Prohibited Connections	66
	Section 26-173	Roof Drains	67
	Section 26-174	Waste Disposal Prohibitions.....	67
	Section 26-175	Alteration of BMPs.....	67
I.	Enforcement and Penalties		
	Section 26-181	Right of Entry	68
	Section 26-182	Notification	68
	Section 26-183	Enforcement.....	68
	Section 26-184	Public Nuisance	69
	Section 26-185	Penalties	69
	Section 26-186	Appeals.....	69
Appendix A	Stormwater Management Design Criteria		72
Appendix B	Neshaminy Creek Watershed SWM Site Plan Checklist		82
Appendix C	Site Evaluation and Soil Infiltration Testing		87
Appendix D	Low Impact Development Techniques		96
Appendix E	Nonstructural Stormwater Management BMPs		100
Appendix F	Chapter 93 Designated Use		106
Appendix G	Watershed Management District Map		107
Appendix H	Hot Spots		108
Appendix I	West Nile Virus Guidance		113
Appendix J	Simplified Stormwater Management Procedures for Existing Single Family Dwelling Lots.....		116
Appendix K	Standard Stormwater Facilities Maintenance and Monitoring Agreement.....		123
Appendix L	Storm Sewer Bedding/Backfill Requirements		128
Appendix M	Pervious Hardscaping Design and Credit Criteria		131

A. GENERAL PROVISIONS

Section 26-101. Statement of Findings

The governing body of the municipality finds that:

- A. Inadequate management of accelerated stormwater runoff resulting from development and redevelopment throughout a watershed increases flood flows and velocities, contributes to erosion and sedimentation, overtaxes the carrying capacity of existing streams and storm sewers, greatly increases the cost of public facilities to convey and manage stormwater, undermines floodplain management and flood reduction efforts in upstream and downstream communities, reduces groundwater recharge, damages private property, and threatens public health and safety.
- B. Inadequate planning and management of stormwater runoff resulting from land development and redevelopment throughout a watershed can also harm surface water resources by changing the natural hydrologic patterns, accelerating stream flows (which increase scour and erosion of streambeds and streambanks thereby elevating sedimentation), destroying aquatic habitat and elevating aquatic pollutant concentrations and loadings such as sediments, nutrients, heavy metals and pathogens.
- C. The aforementioned impacts happen mainly through a decrease in natural infiltration of stormwater.
- D. Through project design, impacts from stormwater runoff can be minimized to maintain the natural hydrologic regime, and sustain high water quality, groundwater recharge, stream base flow, and aquatic ecosystems. The most cost effective and environmentally advantageous way to manage stormwater runoff is through nonstructural project design, minimizing impervious surfaces and sprawl, avoiding sensitive areas (i.e. stream buffers, floodplains, steep slopes), and designing to topography and soils to maintain the natural hydrologic regime.
- E. A comprehensive program of stormwater management (SWM), including reasonable regulation of development and other activities causing loss of natural infiltration, is fundamental to the public health, safety, welfare, and the protection of the people of the Township and all the people of the Commonwealth, their resource, and the environment.
- F. Stormwater is an important water resource by providing groundwater recharge for water supplies and base flow of streams, which also protects and maintains surface water quality.
- G. Public education on the control of pollution from stormwater is an essential component in successfully addressing stormwater.
- H. Federal and State regulations require certain municipalities to implement a program of stormwater controls. These municipalities are required to obtain a federal permit for stormwater discharges from their separate storm sewer systems under the National Pollutant Discharge Elimination System (NPDES).
- I. Non-stormwater discharges to municipal separate storm sewer systems can contribute to pollution of Waters of the Commonwealth by the Township.

Section 26-102. Purpose

The purpose of this comprehensive stormwater management ordinance is to promote health, safety, and welfare within Plumstead Township by maintaining the natural hydrologic regime and by minimizing the harms and maximizing the benefits described in Section 26-101.A of this Part through provisions designed to:

- A. Meet Water Quality requirements under State law, including regulations at 25 Pa. Code Chapter 93.4a to protect and maintain “existing uses” and maintain the level of water quality to support those uses in all streams, and to protect and maintain water quality in “special protection” streams.
- B. Minimize increases in stormwater volume and control peak flow.
- C. Minimize impervious surfaces.
- D. Provide review procedures, performance standards, and design criteria for stormwater planning and management.
- E. Utilize and preserve the existing natural drainage systems as much as possible.
- F. Manage stormwater impacts close to the runoff source, requiring a minimum of structures and relying on natural processes.
- G. Infiltrate stormwater to maintain groundwater recharge, to prevent degradation of surface and groundwater quality, and to otherwise protect water resources.
- H. Preserve and restore the flood-carrying capacity of streams.
- I. Prevent streambank and streambed scour and erosion.
- J. Provide standards to meet National Pollution Discharge Elimination System (NPDES) permit requirements.
- K. Address certain requirements of the Municipal Separate Stormwater Sewer System (MS4) NPDES Phase II Stormwater Regulations.
- L. Provide for proper operations and maintenance of all permanent stormwater management facilities and Best Management Practices that are implemented in the Township.
- M. Promote nonstructural Best Management Practices (BMPs).
- N. Maintain existing flows and quality of streams and watercourses.
- O. Implement an illegal discharge detection and elimination program to address non-stormwater discharges into the municipal separate storm sewer system.

Section 26-103. Statutory Authority

The Township is empowered to regulate land use activities that affect runoff by the authority of the Act of October 4, 1978 32 P.S., P.L. 864 (Act 167) Section 680.1 et seq., as amended, the

'Storm Water Management Act,;" and by the Authority of Pennsylvania Municipalities Planning Code, Act 247 of 1968, as amended by Act 170 of 1988, as further amended by Act 209 of 1990 and Act 131 of 1992, 53 P.S. Section 10101.

Section 26-104. Applicability

- A. This Part shall apply to all areas of the Township that are located within the Neshaminy Creek Watershed, Tohickon Creek Watershed or Delaware River (South) Watershed as delineated in Appendix G which is hereby adopted as part of this Part.
- B. This Part shall apply to temporary and permanent stormwater management facilities constructed as part of any of the regulated activities listed in this section. Stormwater management and erosion and sedimentation control during construction activities which are specifically not regulated by this Part, shall continue to be regulated under existing laws and ordinances.
- C. This Part contains stormwater management performance standards and design criteria that are necessary or desirable from a watershed-wide perspective. Stormwater management design criteria (e.g. inlet spacing, inlet type, collection system design and details, outlet structure design, etc.) shall continue to be regulated by applicable ordinances.
- D. The following activities are defined as 'Regulated Activities' and shall be regulated by this Part except as exempted by Section 26-105 of this Part:
 - 1. Land development.
 - 2. Subdivision.
 - 3. Prohibited or polluted discharges.
 - 4. Alteration of the natural hydrologic regime.
 - 5. Construction or reconstruction of, or addition of new impervious or semi-impervious surfaces (e.g. driveways, parking lots, roads, etc.), except for reconstruction of roads where there is no increase in impervious surface, and/or construction of new buildings or additions to existing buildings.
 - 6. Redevelopment.
 - 7. Diversion piping or encroachments in any natural or man-made stream channel.
 - 8. Nonstructural and structural stormwater management Best Management Practices (BMPs) or appurtenances thereto.
 - 9. Temporary storage of impervious or pervious material (rock, soil, etc.) where ground contact exceeds 5 percent of the lot area or 5,000 square feet (whichever is less), and where the material is placed on slopes exceeding 8 percent.

Section 26-105. Exemptions

- A. Exemptions from any provision permitted by this section shall not relieve the applicant from all other requirements of this Part.
- B. General Exemptions: The following land use activities are exempt from stormwater management peak rate and plan requirements of this Part. On all sites where a cumulative area of less than 1,000 square feet of impervious surface since July 18, 2000 is proposed, the applicant is exempt from stormwater management plan submission requirements of Section 26-131 of this Part.
 - 1. Use of land for gardening for home consumption.
 - 2. Agricultural activity when operated in accordance with a conservation plan, nutrient management plan, or erosion and sedimentation control plan approved

by the Bucks County Conservation District, including activities such as growing crops, rotating crops, tilling of soil, and grazing animals. Installation of new, or expansion of existing, farmsteads, animal housing, waste storage, production areas, or other areas having impervious surfaces shall be subject to the provisions of this Part unless exempt pursuant to Section 26-105 C.

3. Forest Management operations following the Department of Environmental Protection's management practices contained in its publication "Soil Erosion and Sedimentation Control Guidelines for Forestry" and operating under an E&S Plan approved by the Bucks County Conservation District and which have Zoning Permit approval from Plumstead Township.
4. Public road replacement, replacement paving, repaving and/or maintenance.
5. Any aspect of BMP maintenance to an existing SWM system made in accordance with plans and specifications approved by the Township.

C. All Regulated Activities as described in Section 26-104 of this Part shall comply with the Stormwater Management requirements hereof except those activities listed in "Stormwater Management Exemption Criteria" table. Those activities listed in "Stormwater Management Exemption Criteria" table are, to the extent stated herein, exempt from Peak Rate Control provisions of Section 26-122 but are subject to compliance with Section 26-105.D and volume control requirements of Section 26-123 when located within the Neshaminy Creek Watershed. This requirement shall apply to the total development even if development is to take place in phases. The starting point from which to consider tracts as "parent tracts" is July 18, 2000. All impervious surface area constructed on or after July 18, 2000 shall be considered cumulatively. Impervious surface existing on the "parent tract" prior to July 18, 2000 shall not be considered in cumulative impervious area calculations for exemption purposes. An exemption shall not relieve the applicant from implementing such stormwater control measures and erosion control measures as are necessary to protect health, safety, and property.

Table 26-105.1 & Table 26-105.2 Stormwater Management Peak Rate Exemption Criteria

1. Regulated activities included within Section 26-104. D are exempt from Peak Rate Control requirements of Section 26-123 where the amount of impervious surface and proposed location on a parcel conforms to the following tables:

Table 26-105.1

Total Parcel Area (acres)	Maximum Impervious Surface Area (square feet)
<0.5	1,200
0.5 to 1.0	2,500
>1.0 to 2.0	4,000
>2.0 to 5.0	5,000
>5.0	7,500

Table 26-105.2

Maximum amount of the impervious surface area permitted pursuant to Table 1 within a setback (excluding driveway access) measured from the downslope property boundary shall conform to the following table:

Setback* (feet)	Maximum Impervious Surface Area (square feet) permitted within the setback.
10	None permitted
20	1,000
50	2,500
100	4,000
200	5,000
500	7,500

- * The minimum setback distance is measured between the proposed impervious area (excluding driveway access) and/or stormwater control/structure discharge point to the downslope property boundary. The maximum allowable impervious surface area is the amount of impervious surface area permitted within the setback distance. For example: a total of 4,000 square feet of impervious surface is permitted within the 100 feet setback, of which none is permitted within the 10 feet setback, not more than 1,000 square feet is permitted within the 20 feet setback, and not more than 2,500 square feet is permitted within the 50 feet setback.

In lieu of meeting the minimum distance criteria, the applicant may provide documentation from a Design Professional that the increased flows from the site leaves the site in the same manner as the pre-development condition, and that there will be no adverse affects to properties along the path of flow(s). The Township may require the above referenced documentation on any site including a site meeting the minimum distance or parcel size criteria when deemed necessary at the sole discretion of the Township.

2. Regulated activities included within Section 26-104.D proposed on a lot deed restricted from further subdivision, or containing a conservation easement restricting future development to not more than two (2) dwellings which conform to requirements of Stormwater Management Exemption Criteria 1, or the following table:

Total Parcel Area (acres)	Maximum Impervious Surface Area* (square feet)
>5.0 to 10.0	7,500
>10.0 to 20.0	10,000
>20.0	15,000

*Location of impervious surface must conform to Table 26-105.2

3. Construction or reconstruction of buildings or additions to existing buildings or other impervious surface activities regulated pursuant to Section 26-104.D are exempt where the following conditions are met:

- a. An area of impervious surface is removed from the site equal to, or in excess of, the proposed impervious surface area.
 - b. The area where existing impervious surface is removed pursuant to Item 3.a above must be restored with a minimum of twelve (12) inches of topsoil and stabilized pervious groundcover.
4. Lot line adjustment subdivisions are exempt when no increase in impervious surface is proposed.

D. Simplified Procedure for Single Family Dwellings

Individual home construction projects on existing single-family lots which result in less than two thousand five hundred (2,500) square feet of new impervious area (including the building footprint, driveway, sidewalks, swimming pools, patios, and parking areas) or less than five thousand (5,000) square feet of earth disturbance but do not meet exemption criteria of Section 26-105.C or are subject to the additional criteria of Section 26-105.E may utilize the simplified procedure within Appendix J to meet requirements of the Part and are not required to submit formal stormwater management plans to the Township. This procedure may not be utilized for proposed subdivision or land development.

E. Additional Exemption Criteria.

1. Exemption responsibilities - An exemption shall not relieve the applicant from implementing such measures as are necessary to protect the public health, safety, and property.
2. Drainage problems – Where drainage problems are documented or known to exist downstream of, or is expected from, the proposed activity, the Township may deny an exemption.
3. HQ and EV streams – An exemption shall not relieve the applicant from meeting the special requirements for watersheds draining to high quality (HQ) or exceptional value (EV) waters contained in Sections 26-125 and 26-126 of this Part. The Paunacussing Creek is designated as a high quality watershed.

F. The municipality, upon request by the applicant, may grant an exemption from the provisions of this Part for a project qualifying under Section 26-105.C. If an exemption is granted, the municipality may require the developer to pay a fee in an amount established by separate Resolution of the Board of Supervisors to the Municipal Stormwater Management Capital Fund.

G. All applicants seeking an exemption of stormwater management peak rate requirements based upon criteria contained in Section 26-105.C shall, at a minimum, submit the following documentation for review:

1. Three (3) copies of the completed Township Stormwater Management Application form.
2. Stormwater Management Review Fee and Escrow, as established by separate resolution of the Board of Supervisors.

3. Three (3) copies of a plot plan for the parcel, which is the subject of the exemption application, containing, at a minimum, the following information:
 - a. Property boundaries and area of the site, based on deed information, or field survey.
 - b. Location map identifying the site relative to streets and other parcels in the vicinity of the site.
 - c. Location of significant natural and existing manmade features, including wetlands, watercourses, woodlands, steep slopes, structures, parking areas, driveways, utilities, wells, and septic systems within 200 feet of proposed impervious surface, regardless of the location of the property boundary.
 - d. Location and dimensions of existing and proposed impervious surface and other improvements, with setbacks drawn to relate the location of same to property lines, streets, and existing features.
 - e. North Arrow.
 - f. Plan scale, as applicable.
 - g. Information regarding existing/proposed topography and drainage patterns, within two-hundred (200) feet of proposed impervious surface based on field survey, USGS mapping, and/or field observation.
 - h. Other information deemed necessary by the Township Engineer to determine compliance with exemption criteria contained in Section 26-105.

Section 26-106. Repealer

Any ordinance or ordinance provision of the Township inconsistent with any of the provisions of this Part is hereby repealed to the extent of the inconsistency only.

Section 26-107. Severability

Should any section or provision of this Part be declared invalid by a court of competent jurisdiction, such decision shall not affect the validity of any of the remaining provisions of this Part.

Section 26-108. Compatibility with Other Ordinance Requirements

Approvals issued and actions taken under this Part do not relieve the Applicant of the responsibility to secure required permits or approvals for activities regulated by any other code, law, regulation or ordinance. To the extent that this Part imposes more rigorous requirements for stormwater management, the specific requirements contained in this Part shall be followed.

B. DEFINITIONS

Section 26-111. Definitions.

For the purposes of this chapter, certain terms and words used herein shall be interpreted as follows:

- A. Words used in the present tense include the future tense; the singular number includes the plural, and the plural number includes the singular; words of masculine gender include feminine gender; and words of feminine gender include masculine gender.
- B. The word "includes" or "including" shall not limit the term to the specific example but is intended to extend its meaning to all other instances of like kind and character.
- C. The word "person" includes an individual, firm, association, organization, partnership, trust, company, corporation, or any other similar entity.
- D. The words "shall" and "must" are mandatory; the words "may" and "should" are permissive.
- E. The words "used" or "occupied" include the words "intended", "designed", "maintained", or "arranged to be used", "occupied" or "maintained".

Accelerated erosion The removal of the surface of the land through the combined action of man's activity and the natural processes of a rate greater than would occur because of the natural process alone.

Agricultural Activity Activities associated with agriculture such as agricultural cultivation, agricultural operation, and animal heavy use areas. This includes the work of producing crops including tillage, land clearing, plowing, disking, harrowing, planting, harvesting crops or pasturing and raising livestock, and installation of conservation measures. Construction of new buildings or impervious area is not considered agricultural activity.

Alluvial Soil Areas subject to periodic flooding as defined in latest officially issued soil survey information by the U.S. Conservation and Natural Resources Service.

Alteration As applied to land, a change in topography as a result of the moving of soil and rock from one location or position to another; also the changing of surface conditions by causing the surface to be more or less impervious; or earth disturbance.

Applicant A landowner or developer who has filed an application for approval to engage in any Regulated Activities as defined in Section 26-104 of this Part.

As-Built Plan Plans that are maintained during construction of the project and which document the actual locations of the site improvements. As-built plan must be prepared by a professional land surveyor or professional engineer licensed in the Commonwealth of Pennsylvania.

Bankfull The channel at the top of bank or point where water begins to overflow onto a floodplain.

Base Flow The portion of stream flow that is sustained by groundwater discharge.

Bioretention A stormwater retention area which utilizes woody and herbaceous plants and soils to remove pollutants before infiltration occurs.

BMP (Best Management Practice) Activities, facilities, measures or procedures used to manage stormwater impacts from land development, to protect and maintain water quality and groundwater recharge and to otherwise meet the purposes of this Part. Stormwater BMPs are commonly grouped into one or two broad categories or measures: “structural” or “nonstructural”. In this Ordinance, nonstructural BMPs or measures refer to operation and/or behavior-related practices that attempt to minimize the contact of pollutants with stormwater runoff whereas structural BMPs or measures are those that consist of a physical device or practice that is installed to capture and treat stormwater runoff. Structural BMPs include, but are not limited to, a wide variety of practices and devices, from large-scale retention ponds and constructed wetlands, to small-scale underground treatment systems, infiltration facilities, filter strips, low impact design, bioretention, wet ponds, permeable paving, grassed swales, riparian or forested buffers, sand filters, detention basins, and manufactured devices. Structural stormwater BMPs are permanent appurtenances to the project site.

BMP Manual Pennsylvania Best Management Practices Manual, December 2006, as amended.

Channel An open drainage feature through which stormwater flows. Channels include but shall not be limited to, natural and man-made watercourses, swales, streams, ditches, canals, and pipes that convey continuously or periodically flowing water.

Channel erosion The widening, deepening, and headward cutting of channels and waterways, due to erosion caused by moderate to large floods.

Cistern An underground reservoir or tank for storing rainwater.

Conservation District Bucks County Conservation District.

County Bucks County

Culvert A pipe, conduit, or similar structure including appurtenant works which conveys surface water under or through an embankment or fill.

Curve Number (CN) Value used in the Soil Cover Complex Method It is a measure of the percentage of precipitation which is expected to run off from the watershed and is a function of the soil, vegetative cover, and tillage method.

Dam An artificial barrier, together with its appurtenant works, constructed for the purpose of impounding or storing water or another fluid or semifluid, or a refuse bank, fill or structure for highway, railroad, or other purposes which does or may impound water or another fluid or semifluid.

DEP The Pennsylvania Department of Environmental Protection (DEP).

Department The Pennsylvania Department of Environmental Protection.

Designee The agent of Bucks County, Bucks County Conservation District and/or Governing Body involved with the administration, review, or enforcement of any provisions of this Part by contract or memorandum of understanding.

Design Professional (Qualified) A Pennsylvania Registered Professional Engineer, Registered Landscape Architect or Registered Land Surveyor trained to develop stormwater management plans.

Design Storm The magnitude and temporal distribution of precipitation from a storm event measured in probability of occurrence (i.e. 5-year storm) and duration (i.e. 24-hours).

Detention basin An impoundment structure designed to manage stormwater runoff by temporarily storing the runoff and releasing it at a predetermined rate. Detention basins are designed to drain completely soon after a rainfall event.

Detention/Retention Basin Watershed All land area whose surface runoff is captured by a detention and/or retention basin.

Detention district Those subareas in which some type of detention is required to meet the plan requirements and goals of Act 167.

Detention Volume The volume of runoff that is captured and released into the Waters of the Commonwealth at a controlled rate.

Developer A person, partnership, association, corporation, or other entity, or any responsible person therein or agent thereof, that undertakes any regulated activity of this Part.

Development Any man-made change to improved or unimproved real estate including, but not limited to, the construction or placement of buildings or other structures, mobile homes, streets and other paving, utilities, mining, dredging, filling, grading, excavation, or drilling operations, and the subdivision of land.

Development plan The provisions for development including a planned residential development, a plan of subdivision, all covenants relating to use, location and bulk of buildings and other structures, intensity of use or density of development, streets, ways and parking facilities, common open space and public facilities. The phrase “provisions of development plan” when used in this Part shall mean the written and graphic materials referred to in this definition.

Development site The specific tract of land for which a regulated activity is proposed.

Diffused Drainage Discharge Drainage discharge not confined to a single point location or channel, such as sheet flow or shallow concentrated flow.

Discharge 1. (verb) To release water from a project, site, aquifer, drainage basin or other point of interest; 2. (noun) The rate and volume of flow of water such as in a stream, generally expressed in cubic feet per second (CFS).

Disconnected Impervious Area (DIA) An impervious surface that is disconnected from any stormwater drainage or conveyance system and is redirected or directed to a pervious area, which allows for infiltration, filtration, and increased time of concentration.

Disturbed Areas Unstabilized land area where an earth disturbance activity is occurring or has occurred.

Downslope property line That portion of the property line of the lot, tract, or parcels of land being developed located such that all overland or pipe flow from the site would be directed toward it.

Downstream hydraulic capacity analysis Any downstream capacity hydraulic analysis conducted in accordance with this Part.

Drainage conveyance facility A stormwater management facility designed to transmit stormwater runoff which shall include streams, channels, swales, pipes, conduits, culverts, storm sewers, etc.

Drainage easement A right granted by a landowner to a grantee, allowing the use of private land for stormwater management purposes.

Drainage Permit A permit issued by the Township after the SWM Plan has been approved.

Earth Disturbance A construction or other human activity which disturbs and destabilizes the surface of the land including, but not limited to, clearing and grubbing, grading, excavations, embankments, land development, road maintenance, and the moving, depositing, stockpiling or storing of soil, rock or earth materials.

Emergency Spillway A conveyance area that is used to pass peak discharge greater than the maximum design storm controlled by the stormwater facility.

Encroachment A structure or activity that changes, expands or diminishes the course, current or cross section of a watercourse, floodway or body of water.

Engineer A licensed professional civil engineer registered by the Commonwealth of Pennsylvania.

Erosion The process by which the surface of the land, including channels, is worn away by water, wind or chemical action.

Erosion and Sediment Pollution Control Plan A site-specific plan identifying the BMPs to minimize accelerated erosion and sedimentation, pursuant to 25 Pa Code Chapter 102.

Exceptional Value Waters Surface waters of high quality which satisfy Pennsylvania Code Title 25 Environmental Protection, Chapter 93 Water Quality Standards, §93.4b(b) (relating to antidegradation).

Existing conditions The initial condition of a project site prior to the proposed construction. Farm field, disturbed earth, or undeveloped cover conditions of a site or portions of a site used for modeling purposes, shall be considered “meadow” unless the natural groundcover generates lower curve numbers or Rational “C” value, such as forested land. Existing man-made impervious surfaces shall be considered as “meadow” when developing “cover complex” calculations.

Existing Resources and Site Analysis Map A base map which identifies fundamental environmental site information including floodplains, wetlands, topography, vegetative site features, natural areas, prime agricultural land and areas supportive of endangered species.

Existing Recharge Area Undisturbed surface area or depression where stormwater collects and a portion of which infiltrates and replenishes the groundwater.

Flood A general but temporary condition of partial or complete inundation of normally dry land areas from the overflow of streams, rivers, and other waters of this commonwealth.

Floodplain Those areas of Plumstead Township which are subject to the one hundred year flood, as identified in the Flood Insurance Study (FIS) dated May 18, 1999, as amended, and the accompanying maps prepared for the Township by the Federal Emergency Management Agency (FEMA), or most recent revision thereof; and also those areas along streams, ponds, or lakes not identified within the Flood Insurance Study which are inundated by the 100 year reoccurrence interval flood.

Floodway The channel of the watercourse and those portions of the adjoining floodplains that are reasonably required to carry and discharge the 100-year frequency flood. Unless otherwise specified, the boundary of the floodway is as indicated on maps and flood insurance studies provided by FEMA. In an area where no FEMA maps or studies have defined the boundary of the 100-year frequency floodway, it is assumed-absent evidence to the contrary that the floodway extends from the stream to 50 feet from the top of the bank of the stream.

Forest Management/Timber Operations Planning and associated activities necessary for the management of forest. These include timber inventory and preparation of forest management plans, silvicultural treatment, cutting budgets, logging road design and construction, timber harvesting, and reforestation.

Freeboard A vertical distance between the elevation of the design high-water and the top of a dam, levee, tank, basin, or diversion ridge. The space is required as a safety margin in a pond or basin.

Grade 1. (noun) A slope usually of a street, other public way, land area, drainage facility or pipe specified in percent; 2. (verb) To finish the surface of a road bed, top of embankment or bottom of excavation.

Grassed waterway A natural or constructed waterway, usually broad and shallow, covered with erosion-resistant grasses, used to conduct surface water.

Groundwater Water beneath the earth's surface that supplies wells and springs, and is often between saturated soil and rock.

Groundwater recharge Replenishment of natural underground water supplies.

HEC-HMS The US Army Corps of Engineers, Hydrologic Engineering Center (HEC) – Hydrologic Modeling System (HMS).

High Quality Waters Surface waters having quality which exceeds levels necessary to support propagation of fish, shellfish, and wildlife and recreation in and on the water by satisfying

Pennsylvania Code Title 25 Environmental Protection, Chapter 93, Water Quality Standards, §93.4b(a). The Paunacussing Creek is designated as a high quality watershed.

Hot spot – An area where land use or activity generates highly contaminated runoff, with concentrations of pollutants in excess of those typically found in stormwater. Typical pollutant loadings in stormwater may be found in Chapter 8 Section 6 of the *Pennsylvania Stormwater Best Management Practices Manual, Pennsylvania Department of Environmental Protection (PADEP) no. 363-0300-002 (2006)*. More information concerning hot spots may be found in Appendix H of this Ordinance.

Hydric Soil A soil that is saturated, flooded, or ponded long enough during the growing season to develop an anaerobic condition in the upper part.

Hydrologic Regime (Natural) The hydrologic cycle or balance that sustains quality and quantity of stormwater, baseflow, storage, and groundwater supplies under the natural conditions.

Hydrologic Soil Group (HSG) Infiltration rates of soils vary widely and are affected by subsurface permeability as well as surface intake rates. Soils are classified into four HSG's (A, B, C, and D) according to their minimum infiltration rate, which is obtained for bare soil after prolonged wetting. The Natural Resources Conservation Service (NRCS) of the US Department of Agriculture defines the four groups and provides a list of most of the soils in the United States and their group classification. The soils in the area of the development site may be identified from a soil survey report that can be obtained from local NRCS offices or conservation district offices. Soils become less pervious as the HSG varies from A to D.

Hyetograph A graphical representation of average rainfall, rainfall excess rates, or volumes over specified areas during successive units of time during a storm.

Impervious surface Impervious surfaces are those surfaces which prevent the infiltration of water into the ground. All buildings, parking areas, driveways, roads, sidewalks, swimming pools, and any areas containing concrete, asphalt, packed stone, compacted soils, or other equivalent surfaces shall be considered impervious within this definition. In addition, other areas determined by the Township Engineer to be impervious within the meaning of this definition shall be classified as impervious surfaces.

Impoundment A retention or detention basin designed to retain stormwater runoff and release it at a controlled rate.

Infiltration Movement of surface water into the soil, where it is absorbed by plant roots, evaporated into the atmosphere or percolated downward to recharge groundwater.

Infiltration structures A structure designed to direct runoff into the ground (e.g. french drains, seepage pits, seepage trench, biofiltration swale, infiltration basins).

Inlet A surface connection to a closed drain. A structure at the diversion end of a conduit. The upstream end of any structure through which water may flow.

Invert The inside bottom of a culvert or other conduit.

Karst A type of topography or landscape characterized by surface depressions, sinkholes, rock pinnacles/uneven bedrock surface, underground drainage and caves. Karst is formed on carbonate rocks, such as limestone or dolomite.

Land development - Any of the following activities:

1. The improvement of one (1) or two (2) or more contiguous lots, tracts or parcels of land for any purpose involving:
 - A. A group of two (2) or more residential or nonresidential buildings, whether purposed initially or cumulatively, or a single nonresidential building on a lot or lots regardless of the number of occupants or tenure; or
 - B. The division or allocation of land or space, whether initially or cumulatively, between or among two (2) or more existing or prospective occupants by means of, or for the purpose of streets, common areas, leaseholds, condominiums, building groups or other features.
2. A subdivision of land.
3. "Land development" does not include development which involves:
 - A. The conversion of an existing single family detached dwelling or single family semi-detached dwelling into not more than three (3) residential units, unless such units are intended to be a condominium;
 - B. The addition of a residential accessory building, including farm building, on a lot or lots subordinate to an existing principal building; or
 - C. The addition or conversion of buildings or rides within the confines of an enterprise which would be considered an amusement park. For the purposes of this subsection, an amusement park is defined as a tract or area used principally as a location for permanent amusement structures or rides. This exclusion shall not apply to newly acquired acreage by an amusement park until initial plans for the expanded area have been approved by the proper authorities.

Land/earth disturbance Any activity involving grading, tilling, digging, or filling of ground or stripping of vegetation or any other activity that causes an alteration to and destabilization of the natural condition of the land.

Limiting Zone A soil horizon or condition in the soil profile or underlying strata which includes one of the following:

- (i) A seasonal high water table, whether perched or regional, determined by direct observation of the water table or indicated by soil mottling.
- (ii) A rock with open joints, fracture or solution channels, or masses of loose rock fragments, including gravel, with insufficient fine soil to fill the voids between the fragments.
- (iii) A rock formation, other stratum or soil condition which is so slowly permeable that is effectively limits downward passage of effluent.

Low Impact Development (LID) Practices Practices that will minimize proposed conditions runoff rates and volumes, which will minimize the need for artificial conveyance and storage facilities.

Main Stem (Main channel) Any stream segment or other runoff conveyance facility used as a reach in the watershed hydrologic model.

Manning Equation (Manning formula) A method for calculation of velocity of flow (e.g., feet per second) and flow rate (e.g., cubic feet per second) in open channels based upon channel shape, roughness, depth of flow and slope. "Open channels" may include closed conduits when the flow is not under pressure.

Municipal Engineer A professional engineer licensed in the Commonwealth of Pennsylvania and appointed by the Township pursuant to Article V of the Second Class Township Code.

Municipality Plumstead Township, Bucks County, Pennsylvania

Nonpoint source pollution Pollution that enters a watery body from diffuse origins in the watershed and does not result from discernible, confined, or discrete conveyances.

Nonstormwater Discharges - Water flowing in stormwater collection facilities, such as pipes or swales, which is not the result of a rainfall event or snowmelt.

NPDES National Pollution Discharge Elimination System, the federal government's system for issuance of permits under the Clean Water Act, which is delegated to PADEP in Pennsylvania.

NRCS Natural Resource Conservation Service (previously SCS).

Open channel A drainage element in which stormwater flows with an open surface. Open channels include, but shall not be limited to, natural and man-made drainageways, swales, streams, ditches, canals, and pipes flowing partly full.

Outfall "Point source" as described in 40 CFR § 122.2 at the point where the municipality's storm sewer system discharges to surface Waters of the Commonwealth.

Outlet Points of water disposal to a stream, river, lake, tidewater or artificial basin.

Parent Tract The parcel of land from which a land development or subdivision originates as of the date of adoption of the initial Plumstead Township Stormwater Management Ordinance on July 18, 2000 (Ordinance No. 00-7-18-1).

Peak discharge The maximum rate of stormwater runoff from a specific storm event.

Penn State runoff model (calibrated) The computer-based hydrologic modeling technique adapted to the watershed for the Act 167 Plan. The model has been "calibrated" to reflect actual recorded flow values by adjoining key model input parameters.

Permanently Preserved Land A parcel or tract of land that is subject to a recorded conservation easement, in perpetuity, in a manner acceptable to the Township.

Permanently Removed Volume (PRV) The volume of runoff that is permanently removed from the runoff and not released into surface Waters of the Commonwealth during or after a storm event.

Person An individual, partnership, association, corporation or other entity.

Pervious Area Any area not defined as impervious.

Pipe A culvert, closed conduit, or similar structure (including appurtenances) that conveys stormwater.

Planning Commission The Planning Commission of Plumstead Township.

PMF (Probable Maximum Flood) The flood that may be expected from the most severe combination of critical meteorologic and hydrologic conditions that are reasonably possible in any area. The PMF is derived from the probable maximum precipitation (PMP) as determined on the basis of data obtained from the National Oceanographic and Atmospheric Administration (NOAA).

Point Source Any discernible, confined and discrete conveyance, including, but not limited to, any pipe, ditch, channel, tunnel, or conduit from which stormwater is or may be discharged, as defined in State regulations at 25 Pa. Code § 92.1.

Post Construction Period after construction during which disturbed areas are stabilized, stormwater controls are in place and functioning, and all improvements in the approved SWM plan are completed.

Pretreatment Techniques employed in stormwater BMPs to provide storage or filtering to trap coarse materials and other pollutants before they enter the system.

Project Site The specific tract of land where any regulated activity in the Township is planned, conducted or maintained.

Rational Method A rainfall-runoff relation used to estimate peak flow.

Recharge Area Undisturbed surface area or depression where stormwater collects, and a portion of which infiltrates and replenishes the underground and groundwater.

Recharge volume A calculated volume of stormwater runoff from impervious areas which is required to be infiltrated at a site and may be achieved through use of structural or non-structural BMPs.

Regulated Activities Any activity to which this Part is applicable pursuant to Section 26-104 of this Part.

Regulated Earth Disturbance Activity Activity involving earth disturbance subject to regulation under 25 Pa. Code 92, 25 Pa. Code 102 or the Clean Streams Law.

Release rate The percentage of predevelopment peak rate of runoff from a site or subarea to which the post development peak rate of runoff must be reduced to protect downstream areas.

Retention basin A basin designed to retain stormwater runoff so that a permanent pool is established.

Retention Volume/Removed Runoff The volume of runoff that is captured and not released directly into the surface waters of the Commonwealth during or after a storm event.

Return period The average interval, in years, within which a storm event of a given magnitude can be expected to recur. For example, the 25-year return period rainfall would be expected to recur on the average once every 25 years.

Riparian Corridor A vegetated ecosystem along a waterbody that serves to buffer the waterbody from the effects of runoff by providing water quality filtering, bank stability, recharge, rate attenuation and volume reduction, and shading of the waterbody by vegetation. Riparian corridors also provide habitat and may include streambanks, wetlands, floodplains, and transitional areas.

Riser A vertical pipe extending from the bottom of a pond that is used to control the discharge rate from the pond for a specified design storm.

Road Maintenance Earth disturbance activities within the existing road cross-section, such as grading and repairing existing unpaved road surfaces, cutting road banks, cleaning or clearing drainage ditches and other similar activities.

Roof Drains A drainage conduit or pipe that collects water runoff from a roof and leads it away from a structure.

Runoff Any part of precipitation that flows over the land surface.

Sediment Soils or other materials transported by surface water as a product of erosion.

Sediment basin A barrier, dam, or retention or detention basin located and designed to retain rock, sand, gravel, silt, or other material transported by water.

Sediment pollution The placement, discharge or any other introduction of sediment into the Waters of the Commonwealth.

Sedimentation The process by which mineral or organic matter is accumulated or deposited by the movement of water.

Seepage Pit/Seepage Trench An area of excavated earth filled with loose stone or similar coarse material, into which surface water is directed for infiltration into the underground water (refer PA BMP Manual, December 2006, Chapter 6, Section 4).

Separate Storm Sewer System A system of pipes, open channels, streets, and other conveyances intended to carry stormwater runoff.

Shallow Concentrated Flow Stormwater runoff flowing in shallow, defined ruts prior to entering a defined channel or waterway.

Sheet flow Runoff that flows over the ground surface as a thin, even layer, not concentrated in a channel.

Soil-cover complex method A method of runoff computation developed by the NRCS that is based on relating soil type and land use/cover to a runoff parameter called a Curve Number (CN).

Source Water Protection Areas (SWPA) The zone through which contaminants, if present, are likely to migrate and reach a drinking water well or surface water intake.

Special Protection Subwatersheds Watersheds that have been designated in Pennsylvania Code Title 25 Environmental Protection, Chapter 93 Water Quality Standards as exceptional value (EV) or high quality (HQ) waters.

Storage indication method A reservoir routing procedure based on solution of the continuity equation (inflow minus outflow equals the change in storage) with outflow defined as a function of storage volume and depth.

Storm frequency The number of times that a given storm event occurs or is exceeded on the average in a stated period of years. Refer "Return Period."

Storm sewer A system of pipes and/or open channels that convey intercepted runoff and stormwater from other sources, but excludes domestic sewage and industrial wastes.

Stormwater The surface runoff generated by precipitation reaching the ground surface.

Stormwater management facility Any structure, natural or man-made, that, due to its condition, design, or construction, conveys, stores, or otherwise affects stormwater runoff. Typical stormwater management facilities include, but are not limited to, detention and retention basins, open channels, storm sewers, pipes, infiltration structures, and other BMPs.

Stormwater management permit A permit issued by the Township after the drainage plan has been approved. Said permit is issued prior to or with the final township approval of the proposed development activity.

Stormwater management plan The plans for managing stormwater runoff within the Township adopted as required by the Act of October 4, 1978, P.L. 864, (Act 167), as amended and known as the "Stormwater Management Act".

Stormwater management (SWM) site plan The plan prepared by the Developer or his engineer indicating how stormwater runoff will be managed at the particular site of interest according to this Part.

Stream Rivers, creeks, springs, and other perennial or intermittent watercourses containing water at least on a seasonal basis during an average water year. The term "stream" shall include all "Intermittent Streams" and all "Perennial Streams".

1. Springs or Seeps – The point where groundwater discharges to become surface water.
2. Stream, Ephemeral – A reach of stream that flows only during and for short periods following precipitation, and flows in low areas that may or may not be a well defined channel. Ephemeral stream beds are located above the water table year-round. Groundwater is not a source of water for the stream. Some

commonly used names for ephemeral streams include: stormwater channel, drain, swale, gully, dry stream channel, hollow, or saddle.

3. Stream, Headwater – The beginning reach of a stream, which collects water from springs and seeps and provides a hydrologic connection to a perennial stream. These channels may be ill defined and may move from year to year depending upon groundwater input, snowmelt, and runoff, but are typified by hydric soils and hydric vegetation.
4. Stream, Intermittent – A reach of stream that flows only during wet periods of the year and flows in a continuous well-defined channel. During dry periods, when the water table is depressed by seasonal aridity or drought, intermittent streams may go down to a trickle of water and appear dry, when in fact there is water flowing within the stream bottom or “substrate”.
5. Stream, Perennial or Watercourse, Perennial – A body of water in a channel that flows throughout a majority of the year in a defined channel and is capable, in the absence of pollution, drought, or manmade stream disturbances, of supporting a benthic macroinvertebrate community that is composed of two or more recognizable taxonomic groups of organisms, large enough to be seen by the unaided eye and can be retained by a U.S. Standard No. 30 sieve (28 meshes per inch, 0.595 mm openings) and live at least part of their life cycles within or upon available substrates in a body of water or water transport system. A perennial stream can have Q₇₋₁₀ flow of zero. For the purposes of this document, a perennial stream includes lakes and ponds.

Stream Buffer The land area adjacent to each side of a stream, essential to maintaining water quality.

Streambank Erosion The widening, deepening or headward cutting of channels and waterways caused by stormwater runoff or bankfull flows.

Stream enclosure A bridge, culvert or other structure in excess of 100 feet in length upstream to downstream which encloses a regulated water of this Commonwealth.

Subarea (Subwatershed) The smallest drainage unit of a watershed for which stormwater management criteria have been established in the stormwater management plan.

Subdivision As defined in the Pennsylvania Municipalities Planning Code, Act of July 31, 1968, P.L. 805, No. 247.

Swale A low-lying stretch of land which gathers or carries surface water runoff.

Time of concentration (T_c) The time for surface runoff to travel from the hydraulically most distant point of the watershed to a point of interest within the watershed. This time is the combined total of overland flow time and flow time in pipes or channels, if any.

Top of Bank Highest point of elevation in a stream channel cross section at which a rising water level just begins to flow out of the channel and over the floodplain.

Tributary Area – The portion of a watershed that contributes runoff to a particular point in that watershed.

Vernal Pool Seasonal depressional wetlands that are covered by shallow water for variable period from winter to spring, but may be completely dry for most of the summer and fall.

Volumetric Runoff Coefficient A variable indicative of stormwater runoff volume and dependent on the impervious coverage for a site.

Watercourse Same as stream.

Water Quality Requirements As defined under state regulations – protection of *designated and existing* uses (Refer 25 Pa Code Chapters 93 and 96):

- a. Each stream segment in Pennsylvania has a “designated use”, such as “cold water fishery” or “potable water supply”, which are listed in Chapter 93. These uses must be protected and maintained, under state regulations.
- b. “Existing uses” are those attained as of November, 1975, regardless whether they have been designated in Chapter 93. Land development must be designed to protect and maintain existing uses and maintain the level of water quality necessary to protect those uses in all streams, and to protect and maintain water quality in special protection streams.
- c. Water quality involves the chemical, biological, and physical characteristics of surface water bodies. After land development, these characteristics can be impacted by addition of pollutants such as sediment, and changes in habitat through increased flow volumes and/or rates. Therefore, discharge to surface waters must be designed and managed to protect the streambank, streambed, and structural integrity of the waterway, to prevent these impacts.

Watershed Region or area bounded peripherally by water parting and draining to a particular watercourse or body of water.

Waters of the Commonwealth Any and all rivers, streams, creeks, rivulets, impoundments, ditches, watercourses, storm sewers, lakes, dammed water, wetlands, ponds, springs, and all other bodies or channels of conveyance of surface and underground water, or parts thereof, whether natural or artificial, within or on the boundaries of this Commonwealth.

Waters of the United States (or Waters of the US)

- a. All waters which are currently used, were used in the past, or may be susceptible to use in interstate or foreign commerce, including all waters which are subject to the ebb and flow of the tide;
- b. All interstate waters, including interstate “wetlands”;
- c. All other waters such as intrastate lakes, rivers, streams (including intermittent streams), mudflats, sandflats, “wetlands”, sloughs, prairie potholes, wet meadows, playa lakes, or natural ponds the use, degradation, or destruction of which would affect or could affect interstate or foreign commerce including any such waters: (1) Which are or could be used by interstate or foreign travelers for recreational or other purposes; (2) From which fish or shellfish are or could be taken and sold in interstate or foreign commerce; or (3)

Which are used or could be used for industrial purposes by industries in interstate commerce;

- d. All impoundments of waters otherwise defined as waters of the United States under this definition;
- e. Tributaries of waters identified in paragraphs a through d of this definition;
- f. The territorial sea; and
- g. "Wetlands" adjacent to waters (other than waters that are themselves wetlands) identified in paragraphs a through f of this definition.

Wet Basin – Pond for runoff management that is designed to detain runoff and always contains water.

Wetland Those areas that are inundated or saturated by surface or groundwater at a frequency and duration sufficient to support, and that under normal circumstances do support, a prevalence of vegetation typically adapted for life in saturated soil conditions, including swamps, marshes, bogs, ferns, and similar areas.

Wetland Delineation The process by which wetland limits are determined. Wetlands must be delineated by a qualified specialist according to the 1989 Federal Manual (as amended) for the Delineation of Jurisdictional Wetlands (whichever is greater) or according to any subsequent Federal or State regulation. Qualified specialist shall include those persons being Certified Professional Soil Scientists as registered with Registry of Certified Professionals in Agronomy Crops and Soils (ARCPACS); or as contained on consultant's list of Pennsylvania Association of Professional Soil Scientists (PAPSS); or as registered with National Society of Consulting Soil Scientists (NSCSS), or as certified by State and/or Federal certification programs; or by a qualified Biologist/Ecologist.

C. STORMWATER MANAGEMENT

Section 26-121. General Requirements for Stormwater Management

- A. All applicants proposing Regulated Activities within the Township which do not fall under the exemption criteria contained within Section 26-105 of this Part shall submit a stormwater management plan consistent with this Part to the Township for review. These criteria shall apply to the total proposed development even if development is to take place in stages. Impervious surface shall include, but not be limited to, any roof, parking or driveway areas and any new streets and sidewalks. All gravel and crushed stone areas shall be assumed to be impervious unless designed as a BMP (e.g. pervious paver blocks, reinforced turf, gravel filled grids, etc.). (Refer definition of Impervious Surface within Section 26-111 of this Part).
- B. All Regulated Activities shall include such measures as necessary to:
1. Protect health, safety, and property;
 2. Meet the water quality goals of this Ordinance by implementing measures to:
 - a. Minimize disturbance to floodplains, wetlands, and wooded areas.
 - b. Create, maintain, repair or extend riparian buffers.
 - c. Avoid erosive flow conditions in natural flow pathways.
 - d. Minimize thermal impacts to waters of this Commonwealth.
 - e. Disconnect impervious surfaces (i.e. Disconnected Impervious Areas, DIAs) by directing runoff to pervious areas, wherever possible.
 3. To the maximum extent practicable, incorporate the techniques for Low Impact Development Practices (e.g. protecting existing trees, reducing area of impervious surface, cluster development, and protecting open space) described in the *Pennsylvania Stormwater Best Management Practices Manual*, Pennsylvania Department of Environmental Protection (PADEP) no. 363-0300-002 (2006).
- C. The Township may, after consultation with the Department of Environmental Protection (PADEP), approve measures for meeting the state water quality requirements other than those in this Part, provided that they meet the minimum requirements of, and do not conflict with, state law including, but not limited to, the Clean Streams Law.
- D. For all regulated earth disturbance activities, Erosion and Sediment (E&S) Control Best Management Practices (BMPs) shall be designed, implemented, operated, and maintained during the Regulated Earth Disturbance Activities (e.g., during construction) to meet the purposes and requirements of this Ordinance and to meet all requirements under Title 25 of the Pennsylvania Code and the Clean Streams Law. Various BMPs and their design standards are listed in the *Erosion and Sediment Pollution Control Program Manual*, No. 363-2134-008 (April 15, 2000), as amended and updated.
- E. No approval of any subdivision or land development plan, or issuance of any building, zoning, Erosion and Sedimentation Control and Grading Permit, occupancy permit, or the

commencement of any earth disturbance at a project site within the Township, shall proceed until the requirements of this Part are met, including approval of a Stormwater Management Plan under Section 26-131 and a permit under PADEP regulations, where applicable.

- F. Erosion and sediment control during land development shall be addressed as required by Section 26-130.
- G. Volume controls shall be addressed within the Neshaminy Creek Watershed as required by Section 26-123.
- H. Water quality protection and infiltration shall be addressed as required by Sections 26-125 and 26-126.
- I. All Best Management Practices (BMPs) shall conform to the design criteria of this Part and Pennsylvania Stormwater Management Practices Manual, December 30, 2006.
- J. Techniques described in Appendix D (Low Impact Development Techniques) of this Part are encouraged because they reduce the costs of complying with the requirements of this Part and the State Water Quality requirements.
- K. Infiltration BMPs should be spread out, made as shallow as practicable, and located to minimize the use of natural onsite infiltration features while still meeting the other requirements of this Ordinance.
- L. Stormwater drainage systems shall be provided in order to permit unimpeded flow along natural watercourses, except as modified by stormwater management facilities designed to encourage infiltration, groundwater recharge, and improved water quality.
- M. Existing points of concentrated drainage that discharge onto adjacent property shall not be altered without written approval of the affected property owner(s) and shall be subject to any applicable discharge criteria specified in this Part.
- N. Areas of existing sheet flow discharge shall be maintained wherever possible. If sheet flow is proposed to be concentrated and discharged onto adjacent property, the developer must document that adequate downstream conveyance facilities exist to safely transport the concentrated discharge, or otherwise prove that no erosion, sedimentation, flooding or other harm will result from the concentrated discharge; and submit written approval from the affected adjacent property owner(s).
- O. For all subdivision and land development applications, the tributary area discharging drainage to any location along the site property boundary shall not increase by more than twenty-five (25) percent over the predevelopment condition without written approval from the adjacent affected property owner(s).
- P. Where a development site is traversed by watercourses, drainage easements shall be provided conforming to the line of such watercourses. The width of the easement shall be adequate to provide for the unimpeded flow of stormwater runoff from the 100 year storm event. However, in no case shall the easement be less than thirty (30) feet in width. Terms of the easement shall prohibit excavation, the placing of fill or structures, and any alterations that may adversely affect the flow of stormwater within any portion of the easement. Periodic maintenance of the easement shall be required by the landowner to

ensure proper runoff conveyance. The developer will retain the easement until such time as one of the following is accomplished:

1. For subdivisions or land developments, the individual lot owner assumes responsibility for the maintenance of the portion of their property through which the easement passes. The record plan shall contain a description of such easement(s) and notation indicating the maintenance responsibilities.
 2. A homeowner's association or other legal entity approved by the Township, assumes responsibility for the maintenance of the development, including the watercourse easement. The record plan shall contain a description of such easement(s) and notation indicating the maintenance responsibilities.
- Q. When it can be shown that, due to topographic conditions, natural drainageways on the site cannot adequately provide for drainage, open channels may be constructed conforming substantially to the line and grade of such natural drainageways. Work within natural drainageways shall be subject to approval by PADEP through the Joint Permit Application process, or, where deemed appropriate by PADEP, through the General Permit process.
- R. Any stormwater management facilities regulated by this Part that will be located in or adjacent to Waters of the Commonwealth, Waters of the United States, or wetlands shall be subject to approval by PADEP and/or US Army Corps of Engineers through the Joint Permit Application process, or, where deemed appropriate by PADEP and/or US Army Corps of Engineers, the General Permit process. When there is a question whether wetlands may be involved, it is the responsibility of the Developer or his agent to show that the land in question cannot be classified as wetlands, otherwise approval to work in the area must be obtained from PADEP and/or US Army Corps of Engineers.
- S. Any stormwater management facilities regulated by this Part that would be located on state highway rights-of-way, or discharge stormwater to facilities located within a state highway right-of-way, shall be subject to approval by the Pennsylvania Department of Transportation (PADOT).
- T. Site disturbance and impervious surface shall be minimized. Infiltrating stormwater runoff through seepage beds, infiltration trenches, etc. shall be required, where soil conditions permit, to reduce the size or eliminate the need for retention/detention facilities.
- U. Roof drains and sump pumps shall discharge to an infiltration bed, natural watercourse, storm sewer system, or drainage swale (within a stormwater easement). Roof drains and sump pumps shall be connected to a storm sewer, drainage structure, or other approved stormwater conveyance facility that is designed as part of a stormwater management BMP. In no case shall roof drains or sump pumps be connected to a sanitary sewer or permitted to discharge across a sidewalk, walkway, or to a street through the curb.
- V. Special requirements for watersheds draining to high quality (HQ) and exceptional value (EV) waters: The temperature and quality of water and streams that have been determined to be exceptional value and high quality are to be maintained as defined in Chapter 93, Water Quality Standards, Title 25 Pennsylvania Department of Environmental Protection Rules and Regulations. Maintaining the multiple values of these Special Protection Waters occurs through maintaining the pre-development or natural water cycle; not decreasing infiltration and recharge; and not increasing runoff. In so doing, critical temperature

considerations are provided (optimal temperature control is achieved through infiltration of precipitation to groundwater which maximizes temperature-moderated stream base flow). In those cases where Runoff Volume Control cannot be achieved as per Section 26-126.D, temperature sensitive BMPs and stormwater conveyance systems are to be used and designed with storage pool areas (drawing outflow from the bottom of the pool) and supply outflow channels shall be shaded with trees. This will require modification of berms for permanent ponds and the relaxation of restrictions on planting vegetation within the facilities, provided that capacity for volumes and rate control is maintained. At a minimum, the southern half of pond shorelines shall be planted with shade or canopy trees within ten (10) feet of the pond shoreline. In conjunction with this requirement, the maximum slope allowed on the berm area to be planted is 10 to 1. This will lessen the destabilization of berm soils due to root growth. A long-term maintenance schedule and management plan for the thermal control BMPs is to be established and recorded for all development sites.

- W. All stormwater runoff shall be pretreated for water quality prior to discharge to surface or groundwater as required by Section 26-125 of this Part
- X. Completed stormwater management facilities, including detention/retention basins, shall be surveyed by a professional land surveyor or engineer licensed in the Commonwealth of Pennsylvania, to verify compliance with the character of stormwater management facilities as depicted on the approved final plan (or subsequently approved revision, thereof). As-constructed plans shall be submitted to Plumstead Township for review and approval, upon completion of construction of all facilities. Where stormwater management facilities are constructed as part of a subdivision or land development application, the as-built plan must be submitted to, and approved by, Plumstead Township prior to offer of dedication of any public facilities and/or release of financial security for the required maintenance period. Public facilities will not be accepted by Plumstead Township until such time the as-constructed plans have been reviewed and approved by the Township Engineer.
- Y. The record plan and development agreement for an approved subdivision or land development shall define the ownership and maintenance responsibilities as well as access rights for all drainage related easements. Specifically, the record plan shall contain a provision permitting access to such easement(s), at any reasonable time, for inspection and/or emergency repair/maintenance, by Plumstead Township or its designee, of all facilities deemed critical to public welfare. In the event the lot owner or homeowner's association fails to honor their maintenance responsibilities set forth herein, in any manner, Plumstead Township shall have the right of entry upon and within the area of the easement to undertake any required corrective or maintenance effort. The total cost of such, including administrative, engineering, and legal costs for enforcement, may be imposed upon the responsible party as determined by Plumstead Township. Failure to remedy all associated costs described above, may be subject of the imposition of a lien by the Township against the owner(s) in question, in the same manner as the Township might otherwise be empowered by law to assess or impose a lien against a property for municipal improvements.

Section 26-122. Stormwater Management Districts – Peak Rate Control

- A. Mapping of Stormwater Runoff Peak Rate Districts - In order to implement the provisions of this Part, the Tohickon Creek Watershed Stormwater Management Plan, Neshaminy Creek Watershed Stormwater Management Plan, and Delaware River (South) Watershed Stormwater Management Plan, Plumstead Township is divided into Stormwater Runoff Peak Rate Districts consistent with the plans. The boundaries of the districts are indicated

on the runoff peak rate district map that is available for inspection at the Township building. A large-scale boundary map is included as Appendix G for reference.

- B. The exact location of the Stormwater Runoff Peak Rate District boundary as it applies to a given development site shall be determined by mapping the boundaries using the 2-foot or 5-foot topographic contours provided as part of the stormwater management plan developed for the site in accordance with the Subdivision and Land Development Ordinance [Chapter 22]. The District boundaries as originally drawn coincide with topographic divides or, in certain instances, are drawn from the intersection of the watercourse or a potential flow obstruction to the topographic divide consistent with topography. The locations determined on the stormwater management plan shall be reviewed and verified by the Township Engineer.
- C. Description of Tohickon Creek Watershed Stormwater Runoff Hydrologic Peak Rate Districts
 - 1. Conditional No Detention Districts (Direct Discharge). Subareas identified on the official Sub-Basin Map available for inspection at the Township Office. Included in this district are 2, 3, 8-10. These sub-areas may discharge post-development runoff without detention facilities without adversely affecting the total watershed peak flow. These areas are located adjacent to the Delaware River. However, where the conveyance capabilities of the local receiving facilities are not adequate to safely transport the increased peak flows from undetained runoff a 100% release rate control is applied.
 - 2. 100 Percent Release Rate District. Subareas included in this district are 4-7, 11, 13, 16, 33-34. These subareas are not expected to incur a great deal of development growth due to location, topography, soils, or a combination of all three factors. Also, the location in the watershed of these sub-areas is of minor importance in supporting the overall watershed level runoff control. Therefore, these areas are allowed to release development runoff at a rate that does not exceed the existing rates of runoff.
- D. For the purpose of implementing the provisions of the Neshaminy Creek Watershed Stormwater Management Plan, District "A", and Delaware River South Watershed Stormwater Management Plan, District "A", design storm proposed conditions shall be controlled to design storm existing conditions as follows:

<u>Design Storm Proposed Conditions</u>	to	<u>Design Storm Existing Conditions</u>
2-year		1-year
5-year		5-year
10-year		10-year
25-year		25-year
50-year		50-year
100-year		100-year

- E. Sites Located in More Than One District - For a proposed development site located within two or more release category subareas, the peak discharge rate from any subarea shall be the pre-development peak discharge for that subarea multiplied by the applicable release rate. The calculated peak discharges shall apply regardless of whether the grading plan changes the drainage area by subarea.

- F. Off-Site Areas - Off-site areas that drain through a proposed development site are not subject to release rate criteria when determining allowable peak runoff rates or volume reduction. However, on-site drainage facilities shall be designed to safely convey off-site flows through or around the development site to existing points of discharge from the property.
- G. Where the area of a site being impacted by a proposed development activity differs significantly from the total site area, only the proposed disturbed area utilizing stormwater management measures shall be subject to the management district criteria. Non-impacted or undisturbed areas that do not flow into, or are bypassing, the stormwater management facilities shall not be subject to the Stormwater Management District criteria.
- H. Stormwater Conveyance Corridor Protection (Riparian Corridor Preservation and Vegetation) – Runoff from developed areas of the site, including but not limited to areas of impervious surface, shall be managed through a series of riparian corridor vegetation facilities whenever possible. This will be accomplished in a manner satisfactory to the Township, utilizing the “Pennsylvania Stormwater Best Management Practices Manual, December 30, 2006” as amended. Riparian Forested Buffer: the priority goal of the riparian vegetation will be the reduction of thermal impacts on stormwater runoff associated with impervious areas, with a secondary goal being the protection of capacity of existing stormwater conveyance channels. These goals will be achieved through the use of design criteria within this Part and the Pennsylvania Stormwater Best Management Practices Manual, and shall be in addition to any other Township Ordinance provisions.
- I. Regional Detention Alternatives – For certain areas within the study area, it may be more cost-effective to provide one control facility for more than one development site than to provide an individual control facility for each development site. The initiative and funding for any regional runoff control alternatives are the responsibility of prospective developers. The design of any regional control basins must incorporate reasonable development of the entire upstream watershed. The peak outflow of a regional basin would be determined on a case-by-case basis using the hydrologic model of the watershed consistent with protection of the downstream watershed areas. “Hydrologic model” refers to the calibrated model as developed for the stormwater management plan.
- J. "Downstream Hydraulic Capacity Analysis"-Any downstream capacity hydraulic analysis conducted in accordance with this Part shall use the following criteria for determining adequacy for accepting increased peak flow rates:
1. Natural or man-made channels or swales must be able to convey the increased runoff associated with a 2-year return period event within their banks at velocities consistent with protection of the channels from erosion. Acceptable velocities shall be based upon criteria included in the DEP *Erosion and Sediment Pollution Control Program Manual*.
 2. Natural or man-made channels or swales must be able to convey the increased 25-year return period runoff without creating any hazard to persons, property, or wildlife and aquatic habitat. Habitat impact should be minimized or avoided.
 3. Culverts, bridges, storm sewers or any other facilities which must pass or convey flows from the tributary area must be designed in accordance with DEP, Chapter 105 regulations (if applicable) and, at a minimum, pass the increased 25-year return period runoff.

Section 26-123. Volume Control Standards – Neshaminy Creek Watershed

A. Volume Control

Volume controls will mitigate increased runoff impacts, protect stream channel morphology, maintain groundwater recharge, and contribute to water quality improvements. Stormwater runoff volume control methods are based on the net change in runoff volume for the two-year storm event.

Volume controls shall be implemented using the Design Storm Method in subsection 1. or the Simplified Method in subsection 3. below. For Regulated Activities which propose 2,500 square feet or less of impervious surface, this Ordinance establishes no preference for either methodology; therefore, the applicant may select either methodology on the basis of economic considerations, the intrinsic limitations of the procedures associated with each methodology, and other factors. All regulated activities greater than 2,500 square feet must use the Design Storm Method.

1. **Design-Storm Method (Any Regulated Activity):** This method requires detailed modeling based on site conditions. For modeling assumptions refer Section 26-129.
 - a. Post-development total runoff shall not be increased from pre-development total runoff for all storms equal to or less than the 2-year 24-hour duration precipitation.
 - b. To estimate the increased volume of runoff (cubic feet) for the 2-year 24-hour duration precipitation event for existing site conditions (pre-development) and for the proposed developed site conditions (post-development), it is recommended to use the soil cover complex method as shown in this section. Appendix A is available to guide a qualified professional and/or an applicant to calculate the stormwater runoff volume. The calculated volume shall be either reused, evapotranspired, or infiltrated through structural or nonstructural means.

Soil Cover Complex Method:

Step 1: Runoff (in) = $Q = (P - 0.2S)^2 / (P + 0.8S)$ where

P = 2-year 24-hour Rainfall (3.26 inches per Appendix A)

S = $(1000 / CN) - 10$, the potential maximum retention
(including initial abstraction, Ia)

Step 2: Runoff Volume (Cubic Feet) = $Q \times \text{Area} \times 1/12$

Q = Runoff (in)

Area = SWM Area (sq ft), as calculated per Section 26-123.A.2.a.

2. **Stormwater Control Measures:**

The applicant must demonstrate how the required volume is controlled through Stormwater Best Management Practices (BMPs) which shall provide the means necessary to capture, reuse, evaporate, transpire or infiltrate the total runoff volume.

- a. If natural resources exist on the site, the applicant is required to submit a SWM Site Plan and determine the total acreage of protected area where no disturbance is proposed. The acreage of the protected area is subtracted from the total site area and not included in the stormwater management site area (SWM Area) acreage used in determining the volume controls.

$$\text{Stormwater Management Site Area} = \text{Total Site Area (for both pre and post development conditions)} - \text{Protected Area}$$

Natural Resource Areas must be calculated based upon the natural resource protection requirements in the Plumstead Township Zoning Ordinance. Appendix A provides for guidance to assess the total protected area. For additional reference refer Chapter 5 Section 5.4.1 of the PA BMP manual.

- b. Calculate the volume controls provided through nonstructural BMPs. Table A-5 in Appendix A is recommended as guidance.
- c. Volume controls provided through nonstructural BMPs are subtracted from the required volume to determine the necessary structural BMPs.

$$\text{Required Volume Control (ft}^3\text{)} - \text{Nonstructural Volume Control (ft}^3\text{)} = \text{Structural Volume Requirement (ft}^3\text{)}$$

- d. Calculate the volume controls provided through structural BMPs. Table A-6 in Appendix A is recommended as guidance. Refer PA BMP manual Chapter 6 for description of the BMPs.
- e. Infiltration BMPs intended to receive runoff from developed areas shall be selected based on the suitability of soils and site conditions. Infiltration BMPs shall be constructed on soils that have the following characteristics:
 - (1) A minimum soil depth of twelve (12") inches between the bottom of the infiltration BMPs and the top of bedrock or seasonally high water table.
 - (2) An infiltration rate sufficient to accept the additional stormwater load and dewater completely as determined by field tests. A minimum of 0.2 inches/hour (in/hr) should be utilized and for acceptable rates a safety factor of 50% should be applied for design purposes (e.g., for soil which measured 0.4 in/hr, the BMP design should use 0.2 in/hr to insure safe infiltration rates after construction).
 - (3) All infiltration facilities shall be designed to completely infiltrate runoff volume within two (2) days (48 hours) from the peak of the design storm.

- f. Soils – A soils evaluation of the project site shall be required to determine the suitability of infiltration facilities. All regulated activities are required to perform a detailed soils evaluation by a qualified design professional which at minimum addresses soil permeability, depth to bedrock, and subgrade stability. The general process for designing the infiltration BMP shall be:
- (1) Analyze hydrologic soil groups as well as natural and man-made features within the site to determine general areas of suitability for infiltration practices. In areas where development on fill material is under consideration, conduct geotechnical investigations of sub-grade stability; infiltration may not be ruled out without conducting these tests.
 - (2) Provide field tests such as double ring infiltrometer or hydraulic conductivity tests (at the level of the proposed infiltration surface) to determine the appropriate hydraulic conductivity rate. Percolation tests are not recommended for design purposes.
 - (3) Design the infiltration structure based on field determined capacity at the level of the proposed infiltration surface and based on the safety factor of fifty (50) percent.
 - (4) If on-lot infiltration structures are proposed, it must be demonstrated that the soils are conducive to infiltrate on the lots identified.
 - (5) An impermeable liner will be required in detention basins where the possibility of groundwater contamination exists. A detailed hydrogeologic investigation may be required by the Township.
3. **Simplified Method (Regulated activities less than 2,500 square feet of impervious surface)**

Individual home construction projects on single family lots which result in less than two thousand five hundred (2,500) square feet of new impervious area (including the building footprint, driveway, sidewalks, and parking areas) and less than five thousand (5,000) square feet of earth disturbance may utilize the simplified procedure contained in Appendix J to meet requirements of this Part and are not required to submit detailed stormwater management plans prepared pursuant to Section 26-132 of this Part. This procedure may not be utilized for proposed subdivision or land developments.

Section 26-124. Nonstructural Project Design (Sequencing to Minimize Stormwater Impacts)

- A. For design and applicability of non-structural BMPs refer to Chapter 5 of the “Pennsylvania Stormwater Management Practices Manual”, December 2006, as amended. For the non-structural BMPs proposed, the applicant shall utilize and submit appropriate checklists included in Chapter 8, Section 8.8 of the “Pennsylvania Stormwater Best Management Practices Manual”, December 2006, as amended (refer Appendix E) to demonstrate that the BMPs are applicable to the project and to determine the amount of volume or peak rate credit is applicable.
- B. The applicant shall demonstrate that regulated activities are designed in the following sequence to minimize the increases in stormwater runoff and impacts to water quality:

1. Prepare a Site Analysis and Resource Conservation Plan (SARCP), as required by the Subdivision and Land Development Ordinance [Chapter 22], showing environmentally sensitive areas including, but not limited to, steep slopes, ponds, lakes, streams, wetlands, hydric soils, vernal pools, floodplains, riparian corridors, hydrologic soil groups A, B, C, and D, “prime agricultural soils” (prime farmland and farmland of statewide importance as designated in the soil survey of Bucks County), woodlands, surface waters regulated by the State or Federal Government, any existing recharge areas, and any other requirements outlined in the Subdivision and Land Development Ordinance [Chapter 22].
2. Prepare a draft project layout avoiding sensitive areas identified in Section 26-124.B.1 (as further defined by Part 24 of Chapter 27 of Plumstead Township Code of Ordinances) and minimizing total site earth disturbance. The ratio of disturbed area to the entire site area and measures taken to minimize earth disturbance shall be included in the SARCP.
3. Identify site specific existing conditions, drainage areas, discharge points (points of interest), recharge areas, and hydrologic soil groups A and B.
4. Evaluate Nonstructural Stormwater Management Alternatives (Refer Appendix E).
 - a. Minimize earth disturbance.
 - b. Minimize impervious surfaces.
 - c. Break up large impervious surfaces.
5. Satisfy water quality objective (Section 26-125).
6. Satisfy groundwater recharge (infiltration) objective (Section 26-126) and provide for stormwater treatment prior to infiltration.
7. Satisfy stream bank erosion protection objective (Section 26-127).
8. Determine the Watershed Management District within which the site is located (refer Appendix G) and conduct a predevelopment runoff analysis.
9. Prepare final project design to maintain predevelopment drainage areas and discharge points, to minimize earth disturbance and impervious surfaces, to reduce runoff to the maximum extent possible, and to minimize the use of surface or point discharges.
10. Conduct a proposed conditions runoff analysis based on the final design to meet the release rate requirements for streambank erosion (Section 26-127).
11. Manage any remaining runoff through treatment prior to discharge, as part of detention, bioretention, direct discharge or other structural control.
12. Prepare a stormwater management operation and maintenance plan consistent with requirements of Section 26-162 that ensures the long term viability of the stormwater control facilities.

Section 26-125. Water Quality Requirements (Delaware River South and Tohickon Creek Watersheds)

- A. The project plan shall specify permanent stormwater BMPs to be implemented, operated, and maintained to meet water quality requirements. Because water quality requirements vary depending on the “uses” of the waterbodies in the watershed, a framework methodology is provided here.
- B. In order to protect and maintain water quality, additional stormwater runoff created by the development project must be captured, stored, and treated. In addition, postconstruction stormwater infiltration of runoff must replicate preconstruction infiltration of runoff to the maximum extent possible, in High Quality and Exceptional Value Watershed, special requirements may apply.
- C. The volume of additional stormwater runoff to be captured, stored, and treated is called the Water Quality Volume (“WQ_v”).

- 1. The formula for determining WQ_v is:

WQ_v = [(P)(R_v)(A)]/12 (acre-feet), where

P = Rainfall depth in inches, using the “90% storm” – the volume of rainfall for 90% of the storm events which produce runoff in the watershed annually. For Year 2008, PennDOT Region 5, the P value is 2.04 inches.

A = Project Area in acres

R_v = Volume Runoff Coefficient [0.05 + 0.009(I)], where I is the impervious surface percentage (impervious area ÷ total project area) X 100%

- 2. In Special Protection Watersheds, as described in 25 Pa Code Chapter 93, this volume is required to remain onsite through infiltration and other methods, to protect water quality. Guidance can be obtained from PADEP.
- D. The following factors must be considered when evaluating the suitability of BMPs used to control water quality at a given development site:
 - 1. Total contributing drainage area.
 - 2. Permeability and infiltration rate of the site soils.
 - 3. Topographic slope and depth to bedrock.
 - 4. Seasonal high water table.
 - 5. Proximity to building foundations and wellheads.
 - 6. Erodibility of soils.
 - 7. Land availability and configuration of the topography.
 - 8. Peak discharge and required volume control.
 - 9. Streambank erosion.
 - 10. Efficiency of the BMPs to mitigate potential water quality problems.

11. Volume of runoff that will be effectively treated.
12. Nature of the pollutant being removed.
13. Maintenance requirements.
14. Creation/protection of aquatic and wildlife habitat.
15. Recreational value.
16. Enhancement of aesthetic and property value.

To accomplish the above, the applicant shall submit original and innovative designs for review. Such designs may achieve the water quality objectives through a combination of BMPs (Best Management Practices).

- E. The applicant may, subject to approval of Plumstead Township, use any of the following nonstructural stormwater credits, generally described in the following table, in computing the required water quality volume. Additional innovative design techniques may be utilized where approved by the Township. The applicant should consult with the Township early in the design phase when a new approach to nonstructural stormwater design is proposed.

Stormwater Credit	Description
Natural Area Conservation	Conservation of natural areas such as forest, wetlands, or other sensitive areas in a protected easement thereby retaining their predevelopment hydrologic and water quality characteristics. Using this credit, a designer may subtract conservation areas from total site area when computing the required water quality volume.
Disconnection of Rooftop Runoff	Credit is given when rooftop runoff is disconnected and then directed over a pervious area where it is infiltrated. Credit is typically obtained by grading the site to promote overland flow or by providing bioretention on single-family residential lots. If a rooftop area is adequately disconnected, the impervious area may be deducted from the total impervious cover.
Disconnection of Non-Rooftop Runoff	Credit is given for practices that disconnect surface impervious cover by directing it to pervious areas where it is infiltrated. As with rooftop runoff, the impervious area may be deducted from the total impervious cover thereby reducing the required water quality volume.
Stream Buffer Credit	Credit is given when a stream buffer effectively treats stormwater runoff. Effective treatment constitutes capturing runoff from pervious and impervious areas adjacent to the buffer and treating the runoff through overland flow across a grass or forested area. Areas treated in this manner may be deducted from total site area.
Grass Channel (Open Section Roads)	Credit may be given when open grass channels are used to reduce the volume of runoff and pollutants during smaller storms. If designed according to appropriate criteria, these channels may meet water quality criteria for certain types of residential development.
Environmentally Sensitive Rural Development	Credit is given when a group of environmental site design techniques are applied to low density or rural residential development. This credit eliminates the need for structural practices to address water quality volume.

- F. The volume and rate of any stormwater discharges allowed under this Part must be managed to prevent the physical and chemical degradation of receiving waters. If a detention facility is proposed which is part of the BMPs approved for the project, the facility(ies) must be designed to provide for a 24-hour extended detention of the 1-year, 24-hour storm event (i.e., the stormwater runoff will be released over a minimum 24 hours for the 1-year 24-hour storm event from the time of peak inflow to zero outflow).

Section 26-126. Additional Requirements Applicable to Infiltration Oriented Stormwater Management Systems (Delaware River South and Tohickon Creek Watersheds)

- A. Prevention of stormwater runoff is key objective of Chapter 93 of the DEP regulations, because runoff can change the physical, chemical, and biological integrity of waterbodies thereby impacting water quality.
- B. The project plan shall describe how water quality protection requirements will be met. Infiltration BMPs shall be evaluated and utilized to the maximum extent possible to manage the net change in stormwater runoff generated so that post construction discharges do not degrade the physical, chemical, or biological characteristics of the receiving waters. These BMPs may be used to satisfy all or part of the requirements in Section 26-125.
- C. Post construction stormwater infiltration of runoff shall replicate preconstruction infiltration of runoff to the maximum extent possible. In High Quality and Exceptional Value Watersheds, special requirements apply (refer Section 26-125 of this Part).
- D. In calculating the volume of runoff that can be infiltrated at a site, the following methodology shall be used:

- 1. Methodology:

$Re_v = [(S)(R_v)(A)]/12$ (acre-feet), where:

Re_v = Recharge Volume (acre-feet)

S = Soil specific recharge factor (inches)

A = Site area contributing to the recharge facility (acres)

R_v = Volumetric runoff coefficient, $R_v = 0.05 + 0.009(I)$, where:

I = percent impervious area, and

S shall be obtained based upon hydrologic soil group based upon the table below:

<u>Hydrologic Soil Group</u>	<u>Soil Specific Recharge Factor (S)</u>
A	0.38
B	0.25
C	0.13
D	0.06

If more than one hydrologic soil group (HSG) is present at a site, a composite recharge volume shall be computed based upon the proportion of total site area within each HSG.

- 2. In selecting the appropriate infiltration BMPs, the applicant shall consider the following:
 - (a) Permeability and infiltration rate of the site soils.
 - (b) Topographic slope and depth to bedrock.
 - (c) Seasonal high water table.

- (d) Proximity and elevation relative to building foundations, basements, and well heads. (Infiltration BMP should be located downgrade of these structures).
 - (e) Erodibility of soils.
 - (f) Land availability, configuration, and topography.
 - (g) Peak discharge and required volume control.
 - (h) Streambank erosion.
 - (i) Efficiency of the BMPs to mitigate potential water quality problems.
 - (j) Volume of runoff that will be effectively treated.
 - (k) Nature of the pollutant being removed.
 - (l) Maintenance requirements.
 - (m) Creation/protection of aquatic and wildlife habitat.
 - (n) Recreational value.
 - (o) Enhancement of aesthetic and property value.
3. A detailed soils evaluation of the project site shall be performed to determine the suitability of infiltration BMPs (refer Section 26-132.A). The evaluation shall be performed by a qualified professional, and at a minimum, address soil permeability, depth to bedrock, susceptibility to sinkhole formation, and subgrade stability. The site testing shall include adequate sampling of all portions of the site not limited by 100% protected natural resources to determine areas of the property which are suitable for infiltration BMPs. The general process for designing the infiltration BMP shall be:
- (a) Analyze hydrologic soil groups as well as natural and manmade features within the watershed to determine general areas of suitability for infiltration BMPs.
 - (b) Provide field testing data at the elevation of the proposed infiltration zone (bottom surface of infiltration facilities) to determine appropriate percolation rate and/or hydraulic conductivity. Field Testing guidelines are identified in Appendix C.
 - (c) Design infiltration BMPs for required stormwater volume based on field-determined capacity at the level of the proposed infiltration surface.
4. Soil characteristics:
- (a) Infiltration BMPs are particularly appropriate in hydrologic soil groups A and B, as described in the Natural Resources Conservation Service Manual TR-55.
 - (b) Low-erodibility factors ("K" factors) are preferred for the construction of basins.

- (c) There must be a minimum depth of twelve (12) inches between the bottom of any facility and the seasonal high water table and/or bedrock (limiting zones). The minimum required separation between the limiting zone may be increased, if required by the Township, should project specific conditions exist (such as anticipated increased contaminants) which dictate greater prevention of groundwater contamination.
 - (d) There must be an infiltration and/or percolation rate sufficient to accept the additional stormwater load, and to drain completely as determined by field tests.
 - (e) A minimum of thirty (30) feet of undisturbed fill shall separate the foundation wall of any building and an infiltration BMP.
 - (f) The infiltration system shall have positive overflow controls to prevent storage within one foot of the finished surface of grade.
 - (g) Infiltration rates shall not be used in computing the storage volume of the infiltration system.
 - (h) Surface inflows shall be designed to prevent direct discharge of sediment into the infiltration system.
5. The recharge volume provided at the site shall be directed to the most permeable HSG (Hydrologic Soil Group) available, except where other considerations apply such as in limestone geology.
 6. Any infiltration BMP shall be capable of completely infiltrating the impounded water within forty-eight (48) hours from the peak of the storm.
 7. Special attention shall be paid to proper installation of infiltration oriented stormwater management systems during construction, and to careful avoidance of soil compaction during site development.
 8. Infiltration is not permitted in geologically susceptible limestone areas. All stormwater facilities in geologically susceptible limestone areas must be constructed with an impermeable liner approved by the Township to prevent seepage of water into the ground. All proposed channels or swales receiving or conveying concentrated stormwater runoff must be protected with an impermeable liner approved by the Township.
 9. Caution shall be exercised where salt or chloride would be a pollutant since soils do little to filter this pollutant and it may contaminate the groundwater. Extreme caution shall be exercised where infiltration is proposed in source water protection areas. The qualified design professional shall evaluate the possibility of groundwater contamination from the proposed infiltration/recharge facility and perform a hydrogeologic justification study if necessary. The infiltration requirement in High Quality/Exceptional Value waters shall be subject to DEP's Title 25: Chapter 93 Antidegradation Regulations. The Township may require the installation of an impermeable liner in BMP and/or detention basins where the possibility of

groundwater contamination exists. A detailed hydrogeologic investigation may be required by the Township.

10. The plan must include safeguards against groundwater contamination for uses which may cause groundwater contamination, should there be a mishap or spill.
11. During the period of land disturbance, runoff shall be controlled prior to entering any proposed infiltration area. Areas proposed for infiltration BMPs shall be protected from sedimentation and compaction during the construction phase, so as to maintain their maximum infiltration capacity.
12. Infiltration BMPs shall not be constructed nor receive runoff until the entire contributory drainage area to the infiltration BMP has achieved final stabilization.
13. The requirements for volume control and infiltration are applied to all disturbed areas, even if they are ultimately to be a pervious or permeable land use such as lawn or other landscaped area, given the extent to which development-related disturbance leads to compaction of the soils and reduces their infiltrative capacity.

Section 26-127. Stream Bank Erosion Requirements

In addition to the water quality volume, to minimize the impact of stormwater runoff on downstream stream bank erosion, a BMP must be designed to detain the proposed condition's 2-year, 24-hour design storm to the existing conditions 1-year flow using the SCS Type II distribution. Additionally, provisions shall be made (such as adding a small orifice at the bottom of the outlet structure) so that the proposed condition's 1-year storm takes a minimum of 24-hours to drain from the facility from a point where the maximum volume of water from the 1-year storm is captured (e.g. the maximum water surface elevation is achieved in the facility).

Release of water may begin at the start of the storm (e.g. the invert of the water quality orifice is at the invert of the facility). The design of the facility shall minimize clogging and sedimentation. Orifices smaller than four (4) inches in diameter are not allowed unless the design engineer can verify that the smaller orifice is protected from clogging by use of trash racks, etc. In that case, smaller orifices may be permitted. Trash racks are required for any primary orifice.

Whenever a watercourse is located within a development site, it shall remain open in the natural state and location and shall not be piped, impeded, or altered (except for road crossings). It is the responsibility of the developer to restore existing eroded stream/channel banks within a subdivision or land development site and obtain all permits necessary from PADEP, to do so. The developer must submit pictorial documentation of existing stream/channel banks to determine whether existing banks must be stabilized.

Section 26-128. Design Criteria for Stormwater Management Facilities and Best Management Practices

- A. Stormwater runoff which may result from Regulated Activities listed in Section 26-104 shall be controlled by permanent stormwater runoff BMPs that will provide the required standards within Article III. The methods of stormwater control or Best Management Practices (BMPs) which may be used to meet the required standards are described in this Part and "Pennsylvania Stormwater Best Management Practice Manual", December 30, 2006, as amended. The choice of BMPs is not limited to the ones appearing in this Part

and the manual, however, any selected BMP must meet or exceed the runoff peak rate requirements of this Part for the applicable Hydrologic District.

- B. Any stormwater facility located on state highway rights-of-way shall be subject to approval by the Pennsylvania Department of Transportation.
- C. Collection System Standards
 - 1. Curb Inlets – Curb inlets shall be located at curb tangents on the uphill side of street intersections, and at intervals along the curb line to control the maximum amount of encroachment of runoff on the roadway pavement so that same does not exceed a width of four feet during the design storm event. Design and location of curb inlets shall be approved by the Township.
 - 2. Pipe Materials – All storm sewer piping shall be Class III reinforced concrete pipe, except when pipe class and strength is required to be increased in accordance with PennDOT Specifications. Piping shall be saw-cut at ends, as needed, and not hammered or broken. All pipe joints and lift holes must be mortared except where designed for infiltration.
 - 3. Minimum Pipe Size – Minimum pipe diameter shall be eighteen (18) inches (or an equivalent flow area of 1.76 square feet).
 - 4. Inlet and Manhole Construction – Inlet and manhole castings and concrete construction shall be equivalent to PennDOT Design Standards. Manholes shall be equipped with open grate lids. All inlet grates shall be “bicycle safe” heavy duty structural steel. All storm sewer inlets must be identified with a storm drain marker. Storm drain markers shall be stainless steel affixed to the inlet hood with adhesive, rivets or bolts. (Marker may be bolted to the grate in off road locations). Marker shall have a minimum diameter of 3½ inches and include “No Dumping – Drains to Waterway” and a fish symbol. Alternate designs/sizes may be used if approved by the Township.
 - 5. Open end pipes must be fitted with concrete endwalls or wing walls in accordance with PennDOT Standards.
 - 6. Flow velocity – Stormwater collection systems shall be designed to produce a minimum velocity of 3.0 feet per second when flowing full. The maximum permissible velocity shall be 15.0 feet per second. Pipe slopes shall not be less than 0.50%.
 - 7. Inlets and manholes shall be spaced at intervals not exceeding three hundred (300) feet, and shall be located wherever branches are connected or sizes are changed, and wherever there is a change in alignment or grade. For drainage lines of at least thirty-six (36) inches diameter, inlets and manholes may be spaced at intervals not exceeding four hundred (400) feet.
 - 8. Storm sewer bedding/backfill requirements shall conform to the construction details in Appendix L.
 - 9. Inlets shall be located to intercept concentrated runoff prior to discharge over public/private rights-of-way, sidewalks, streets, and driveways.

10. The capacity of all Type „C“ inlets shall be based on a maximum surface flow to the inlets of 4.0 cfs, calculated based on the 100-year frequency design storm event. The maximum flow to Type „C“ inlets located in low points (such as sag vertical curves) shall include the overland flow directed to the inlet as well as all bypass runoff from upstream inlets. The bypass flow from upstream inlets shall be calculated using inlet efficiency curves included in PennDOT Design Manual Part 2, latest edition. If the surface flow to an inlet exceeds 4.0 cfs, additional inlets shall be provided upstream of the inlet to intercept the excessive surface flow. A Type „C“ inlet at a low point of a paved area may be designed to accept a maximum of six (6) cubic feet per second (cfs). Type „M“ inlets shall be designed to accept a maximum surface flow of six (6) cfs based on the 100-year frequency design storm event, unless otherwise approved by the Township. Double inlets will not be permitted where additional pipe and inlets can be placed upstream to intercept excessive surface flow. A maximum of twelve (12) cfs shall be permitted to be collected by a Type „M“ inlet located in an isolated pervious area provided the designer can verify that such an inlet would not cause stormwater to accumulate on any adjacent public or private property, outside of an associated storm sewer easement, and that the depth of the accumulated stormwater would not exceed twelve (12) inches.
11. A minimum drop of two (2) inches shall be provided between the inlet and outlet pipe invert elevations within all inlets and manholes. When varying pipe sizes enter an inlet or manhole, the elevation of crown of all pipes shall be matched.
12. Stormwater pipes shall have a minimum depth of cover of twelve (12) inches (including over the bell) or as designated by the American Concrete Pipe Association (whichever is greater), and in no case shall any part of the pipe project into the road subbase or curb. Where cover is restricted, equivalent pipe arches may be specified in lieu of circular pipe.
13. The capacity of all stormwater pipes shall be calculated utilizing the Manning Equation for open channel flow as applied to closed conduit flow. The Manning’s roughness coefficient shall be 0.13 for all concrete pipe. In cases where pressure flow may occur, the hydraulic grade line shall be calculated throughout the storm sewer system to verify that at least one foot of freeboard will be provided in all inlets and manholes for the design storm event.
14. Culverts shall be designed based on procedures contained in Hydraulic Design of Highway Culverts, HDS #5, U.S. Department of Transportation, Federal Highway Administration. Where pressure flow is anticipated in storm sewer pipes (non-open channel flow), the applicant’s designer shall be required to calculate the elevation of the hydraulic grade line through the storm sewer system. Wherever the hydraulic grade line elevation exceeds the pipe crown elevation for the design flow, pipes with watertight joints must be specified.
15. Storm sewer structures (i.e. endwalls, inlets, and sections, etc.) may not be located on top of, or within ten (10) feet of electric, communication, water, sanitary sewer, or gas services and/or mains, unless approval is received from the Township and the Authority or Utility having jurisdiction over same.
16. Stormwater pipes must be oriented at right angles to electric, water, sanitary sewer, and gas utilities when crossing above or beneath same. Crossing angles of less

than 90 degrees will only be permitted at the discretion of the Township. When skewed crossings are permitted, interior angles between alignment of the storm sewer pipe and utility shall not be less than 45 degrees. Vertical and horizontal design of storm sewer must be linear.

17. Roadway underdrain is required along both sides of all proposed roadways, existing roadways proposed to be widened, and within existing or proposed roadside swales as directed by the Township.
 18. Where a public storm sewer system is not located within a right-of-way, or dedicated public property, a twenty (20) feet wide easement shall be established to encompass the storm sewer system. For multiple pipes or utilities, the width of the easement shall be a minimum of thirty (30) feet.
 19. A minimum of one (1) foot of freeboard, between the inlet grate and the design flow elevation, shall be provided in all storm sewer systems (inlets and manholes) for the 100-year frequency design storm event.
- D. Open Swales and Gutters – Open swales shall be designed on the basis of Manning’s Formula as indicated for collection systems with the following considerations:
1. Roughness Coefficient – The roughness coefficient shall be 0.040 for earth swales.
 2. Bank Slopes – Slopes for swale banks shall not be steeper than one (1) vertical to four (4) horizontal.
 3. Flow Velocity – The maximum velocity of flow as determined by Manning’s equation shall not exceed the allowable velocities as shown in the following table for the specific type of material, unless otherwise approved by the Township and the Bucks County Conservation District

Note: Source of the following design criteria is the Pennsylvania Department of Environmental Protection, Bureau of Soil and Water Conservation Publication, Erosion and Sediment Control Program Manual.

ALLOWABLE VELOCITY

<u>Material</u>	<u>Velocity in feet per second (fps)</u>
Well established grass on good soil	
Short Pliant bladed grass	4.0 to 5.0
Bunch grass – soil exposed	2.0 to 3.0
Stiff stemmed grass	3.0 to 4.0
Earth without vegetation	
Fine sand or silt	1.0
Ordinary firm loam	2.0 to 3.0
Stiff clay	3.0 to 5.0
Clay and gravel	4.0 to 5.0
Coarse gravel	4.0 to 5.0
Soft shale	5.0 to 6.0
Shoulders	
Earth	(as defined above)
Stabilized	6.0
Paved	10.0 to 15.0

4. Swales shall be stabilized with bio-degradable erosion control matting to permit establishment of permanent vegetation. Swales shall be of such shape and size to effectively contain the one-hundred (100) year, Rational Method design storm, and to conform to all other specifications of the Township.
5. To minimize sheet flow of stormwater across lots located on the lower side of roads or streets, and to divert flow away from building areas, the cross-section of the street as constructed shall provide for parallel ditches or swales or curb on the lower side which shall discharge only at drainage easements, unless otherwise approved by the Township.
6. Gutters and swales adjacent to road paving shall be permitted to carry a maximum flow of four (4) cubic feet per second prior to discharge away from the street surface, unless it is proven to the satisfaction of the Township by engineering calculations that the road slopes or other factors would allow higher gutter or swale capacity.
7. Flows larger than those permitted in gutters and roadside swales may be conveyed in swales outside the required road right-of-way in separate drainage easements, or may be conveyed in pipes or culverts inside or outside the required road right-of-way.
8. Existing and proposed swales shall be provided with underdrains as deemed necessary by the Township should overland seepage result in potential maintenance problems. Underdrains must discharge into a natural drainage channel or stormwater management system.
9. Where drainage swales are used to divert surface waters away from buildings, they shall be sodded, landscaped, or otherwise protected as required and shall be of a slope, shape, and size conforming with the requirements of the Township. Concentration of surface water runoff shall be permitted only in swales, watercourses, retention or detention basins, bioretention areas, or other areas designed to meet the objectives of this Part.

E. Bridge and Culvert Design

Any proposed bridge or culvert to convey flow within a perennial or intermittent stream shall be designed in accordance with the following principals:

1. Culverts and bridges shall be designed with an open bottom to maintain natural sediment transport and bed roughness, avoiding acceleration of water velocity above the natural (preexisting) condition. Rock (rip rap) lining (native material if possible) shall be installed within the culvert as needed to prevent erosion within the structure. Approximate top of rock lining must be at the level of the existing stream bottom so as to maintain normal water level and unimpeded movement of native animal species.
2. Bottom of opening shall be designed to match the bankfull channel condition in terms of width and depth. The cross-sectional area of the bankfull channel (measured at a reference location upstream of the structure) shall be matched with area in the crossing structure.

3. Above the bankfull elevation, the width shall increase a minimum of thirty (30) percent to disperse the energy of higher flow volumes and avoid undermining of the supporting structure by secondary currents.
4. The total cross-sectional area of the structure opening must be equal to or greater than the flood prone area (cross-sectional stream area at a depth of twice the maximum bankfull depth, measured at a reference location upstream of the structure). The flood prone area is approximately equal to the area flooded by a 50-year return flood.
5. All bridges, culverts, and drainage channels shall be designed to convey a flow rate equal to a one hundred (100) year, twenty-four (24) hour storm (refer Appendix A, Table A-1). All bridges and culverts shall be designed to convey the 100-year design storm without increasing the extent and depth of the 100-year floodplain.

F. Storm Sewer Design

1. Design flow rate – The storm sewer system shall be designed to carry the one hundred- (100) year frequency design storm peak flow rate. The drainage area and runoff coefficient to each inlet shall be indicated on the stormwater management plan. The 100-year flow rate shall be determined by the “Rational” method formula:

Q = CIA where:

Q = Peak runoff rate measured in cubic feet per second (cfs)

C = Runoff coefficient - The coefficient of stormwater runoff includes many variables, such as ground slope, ground cover, shape of drainage area, etc.

I = Intensity – Average Rainfall Intensity in inches per hour for a time equal to the time of concentration (in/hr).

A = Area – Drainage area in acres (ac).

Appropriate values for the rainfall intensity can be found in Appendix A, Figure A-1.

2. Consideration shall be given to future land use changes in the drainage area in selecting the Rational (“C”) coefficient. For drainage areas containing several different types of ground cover, a weighted value of “C” shall be used.
3. In determining the peak flow rate to individual storm sewer inlets (or other collection structures) the time of concentration method (as referenced in Section 26-129) shall be used for inlet drainage areas in excess of one (1) acre, unless otherwise approved by the Township. For inlet drainage areas less than one (1) acre, a five (5) minute time of concentration shall be used unless otherwise approved by the Township.
4. In determining the required design flow rate through a storm sewer piping system, if a five (5) minute time of concentration (storm duration) results in a pipe size exceeding a thirty (30) inch diameter pipe (or equivalent flow area of 4.9 square feet), the time of concentration approach (as defined herein) shall be used in determining storm duration.
5. Overflow System – An overflow system shall be provided to carry all bypass flow and/or flow in excess of storm sewer design capacity, to the detention basin (or other

approved outlet point) when the capacity of the storm sewer system is exceeded. Stormwater runoff will not be permitted to surcharge from storm sewer structures.

G. Grading and Drainage

1. After completion of rough grading, a minimum of eight (8) inches of topsoil, or the existing depth of topsoil encountered on the site (whichever is greater), shall be returned to remaining disturbed areas prior to final grading and seeding.
2. Lots shall be graded to secure proper drainage away from buildings and to prevent the collection of storm water in pools. Minimum two (2) percent slopes shall be maintained away from and around all structures. Separation between the top of foundation wall (or slab) shall comply with Township Construction Code requirements.
3. Construction - The developer shall construct and/or install such drainage structures and/or pipe which are necessary to prevent erosion damage and to satisfactorily carry off such surface waters to the nearest practical street, storm drain or natural water course.
4. Excavation - No excavation shall be made with a cut face steeper in slope than four (4) horizontal to one (1) vertical (4:1 = 25 percent), except under one or more of the following conditions:
 - (a) The fill is located so that settlement, sliding, or erosion will not result in property damage or be a hazard to adjoining property, streets, alleys or buildings.
 - (b) A written statement from a Professional civil engineer, licensed in the Commonwealth of Pennsylvania and experienced in erosion control, certifying the site has been inspected and that the proposed deviation from the slope specified above will not endanger any property or result in property damage, is submitted to and approved by the Township Engineer.
 - (c) A concrete, segmental block, or stone masonry wall, constructed in accordance with requirements of the Township Zoning Ordinance [Chapter 27] and Construction Code, is provided to support the face of the excavation.
5. Fill - No fill shall be made which creates any exposed surface steeper in slope than four (4) horizontal to one (1) vertical (4:1 = 25 percent) except under one or more of the following conditions:
 - (a) The fill is located so that settlement, sliding, or erosion will not result in property damage or be a hazard to adjoining property, streets, alleys, or buildings.
 - (b) A written statement from a Professional civil engineer, licensed in the Commonwealth of Pennsylvania and experienced in erosion control, certifying the site has been inspected and that the proposed deviation from the slope specified above will not endanger any property or result in property damage, is submitted to and approved by the Township.
 - (c) A concrete, segmental block, or stone masonry wall, constructed in accordance with Township requirements, is provided to support the face of the excavation.

6. Slopes and Fences - The top or bottom edge of slopes shall be a minimum of five (5) feet from property or right-of-way lines of streets or alleys, in order to permit the normal rounding of the edge without encroaching on the abutting property. Where walls or slopes (steeper than two (2) horizontal to one (1) vertical) are approved under the criteria in this Part, and are five (5) feet or more in height, a protective fence conforming to Township Construction Codes shall be required at the top of the wall (or bank).
7. Clean up - All lots must be kept free of any debris or nuisances whatsoever during construction.
8. Design of erosion and sedimentation control facilities (particularly stormwater/sediment basins) shall incorporate Best Management Practices as defined herein.
9. Cut and fill operations shall be kept to a minimum. Wherever feasible, natural vegetation shall be retained, protected, and supplemented. Cut and fills shall not endanger or otherwise adversely impact adjoining property.
10. No grading equipment shall be permitted to be loaded and/or unloaded on a public street, and no grading equipment shall be permitted to travel on or across a public street unless licensed for operation on public thoroughfares.
11. Grading equipment shall not be permitted to intermittent and perennial streams. Temporary crossing shall only be permitted where application is made, and approval is received, from the Pennsylvania Department of Environmental Protection (where applicable), the Bucks County Conservation District, and Plumstead Township.
12. Design of energy dissipation for high volume and/or high velocity discharge from storm sewer pipes and channels shall be in accordance with Hydraulic Engineering Circular No. 14, "Hydraulic Design of Energy Dissipaters for Culverts and Channels" as published by Department of Transportation, FHA, when deemed necessary by the Township, and as approved by the Bucks County Conservation District.
13. To control the dissemination of mud and dirt on to public roads and driveways, tire cleaning areas constructed of AASHTO #1 stone (underlain by geotextile structural fabric), at least fifty (50) feet in length shall be installed at each point of access to the site and individual lots (upon construction of internal streets in a binder condition). When deemed necessary by the Township, washing stations shall also be set-up at every construction entrance in order to wash mud and dirt from exiting vehicles. Appropriate measures must be taken to control runoff from such locations. The developer shall be responsible for the placement of appropriate signage identifying construction entrances and washing stations. Construction entrances shall be maintained by the developer during construction, as determined by the Township.
14. During construction activities, necessary measures for dust control shall be exercised, including the application of water to higher traffic areas of the site.
15. In the event any mud and/or debris is transported from the site onto a public roadway, the debris shall be removed immediately and the roadway swept and/or washed as deemed necessary by the Township at the owner's expense.

16. Adequate provision shall be made to prevent surface water from damaging the cut face of excavation and the sloping surfaces of fills.

H. Stormwater Detention/Retention Basins

1. If permanent ponds (retention basins) are proposed, the developer shall demonstrate that such ponds are designed to protect the public's health and safety.
2. During construction, duly authorized representatives of Plumstead Township may enter at any reasonable time upon any property within the Township to investigate whether construction activity is in compliance with this Part.
3. When basins are provided, they shall be designed to utilize the natural contours of the land whenever possible. When such design is not practical, the construction of the basin shall utilize slopes as flat as possible to blend the structure into the terrain.
4. Except with the one (1) year design storm, basins shall be designed so that they return to normal conditions within approximately twenty-four (24) hours after the termination of the storm, unless the Township determines that downstream conditions may warrant other design criteria for stormwater release.
5. Landscaping and planting in and around the perimeter of basins shall be provided. It shall be aesthetically pleasing and compatible with surrounding land uses, and require minimum maintenance. Proposed landscaping and planting shall also be in accordance with the provisions of this Part, the Subdivision and Land Development Ordinance [Chapter 22], and the Zoning Ordinance [Chapter 27].
6. If a stormwater management basin will serve as a temporary sediment control device, the temporary sediment control measures shall be shown including perforated riser pipes or standboxes, filter berms, clean-out stakes and other measures as may be required by Pennsylvania Department of Environmental Protection, Chapter 102 Regulations. Plans for such facilities shall require Bucks County Conservation District approval prior to implementation. Sedimentation basins shall be in place prior to any earthmoving activities within their tributary drainage areas. A note identifying the above criteria shall be required on the Record Plan of subdivisions and land developments as well as in the development agreement with the Township.
7. Stormwater management basins shall be in place before the creation of any new impervious surfaces on the site.
8. Runoff shall not be directed to any infiltration structure until all tributary drainage areas are stabilized.
9. Where permanent retention (pond) facilities are proposed, there shall be a safety ledge, ten (10) feet wide, no greater than fifteen (15) inches and no less than twelve (12) inches below the permanent water surface level.
10. All basins shall have slopes of four (4) horizontal to one (1) vertical (4:1 = 25 percent), or flatter on the basin's outer berm and three (3) horizontal to one (1) vertical or less on the basin's inner berm. The top or toe of any slope shall be located a minimum of five (5) feet from any property line. The maximum difference between the top of berm elevation and the invert elevation of the outlet structure shall be seven (7) feet.

11. All portions of a dry detention basin bottom (non wetland) shall have a minimum slope of two (2) percent.
12. All basin embankments shall be placed in lifts not to exceed one (1) foot in thickness and each lift shall be compacted to a minimum of 95% of Modified Proctor Density as established by A.S.T.M. D-1557. Prior to proceeding to the next lift, the compaction shall be verified by a Soils Engineer employed by the applicant/developer. Compaction tests shall be run on the leading and trailing edge of the berm along with the top of the berm. Verification of required compaction shall be submitted to the Township prior to utilization of any basin for stormwater management.
13. Emergency overflow facilities/spillways shall be provided within basins in order to convey basin inflow in excess of design flows, out of the basin, or in the event the outlet structure becomes blocked and is unable to convey flow. Emergency spillways discharging over embankments shall be constructed of reinforced concrete checker-blocks to protect the berm against erosion. Checkerblocks shall be back-filled with topsoil and stabilized in lawn cover. The checkerblock lining shall extend to the toe of the embankment on the outside of the berm, and shall extend to an elevation of three (3) feet below the spillway crest on the inside of the berm. Vegetated spillways may be utilized for spillways constructed entirely on undisturbed ground (e.g. not discharging over fill material). A dense cover of vegetation shall be rapidly established in such spillways by sodding or seeding with a geotextile anchor. The minimum capacity of all emergency spillways shall be equivalent to the peak flow rate of the one hundred (100) year, post-development design storm (entering to the basin). Spillway elevations shall be a minimum of one (1) foot above the maximum depth of detained runoff within the basin for the one-hundred (100) year post-development design storm.
14. In all cases, the discharge end of the basin shall be provided with a properly designed outlet control structure (headwall, orifice structure or other approved flow control structure), culvert pipe, and endwall. Perforated riser pipes alone, without provision for permanent outlet control structure (as stated above) and culvert pipe, are not permitted for permanent basins.
15. The minimum top of basin berm width (at the design elevation) shall be ten (10) feet. A cut-off trench (keyway) of impervious material shall be provided under all embankments that require fill material. The cut-off trench shall be a minimum of eight (8) feet wide, three (3) feet deep and have side slopes of one (1) horizontal to one (1) vertical.
16. The minimum freeboard through the emergency spillway shall be one (1) foot. Freeboard is defined as the difference between the design flow elevation through the spillway and the elevation of the top of the settled basin berm.
17. Anti-seep collars shall be installed around the pipe barrel and shall be centered within the normal saturation zone of the berm. The anti-seep collars and their connections to the pipe barrel shall be watertight. The anti-seep collars shall be cast-in-place and extend a minimum of two (2) feet beyond the outside of the principal pipe barrel. Precast collars shall be permitted if approved by the Township. A minimum of two (2) collars shall be installed on each basin outlet pipe, and be located a minimum of two (2) feet from any pipe joint.
18. A perforated sediment control structure, sized in accordance with Bucks County Conservation District requirements, shall be provided at each basin outlet structure (if more than one is to be utilized) for sediment control. Sediment control structures

shall not be removed until the entire area tributary to the basin has been permanently stabilized and until approved by the Bucks County Conservation District.

19. All basin outlet pipes shall be watertight reinforced concrete having "O-Ring" joints. All joints and lift holes shall be mortared. Crushed stone bedding/backfill material shall not be utilized through basin berms.
20. A minimum of six (6) inches is required between the top of an outlet structure box and the emergency spillway elevation. Six (6) inches, minimum, is also required between the one hundred (100) year water surface elevation and the top of an outlet structure box.
21. Energy dissipating devices (rock lining/rip rap, or other approved materials) shall be provided at all basin outlets and shall be sized in accordance with Pennsylvania Department of Environmental Protection, Bureau of Soil and Water Conservation Publication, Erosion and Sediment Control Program Manual, latest revision.
22. Stone gabion baskets and retaining wall systems shall not be utilized in construction of detention/retention basins.
23. Access easements and stabilized drives to stormwater detention facilities shall be provided for maintenance and operation. This access easement shall be cleared and, when possible, be at least twenty (20) feet in width. Multiple accesses shall be encouraged for major facilities. The developer shall provide access easements and drives of reinforced concrete checker-block (back-filled with topsoil and stabilized in lawn cover) or other similar paver acceptable to the Township Engineer, over a six (6) inch bed of compacted PennDOT type 3A coarse aggregate (or approved equivalent). Accessways to basins shall be a minimum of ten (10) feet wide and be no steeper in slope than ten (10) feet horizontal to one (1) feet vertical (10:1). In addition, depressed curb and concrete apron shall be provided where the accessway enters a street/driveway and the stabilized driveway shall extend from the bottom of the interior basin berm embankment to the point of access to the basin. Access easements shall be owned and maintained by the individual lot owner(s) or homeowner's association, but shall be established to permit access by Plumstead Township or its designee, for emergency inspection and/or maintenance, at any reasonable time.
24. Split rail fence with wire mesh backing is required around all detention or retention basin where directed by Plumstead Township. Fence shall consist of concrete posts (dual rail), four (4) feet high, with cedar rails (eight [8] feet to ten [10] feet long), and epoxy coated wire mesh (color to be determined by Township) installed six (6) inches above finished grade. Each basin fence installation shall include two points of access with ten (10) feet wide self closing, self latching gates.

I. General Design Requirements

1. Prior to finish grading of a development site and final overlay of streets, roads, and driveways, temporary measures, acceptable to the Township, shall be taken to ensure that all runoff intended to be intercepted and collected by an inlet or other facility, will be collected. The plan shall include such details, notes, or specification including bituminous "eyebrows" at inlets, diversion berms, etc.
2. Water originating from other than natural sources, such as air conditioning units, sump pumps, or other dry weather flow, wherever practical and possible, shall be connected to a storm sewer, or street drainage structure, or other approved

stormwater conveyance facility that is designed as part of a stormwater management BMP.

3. All stormwater runoff and floodplain calculations and stormwater management facilities design shall be prepared by a Professional Engineer licensed in the Commonwealth of Pennsylvania.
4. When subdivisions or land developments are submitted to the Township for approval in sections or phases, a complete storm sewer design for the proposed subdivision and land development shall be submitted. The proposed design must include the entire tract and not a portion.

Section 26-129. Calculation Methodology

- A. Stormwater runoff from all development sites shall be calculated using either the Rational Method or a soil cover complex methodology.
- B. Any stormwater runoff calculations shall use generally accepted calculation technique that is based on the NRCS soil cover complex method. Table 26-129-1 summarizes acceptable computation methods. Method must be selected by the applicant based on the individual limitations and suitability of each method for a particular site.

The Rational Method may be used to estimate peak discharges from drainage areas that contain less than seventy-five (75) acres. The Rational Method is recommended for drainage areas under twenty-five (25) acres.

Table 26-129-1 Acceptable Computation Methodologies For Stormwater Management Plans

METHOD	METHOD DEVELOPED BY	APPLICABILITY
TR-20 (or commercial computer package based on TR-20).	USDA NRCS	Applicable where use of full hydrology computer model is desirable or necessary
TR-55 (or commercial computer package based on TR-55)	USDA NRCS	Applicable for land development plans within limitations described in TR-55
HEC-1, HEC-HMS	US Army Corps of Engineers	Applicable where use of full hydrologic computer model is desirable or necessary
PSRM	Penn State University	Applicable where use of a hydrologic computer model is desirable of necessary; simpler than TR-20 or HEC-1.
Rational Method (or commercial computer package based on Rational Method)	Emil Kuichling (1889)	Applicable sites less than 75 acres, or as approved by the Township engineer.
Other methods	Varies	Other computation methodologies approved by the Township engineer.

- C. All calculations consistent with this Ordinance using the Soil Cover Complex Method shall use the appropriate design rainfall depths for the various return period storms according to the National Oceanic and Atmospheric Administration (NOAA) Atlas 14 rain data corresponding to the Doylestown rain gage, as presented in Table A-1 Appendix A of this

Part. The SCS Type 11 rainfall curve from NOAA is found on Figure A-1 in Appendix A of this Part. This data may also be directly retrieved from the NOAA Atlas 14 website: hdsc.nws.noaa.gov/hdsc/pfds/orb/pa_pfds.html. If a hydrologic computer model such as PSRM or HEC-1/HEC-HMS is used for stormwater runoff calculations, then the duration of rainfall shall be 24 hours.

- D. All calculations using the Rational Method shall use rainfall intensities consistent with appropriate time-of-concentration for overland flow and return periods from NOAA Atlas 14, Volume 2 Version 2.1. Times-of-concentration for overland flow shall be calculated using the methodology presented in Chapter 3 of *Urban Hydrology for Small Watersheds*, NRCS, TR-55 (as amended or replaced from time to time by NRCS). Times-of-concentration for channel and pipe flow shall be computed using Manning's equation.
- E. Runoff Curve Numbers (CN) for both existing and proposed conditions to be used in the soil cover complex method shall be obtained from Table A-4 in Appendix A of this Part.
- F. Runoff coefficients (C) for both existing and proposed conditions for use in the Rational method are contained in Table A-7 in Appendix A of this Part.
- G. All calculations using the Rational Method shall use rainfall intensities consistent with appropriate times of concentration for overland flow and return periods from the Design Storm Curves from PA Department of Transportation Design Rainfall Curves (1986) (Figure A-2). Times of concentration for overland flow shall be calculated using the methodology presented in Chapter 3 of *Urban Hydrology for Small Watersheds*, NRCS, TR-55 (as amended or replaced from time to time by NRCS). Times of concentration for channel and pipe flow shall be computed using Manning's Equation.
- H. For the purposes of existing conditions flow rate determination for all subdivision and land development applications, undeveloped land and existing impervious surfaces shall be considered as "meadow" in good condition, unless the natural ground cover generates a lower curve number (CN) or Rational „C" value (e.g. forest), as listed in Table A-4 or A-7 in Appendix A of this Part. Wooded areas shall use a ground cover of "woods in good condition". An area shall be considered wooded if there is a contiguous canopy of trees existing over an area of one-quarter (1/4) acre or more.
- I. Where uniform flow is anticipated, the Manning equation shall be used for hydraulic computations, and to determine the capacity of open channels, pipes, and storm sewers. Values for Manning's roughness coefficient (n) shall be consistent with Table A-8 in Appendix A of this Part.
- J. Outlet structures for stormwater management facilities shall be designed to meet the performance standards of this Part using any hydraulic analysis technique or method accepted by the Township.
- K. The design of any stormwater management facilities intended to meet the performance standards of this Part shall be verified by routing the design storm hydrograph through these facilities using the Storage Indication Method. The design storm hydrograph shall be computed using a calculation method that produces a full hydrograph.
- L. The Township has the authority to require that computed existing runoff rates be reconciled with field observations and conditions. If the design professional engineer can substantiate through actual physical calibration that more appropriate runoff and time-of-

concentration values should be utilized at a particular site, then appropriate variations may be made upon review and recommendations of the Township Engineer. Calibration shall require detailed gauge and rainfall data for the particular site in question.

- M. Infrequent Storm - The rational runoff coefficients given in this Part are applicable for the 2-year through 10-year frequency design storm event. Less frequent, higher intensity storms require modification of the runoff coefficient because infiltration and other losses have a proportionally smaller effect on runoff (Wright-McLaughlin 1969). The adjustment of the rational method for use with major storms shall be made by multiplying the rational formula by a frequency factor Cf. Cf values are as follows: 25-year frequency design storm – 1.1; 50-year frequency design storm – 1.2; 100-year frequency design storm – 1.25. The product of Cf and Rational Coefficient C shall not exceed 1.0.
- N. The time of concentration (Tc) is the time required for water to flow from the hydraulically most remote point of the drainage area to the point of interest (design point). Use of the rational formula requires calculation of a Tc for each design point within the drainage basin. Travel Time Estimation for the rational method shall be based on NRCS Technical Release No. 55 (2nd Edition). For design purposes the time of concentration may not be less than five (5) minutes. Travel time (Tt) is the time it takes runoff to travel from one location to another in a watershed (subreach) and is a component of time of concentration. Tc is computed by summing all the travel times for consecutive components of the drainage conveyance system.

Water moves through a watershed as sheet flow, shallow concentrated flow, open channel flow, or some combination of these. Sheet flow rates shall be calculated using the NRCS TR-55 (1986) variation of the kinematic wave equation. Sheet flow length may not exceed fifty (50) feet over paved surfaces and one hundred and fifty (150) feet over unpaved surfaces. Maximum permitted sheet flow length shall be one hundred and fifty (150) feet unless site specific conditions exist (that can be demonstrated) that warrant an increase of the sheet flow length. Under no circumstances shall sheet flow length exceed 300 feet. Shallow concentrated flow time and open channel flow time shall be calculated using standard engineering methodologies.

Section 26-130. Standards During Land Disturbance

- A. Whenever vegetation and topography are to be disturbed, such activity must be in conformance with Chapter 102, Title 25, Rules and Regulations, Part 1, Commonwealth of Pennsylvania, Department of Environmental Protection, Subpart C, protection of Natural Resources, Article II, Water Resources, Chapter 102, "Erosion Control," and in accordance with the Bucks County Conservation District and the standards and specifications of the Township.
- B. No Regulated Earth Disturbance activities within the Township shall commence until approval by the Township of an Erosion and Sediment Control and Grading Plan for construction activities.
- C. Pursuant to 25 PA Code Chapter 92, a PADEP "NPDES Construction Activities" permit is required for Regulated Earth Disturbance activities.
- D. Evidence of any necessary permit(s) for Regulated Earth Disturbance activities from the appropriate PADEP regional office or Bucks County Conservation District must be submitted to the Township.

- E. A copy of the Erosion and Sediment Control Plan and any required permit, as required by PADEP regulations shall be available at the project site at all times.
- F. Additional erosion and sedimentation control design standards and criteria that must be applied where infiltration BMPs are proposed include the following:
 - 1. Areas proposed for infiltration BMPs shall be protected from sedimentation and compaction during the construction phase, so as to maintain their maximum infiltration capacity. Thirty-three (33) inch Super Filter Fabric Fence (or other approved protection mechanism) must be installed around proposed infiltration areas to prevent encroachment and compaction by construction equipment.
 - 2. Infiltration BMPs shall not be constructed nor receive runoff until the entire contributory drainage area to the infiltration BMP has received final stabilization. If necessary, thirty-three (33) inch Super Filter Fabric Fence (or other approved protection mechanism) must be installed in the vicinity of infiltration area to prevent contamination by runoff containing suspended sediment.
- G. Peak discharges from the site shall comply with the appropriate sections above, with the following additions:
 - 1. For purposes of calculating required detention storage during land disturbance, peak discharge rates and volumes shall be calculated based upon the runoff coefficients for bare soils during the maximum extent of disturbance from clearing, grading, and impervious surface installation, shown on the development plan. Controls shall insure that the difference in volume and rate of peak discharges before disturbance and during shall not exceed those peak discharges and volumes required in Sections 26-122 and 26-123 of this Part. Detention storage during the period of land disturbance and prior to establishment of permanent cover may require additional facilities on a temporary basis. Such measures shall be located so as to preserve the natural soil infiltration capacities of the planned infiltration areas. Calculations based on the above parameters must be submitted to verify "during construction" runoff rate does not exceed predevelopment runoff rate for the 1-year frequency through 100-year frequency design storm events.
 - 2. Wherever soils, topography, cut and fill or grading requirements, or other conditions suggest substantial erosion potential during land disturbance, the Township may require that the entire volume of all storms up to a 2-year storm from the disturbed areas be retained on site and that special sediment trapping facilities (such as check dams, etc.) be installed.
- H. Areas of the site to remain undisturbed shall be protected from encroachment by construction equipment/vehicles to maintain the existing infiltration characteristics of the soil. Four feet high orange safety fence or other similar protection fence approved by the Township must be installed around the entire limit of disturbance/clearing prior to commencement of earthmoving activities, and maintained until completion of all construction activity.

Section 26-130.1. Water Quality Requirements After Regulated Earth Disturbance Activities Are Complete

- A. No Regulated Earth Disturbance activities within the Township shall commence until approval by the Township of a plan which demonstrates compliance with State Water Quality Requirements after construction is complete.
- B. The BMPs must be designed, implemented, and maintained to meet State Water Quality Requirements and any other more stringent requirements as determined by the Township.
- C. To control postconstruction stormwater impacts from Regulated Earth Disturbance activities, State Water Quality Requirements may be met by BMPs, including site design, which provide for replication of preconstruction stormwater infiltration and runoff conditions, so that post-construction stormwater discharges do not degrade the physical, chemical or biological characteristics of receiving waters. As described in the PADEP Comprehensive Stormwater Management Policy (#392-0300-002, September 28, 2002), this may be achieved by the following:
 - 1. Infiltration: replication of preconstruction stormwater infiltration conditions.
 - 2. Treatment: use of water quality treatment BMPs to filter out the chemical and physical pollutants from the stormwater runoff, and
 - 3. Streambank and Streambed Protection: management of volume and rate of postconstruction stormwater discharges to prevent physical degradation of receiving waters (e.g. from scouring).
- D. PADEP has regulations that require Townships to ensure design, implementation, and maintenance of Best Management Practices (BMPs) that control runoff from new development and redevelopment after Regulated Earth Disturbance activities are complete. These requirements include the need to implement post-construction stormwater BMPs with assurance of long-term operations and maintenance of those BMPs.
- E. Evidence of any necessary permit(s) for Regulated Earth Disturbance activities from the appropriate PADEP regional office must be submitted to the Township.
- F. BMP operations and maintenance requirements are described in Subpart D of this Part.

Section 26-130.2. Delaware Canal Areas

Development on lands adjacent to the Delaware Canal which propose to discharge stormwater into the canal must obtain special right-of-way approval from Pennsylvania Department of Conservation and Natural Resources (PADCNR). The PADCNR has established a separate policy for granting right-of-way for stormwater drainage into the Delaware Canal, which shall be used in conjunction with this Part. Feeder streams that flow or feed into the Delaware Canal shall be protected against soil erosion, water quality degradation, and sedimentation.

Section 26-130.3 Other Requirements

- A. Hot Spots

1. Use of infiltration BMPs is prohibited on hot spot land use areas. Examples of hot spots are listed in Ordinance Appendix H.
2. Stormwater runoff from hot spot land uses shall be pretreated. In no case may the same BMP be employed consecutively to meet this requirement. Guidance regarding acceptable methods of pre-treatment is located in Appendix H.

B. West Nile Guidance Requirements

All wet basin designs shall incorporate biologic controls consistent with the West Nile Guidance found in Appendix I.

D. STORMWATER MANAGEMENT PLAN REQUIREMENTS

Section 26-131. General Requirements

For any of the activities regulated by this Part, the final approval of subdivision and/or land development plans, the issuance of any building or occupancy permit, or the commencement of any land disturbance activity may not proceed until the property owner or developer or his/her agent has received written approval of a stormwater management plan from the Township.

Section 26-132. Stormwater Management Plan Contents and Requirements

The stormwater management plan shall consist of all applicable calculations, maps, and plans. A note on the maps shall refer to the associated computations and erosion and sedimentation control plan by title and date. The cover sheet of the computations and erosion and sedimentation control plan shall refer to the associated maps by title and date. All stormwater management plan materials shall be submitted to the Township in a format that is clear, concise, legible, neat, and well organized; otherwise, the stormwater management plan shall be disapproved and returned to the applicant.

The following items shall be included in the stormwater management plan:

- A. A feasibility analysis that evaluates the potential application of infiltration, flow attenuation, bioretention, wetland, or wet pond BMPs must be submitted with the required stormwater management plans for those developments not intending the use of such facilities. This analysis shall provide:
 1. a general assessment of the anticipated additional runoff based on the design storm and post-development condition and utilizing the calculation procedures required in Section 26-129;
 2. indication of drainage areas on the development site resulting in impervious, pervious, and rooftop runoff;
 3. indication of type of land use (residential, non-residential) generating the impervious surface runoff;
 4. delineation of soils on the site from the NRCS, Soil Survey of Bucks and Philadelphia Counties and onsite soil study. Soil study shall be conducted by a soil scientist and shall include sufficient probes/deep holes to evaluate application of BMPs;
 5. indication of soils generally suitable for infiltration and/or wet pond/artificial wetland BMPs, including specification of those soils requiring modifications;
 6. calculated acreage of suitable soils for infiltration BMPs and wet pond or artificial wetland BMPs and percentage of suitable soils based on total site acreage;
 7. calculated acreage of suitable soils for infiltration BMPs and wet pond or artificial wetland BMPs made unavailable due to proposed development layout and justification that alternative development layout which would reduce impact on suitable soil availability is unfeasible;
 8. analysis of potential infiltration or wet pond or artificial wetland BMPs which could be implemented to manage the projected post-development runoff with consideration of

suitable soil availability runoff point of and type of land use (Subsections A.2. and 3. above) and the general design standards and maintenance issues included in this Part including an indication of how most post-development runoff can be managed by these BMPs (e.g. the entire post-development runoff or partial amount of runoff expressed as a percentage);

9. rationale for the decision to not proceed with implementation of wet pond or artificial wetland BMPs such as insufficient soil suitability; and
10. rationale for not proceeding with infiltration oriented BMPs in accordance with Sections 26-123 and 26-126 of this Part.

The feasibility analysis must allow the Township to review the general soil characteristics of a site and the proposed development for that site and determine if infiltration BMPs or wet pond or artificial wetland BMPs could have been more thoroughly pursued for use by the developer. The information required in the analysis is detailed enough to determine the potential applicability of these BMPs for a proposed development, but general enough not to force a developer into incurring excessive cost associated with conducting laborious field and/or laboratory soil testing for a site which ultimately may not be suitable for infiltration or wet pond or artificial wetland BMP implementation. However, with the requirements for conducting a feasibility analysis, developers will be aware that they are expected to use these BMPs wherever possible and are required to provide adequate justification if these BMPs are not to be implemented. Essentially, all developers will be conducting feasibility analysis since such analysis would become the preliminary step in evaluating the potential for implementation of these mandatory BMPs where possible. Taking into consideration the areal extent of suitable soils necessary to accommodate an infiltration facility, wet pond or wetland BMP for the type and size of development proposed, developers are required to conduct the detailed soil testing and other feasibility testing required in other sections of this Part which contain the description and additional design criteria of these BMPs.

- B. A detailed geologic evaluation of the project site shall be performed to determine the suitability of recharge facilities. The evaluation shall be performed by a qualified geologist and/or soil scientist, and at a minimum, address soil permeability, depth to bedrock, susceptibility to sinkhole formation, and subgrade stability.
- C. Whenever a stormwater management facility will be located in an area underlain by limestone or dolomite a geological evaluation of the proposed location shall be conducted to determine susceptibility to sinkhole formations. The design of all facilities over limestone formations shall include measures to prevent ground water contamination and, where necessary, sinkhole formation. Soils used for the construction of basins shall have low-erodibility factors ("K" factors). Installation of an impermeable liner shall be required in detention or retention basins constructed over limestone formations.
- D. It shall be the developer's responsibility to verify whether if the site is underlain by limestone. The following note shall be attached to all stormwater management plans and signed and sealed by the developer's professional engineer "I, _____, certify that the proposed stormwater management facility (circle one) is/is not underlain by limestone."
- E. General
 1. General description of project.

2. General description of permanent stormwater BMPs and management techniques, including construction specifications of the materials to be used for stormwater management facilities.
 3. Complete hydrologic, hydraulic, and structural computations for all stormwater management facilities.
- F. Map(s) of the project area shall be submitted on twenty-four (24) inch x thirty-six (36) inch sheets and shall be prepared in a form that meets the requirements for recording at the offices of the Recorder of Deeds of Bucks County. The contents of the maps(s) shall include, but not be limited to:
1. The location of the project relative to highways, municipalities, or other identifiable landmarks.
 2. Watershed(s) within which the project is located (e.g. Tohickon Creek, Neshaminy Creek, Delaware River (South)).
 3. Existing contours at intervals of two (2) feet. In areas of steep slopes (greater than twenty-five (25) percent), five (5) feet contours may be used.
 4. Existing streams, lakes, ponds, or other bodies of water within the project area.
 5. Other physical features including flood hazard boundaries, sinkholes, streams, existing drainage courses, wetlands, areas of natural vegetation to be preserved, and the total extent of the upstream area draining through the site.
 6. The locations of all existing and proposed utilities, sanitary sewers, and water lines located on the site and/or within fifty (50) feet of property lines with minimum setback distances for all existing and proposed water supply wells and on-lot sewage disposal systems.
 7. An overlay showing soil names and boundaries. The overlay shall include a table on the map showing the recharge capabilities of each soil represented onsite in inches per hour and describe their recharge or infiltration capabilities.
 8. Proposed changes to the land surface and vegetative cover, including the type and amount of impervious area that would be added.
 9. Proposed structures, roads, paved areas, and buildings. Where pervious pavement is proposed for parking lots, recreational facilities, non-dedicated streets, or other areas, pavement construction specifications shall be noted on the plan.
 10. Final contours at intervals at two (2) feet. In areas of steep slopes (greater than twenty-five (25) percent), five (5) feet contour intervals may be used.
 11. The name of the development, the name and address of the owner of the property, and the name of the individual or firm preparing the plan.
 12. The date of submission.
 13. A graphic and written scale of one (1) inch equals no more than fifty (50) feet. For tracts of twenty (20) acres or more, the scale may be one (1) inch equals no more than one hundred (100) feet.
 14. A North arrow.
 15. The total tract boundary and size with distances marked to the nearest foot and bearings to the nearest degree.
 16. Existing and proposed land use(s).

17. A key map showing all existing man-made features beyond the property boundary that may be affected by the project.
18. Horizontal and vertical profiles of all open channels, including hydraulic capacity.
19. Overland drainage paths.
20. All existing and proposed stormwater management facility and/or drainage easements described by metes and bounds, including the purpose and ownership of each easement.
21. A note on the plan indicating the location and responsibility for maintenance of stormwater management facilities that would be located off-site. All off-site facilities shall meet the performance standards and design criteria specified in this Part.
22. A construction detail of any improvements made to sinkholes and the location of all notes to be posted, as specified in this Part.
23. A statement on the plan, signed by the landowner, acknowledging the stormwater BMPs and management facilities to be a permanent fixture that can be altered or removed only after approval of a revised plan by the Township, which shall be recorded with the record plan and which shall be applicable to all future landowners.
24. The location of all erosion and sedimentation control facilities.
25. The following signature block for the design engineer:
“(Design engineer), on this date (date of signature), has reviewed and hereby certifies that the stormwater management plan meets all design standards and criteria of the Plumstead Township Stormwater Management Ordinance.”

G. Required Supplemental Information

1. A written description of the following information shall be submitted.
 - a) The overall stormwater management concept for the project.
 - b) Stormwater runoff computations as specified in this Part.
 - c) Stormwater management BMPs to be applied both during and after development.
 - d) Expected project time schedule.
2. A soil erosion and sedimentation control plan, where applicable, including all reviews and approvals, as required by PADEP and/or Bucks County Conservation District.
3. A geologic assessment of the effects of runoff on sinkholes as specified in this Part.
4. The effect of the project (in terms of runoff volume, peak flow, and discharge durations) on adjacent properties and on any existing Township stormwater collection system that may receive runoff from the project site.
5. A Declaration of Adequacy and Highway Occupancy Permit from the PADOT District Office when utilization of a PADOT storm drainage system is proposed.
6. An Operations and Maintenance (O&M) Plan for all existing and proposed physical stormwater facilities, as well as schedules and costs for O&M activities. The plan shall address long-term ownership and responsibilities for O&M.

H. Stormwater Management BMPs

1. All stormwater management BMPs must be located on a plan and profile drawings and described in detail.
2. When infiltration methods such as seepage pits, beds, or trenches are proposed, the locations of existing and proposed septic tank, infiltration areas, and wells must be shown. A minimum separation distance of no less than twenty (20) feet shall be provided between any septic system and any facility used for stormwater management. An analysis shall be submitted to verify that stormwater infiltration shall not affect groundwater elevations of the septic drain field site.
3. All calculations, assumptions, and criteria used in the design of the stormwater management BMPs must be shown. If multiple facilities are proposed in conjunction with each other, such as infiltration Best Management Practices with vegetation based management practices , a summary narrative, shall be included describing any sequence and how the facilities are meant to function with each other to manage stormwater runoff.

Section 26-133. Plan Submission

For all activities regulated by this Part, the steps below shall be followed for submission. For any activities that require a PADEP joint permit application and regulated under Chapter 102 (Erosion and Sediment Control), Chapter 105 (Dam Safety and Waterway Management), or Chapter 106 (Floodplain Management) of PADEP's Rules and Regulations, require a PADOT highway occupancy permit, or require any other permit under applicable local, state, or federal regulations, the permit(s) shall be part of the plan submission.

- A. The stormwater management plan shall be submitted by the developer as part of the Preliminary plan submission for the regulated activity.
- B. A minimum of three (3) copies of the stormwater management plan shall be submitted to the Township during regular business hours. Additional copies shall be submitted if requested by the Township.
- C. Distribution of the stormwater management plan will be as follows:
 1. One (1) copy to be retained by the Township, accompanied by the requisite Township review fee and escrow, as specified in this Part.
 2. Two (2) copies forwarded by the Township to the Township Engineer.

Section 26-134. Stormwater Management Plan Review

- A. The Township Engineer shall review the stormwater management plan for consistency with the adopted Watershed Act 167 Stormwater Management Plan, this Part, and applicable Township ordinances. The Township shall require receipt of a complete plan, as specified in this Part.
- B. The Township Engineer shall also review the Stormwater Management Plan for any subdivision or land development for compliance with all Subdivision and Land Development Ordinance [Chapter 22] provisions not superseded by this Part.

- C. For activities regulated by this Part (not including subdivision or land development applications), the Township Engineer shall notify the Township in writing, within forty-five (45) calendar days of receipt, whether the stormwater management plan is consistent with this Part. A copy of the Township Engineer's review letter shall be forwarded to the applicant. Any disapproved stormwater management plan may be revised by the applicant and resubmitted consistent with this Part.
- D. The Township shall not approve any subdivision or land development or regulated activities specified in Section 26-104 of this Part if the stormwater management plan has been found to be inconsistent with the adopted Watershed Act 167 Stormwater Management Plan. All required permits from PADEP must be obtained prior to, or as a requirement of, final approval.
- E. The Township Code Enforcement Officer shall not issue a building permit for any regulated activity specified in Section 26-104 of this Part if the stormwater management plan has been found to be inconsistent with this Part, as determined by the Township Engineer, or without considering the comments of the Township Engineer. All required permits from PADEP must be obtained prior to issuance of a building permit.
- F. The developer shall be responsible for completing an "as-built survey" of all stormwater management BMPs included in the approved stormwater management plan. The as-built survey and an explanation of any discrepancies with the design plans shall be submitted to the Township Engineer for review. In no case shall the Township approve the as-built survey until the Township receives written verification of satisfactory completion from the Township Engineer, Highway Occupancy Permit completion acknowledgement from the PADOT District Office (where applicable), and any applicable permits from PADEP.
- G. The Township's approval of a stormwater management plan shall be valid for a period not to exceed two (2) years. If stormwater management facilities included in the approved stormwater management plan have not been constructed, or if an as-built survey of these facilities has not been approved within this 2-year time period, then the Township may consider the stormwater management plan disapproved and may revoke any and all permits. Stormwater management plans that are considered disapproved by the Township shall be resubmitted in accordance with Section 26-138 of this Part.

Section 26-135. Retention of Plans at Project Site

A set of design plans approved by the Township shall be on file at the site throughout the duration of the development activity. Periodic inspections may be made by the Township or designee during development activities.

Section 26-136. Adherence to Approved Plan

It shall be unlawful for any person to undertake any regulated activity on any property except as provided for in the approved stormwater management plan and pursuant to the requirements of this Part. It shall be unlawful to alter or remove any BMP required by the stormwater management plan pursuant to this Part or to allow the property to remain in a condition which does not conform to the approved stormwater management plan.

Section 26-137. Certification of Completion

At the completion of the project, and as a prerequisite for the release of the performance guarantee under Section 26-161, the owner or his representatives shall:

1. Contact the Township Engineer to request inspection of the site for completion of stormwater management facilities and compliance with the approved plans and specifications.
2. Provide a set of as-built drawings as required pursuant to the Township Building Code and/or Subdivision and Land Development Ordinance [Chapter 22].

Section 26-138. Modification of Plans

A modification to a submitted stormwater management plan for a development site that involves a change in stormwater management facilities or techniques, or that involves the relocation or redesign of stormwater management facilities, or that is necessary because soil or other conditions are not as stated on the stormwater management plan as determined by the Township Engineer, shall require a resubmission of the modified stormwater management plan consistent with Section 26-133 of this Part and be subject to review as specified in Section 26-134 of this Part.

A modification to an already approved or disapproved stormwater management plan shall be submitted to the Township, accompanied by the applicable Township review fee. A modification to a stormwater management plan for which a formal action has not been taken by the Township shall be submitted to the Township, accompanied by the applicable Township review fee.

Section 26-139. Occupancy Permit

An occupancy permit shall not be issued unless the stormwater management facilities approved for the lot have been installed and found satisfactory to the Township Engineer.

E. INSPECTIONS

Section 26-141. Schedule of Inspections

- A. The Township Engineer assignee shall inspect all phases of the installation of the permanent stormwater management facilities.
- B. During any stage of the work, if the Township Engineer determines that temporary or permanent erosion and sedimentation control or stormwater management BMPs are not being implemented in accordance with the approved stormwater management plan and this Part, the Township shall revoke any existing permits until a revised stormwater management plan is submitted and approved, as specified in this Part.

Section 26-142. Right of Entry

- A. During construction, duly authorized representatives of the Township may enter at reasonable times upon any property within the Township to inspect the implementation, condition, or operation and maintenance of the stormwater BMPs to investigate construction activity is in compliance with this Part.
- B. BMP owners and operators shall allow persons working on behalf of the Township ready access to all parts of the premises for the purposes of determining compliance with this Part.
- C. Persons working on behalf of the Township shall have the right to temporarily locate on any BMP in the Township such devices as are necessary to conduct monitoring and/or sampling of the facility's storm water discharge.
- D. Unreasonable delays in allowing the director access to a BMP is a violation of this article.

F. FEES AND EXPENSES

Section 26-151. Stormwater Management Plan Review Fee and Escrow

The Township shall establish a review fee and escrow schedule by Resolution of the Board of Supervisors body to defray review costs incurred by the Township, any outside review agencies or entities necessary to review submitted plans, and the Township Engineer. The Township shall periodically update the review fee schedule to ensure that review costs are adequately reimbursed. The applicant shall pay all fees.

Section 26-152. Expenses Covered by Fees and Escrow

The fees and escrows required by this Part shall, at a minimum, cover the following:

- A. Administrative/clerical costs.
- B. Review of the stormwater management plan by the Township and Township Engineer.
- C. Site inspections by the Township staff and/or Township Engineer.
- D. Inspection of stormwater management facilities and stormwater management improvements during construction.
- E. Final inspection upon completion of the stormwater management facilities and stormwater management improvements presented in the stormwater management plan.
- F. Any additional work required to enforce any permit provisions regulated by this Part, correct violations, and ensure proper completion of stipulated remedial actions.

Section 26-153 Itemization of Costs

Expenses incurred by the Township and charged to the applicant pursuant to Section 26-152 of this Part shall be itemized. A copy of the itemized costs will be provided by the Township to the applicant.

G. MAINTENANCE RESPONSIBILITIES

Section 26-161. Performance Guarantee

The applicant shall provide a financial guarantee to the Township for the timely installation and proper construction of all erosion and sediment control measures and stormwater management BMPs as required by the approved stormwater management plan and this Part equal to the full construction cost of the required controls plus construction contingency and construction inspection costs.

Section 26-162. Maintenance Responsibilities

- A. The stormwater management plan for the development site shall contain an BMP Operation and Maintenance plan (BMP O&M) prepared by the design engineer. The operation and maintenance plan shall outline required routine maintenance actions and schedules necessary to insure proper operation of the BMPs and shall be subject to review and approval of the Township.
- B. The BMP O&M plan for the development site shall establish responsibilities for the continuing operation and maintenance of all proposed stormwater control facilities, consistent with the following principles:
 - 1. If a development consists of structures or lots that are to be separately owned and in which streets, storm sewers, and other stormwater management improvements are to be dedicated to the Township, stormwater BMPs may also be dedicated to and maintained by the Township, if accepted by the Township.
 - 2. If a development site is to be maintained in a single ownership or if storm sewers and other stormwater management improvements are to be privately owned and maintained, then the ownership and maintenance of stormwater BMPs shall be the responsibility of the owner or private management entity.
- C. The stormwater facility and BMP O&M plan shall include the following:
 - 1. Description of how each stormwater facility and BMP will be operated and maintained, and the identity and contact information associated with the person(s) responsible for O&M.
 - 2. Name of the project site, name and address of the owner of the property, and name of the individual or firm preparing the plan.
 - 3. A statement, signed by the facility owner, acknowledging that the stormwater facilities and BMPs are fixtures that can be altered or removed only after approval by the municipality.
- D. Facilities, areas, or structures used as BMPs shall be enumerated as permanent real estate appurtenances and recorded as deed restrictions or conservation easements that run with the land.
- E. The O&M plan shall be recorded as a restrictive deed covenant that runs with the land.
- F. The Board of Supervisors, upon recommendation of the Township Engineer, shall make the final determination on the continuing maintenance responsibilities prior to final approval of the stormwater management plan. The Board of Supervisors reserves the

right anytime to accept the ownership and operating responsibility for any or all of the stormwater BMPs. The right of the Township to accept ownership in the future shall be stated in the Maintenance Agreement (refer Section 26-164).

Section 26-163 Municipal Review of Stormwater Facilities and BMP Operations and Maintenance (O&M) Plan

- A. The Township shall review the Stormwater Facilities and BMP O&M plan for consistency with the purposes and requirements of this Ordinance, and any permits issued by PADEP.
- B. The Township shall notify the Applicant in writing whether the Stormwater Facility and BMP O&M plan is approved.
- C. The Township shall require a "Record Drawing" of all stormwater facilities and BMPs.

Section 26-164. Maintenance Agreement for Privately Owned Stormwater BMPs

- A. Prior to final approval of the site's stormwater management plan, the applicant shall sign and record an O&M agreement prepared and approved by the Township Solicitor covering all stormwater control facilities that are to be privately owned. The form and substance of the agreement shall be consistent with the agreement in Appendix K of this Part.
- B. Other items may be included in the O&M agreement where determined necessary to guarantee the satisfactory maintenance of all facilities. The O&M agreement shall be subject to review and approval of the Township.
- C. The owner is responsible for the O&M of the SWM BMPs. If the owner fails to adhere to the O&M Agreement, the Township may perform the services required and charge the owner appropriate fees. Nonpayment of fees may result in a lien against the property.

Section 26-165. Stormwater Management Easements

- A. Stormwater management easements shall be provided by the property owner if necessary for: (1) access for facility inspections and maintenance, or (2) preservation of stormwater runoff conveyance, infiltration, and detention areas and facilities, including flood routes for the 100-year storm event. The purpose of the easement shall be specified in the maintenance agreement signed by the property owner.
- B. Stormwater management easements are required for all areas used for off-site stormwater control, unless a waiver is granted by the Township.
- C. Easements shall be recorded with the Bucks County Recorder of Deeds prior to issuance of a building permit or recordation of a subdivision or land development plan.

Section 26-166. Municipal Stormwater Maintenance Fund

- A. If stormwater BMPs are accepted by the Township for dedication, persons installing stormwater BMPs shall be required to pay a specified amount to the Township Stormwater Maintenance Fund to help defray costs of periodic inspections and maintenance expenses. The amount of the deposit shall be determined as follows:
 - 1. If the BMP is to be owned and maintained by the Township, the deposit shall cover the estimated costs for maintenance and inspections required pursuant to Section

26-167 for ten (10) years. The Township Engineer will establish the estimated costs upon review of information submitted by the applicant.

2. If the stormwater management facilities and Best Management Practices are to be owned and maintained by a private entity, the deposit shall cover the estimated costs for maintenance and inspections for ten (10) years. The Township Engineer will establish the estimated costs upon review of information submitted by the applicant.
 3. The amount of the deposit to the fund shall be converted to present worth of the annual series of payments. The Township engineer shall determine the present worth equivalents, which shall be subject to the approval of the Board of Supervisors.
- B. If a BMP is proposed that also serves as a recreation facility (e.g., ballfield, pond), the Township may, but is not required to, reduce or waive the amount of the maintenance fund deposit based upon the value of the land for public recreation purpose.
- C. A financial deposit to the Township Stormwater Management Fund shall be required to be paid by the developer to help defray costs of periodic inspections and maintenance expenses associated with all stormwater management facilities, storm sewer, culverts, and other such improvements required by PennDOT, to be constructed within the right-of-way of public roadways, that are to be maintained after dedication by the Township. The deposit shall cover the estimated cost for maintenance and inspections for ten (10) years. The Township Engineer will establish the estimated cost upon review of information submitted by the applicant.

Section 26-167. Post-Construction Maintenance Inspections

- A. BMPs shall be inspected by the landowner/developer or responsible entity (including the Township Engineer for dedicated BMPs) on the following basis:
1. Twelve (12) months after completion of the facility and acceptance by the Township.
 2. At least once every three (3) years thereafter,
 3. During or immediately after the cessation of a 100-year or greater storm event.
- B. The entity conducting the inspection shall submit a report to the Township regarding necessary repairs, if any.

H. PROHIBITIONS

Section 26-171. Prohibited Discharges

- A. Any drain or conveyance, whether on the surface or subsurface, that allows non-stormwater discharge including, but not limited to, sewage, processed wastewater, and wash water to enter the Waters of the Commonwealth is prohibited.
- B. No person in the Township shall allow or cause to allow stormwater discharges into the Township's separate storm sewer system which are not composed entirely of stormwater, except discharges allowed under a state or federal permit.
- C. Discharges which may be allowed under the Township's NPDES permit based on a finding by the Township that the discharge(s) do not significantly contribute to pollution to surface waters of the Commonwealth by the Township are:

Water line flushing	Discharges from potable sources
Landscape irrigation	Discharges from foundation drains
Diverted stream flows	Air conditioning condensation
Uncontaminated pumped groundwater	Irrigation water
Springs	Flows from riparian habitats and wetlands
Water from crawl space pumps	Street wash water
Lawn watering	Individual residential car washing
Dechlorinated swimming pool discharge (per PADEP requirements)	Discharges from firefighting activities including training
Routine external building wash down (which does not use detergents or other compounds)	Uncontaminated water from foundations or footing drains

- D. In the event that the Township subsequently determines that any of the discharges identified in Subsection B degrade the quality of Waters of the Commonwealth or U.S. by the Township, then the Township will notify the responsible person to cease the discharge.
- E. Upon notice provided by the Township under Subsection C, the discharger will have a reasonable time to cease the discharge consistent with the degree of pollution caused by the discharge.

Section 26-172. Prohibited Connections

- A. The following connections are prohibited:
 - 1. Any drain or conveyance, whether on the surface or subsurface, which allows any non-storm water discharge including sewage, process wastewater, and wash water to enter the separate storm sewer systems, and any connections to the storm drain system from indoor drains and sinks;
 - 2. Any drain or conveyance connected from a commercial or industrial land use to the separate storm sewer system which has not been documented in plans, maps, or equivalent records, and approved by the Township.
- B. This prohibition expressly includes, without limitation, connections made in the past, regardless of whether the connection, drain or conveyance was previously allowed,

permitted, or approved by a government agency, or otherwise permissible under law or practices applicable or prevailing at the time of connection.

Section 26-173. Roof Drains

- A. Roof drains shall discharge to infiltration areas or vegetative BMPs and to the maximum extent practicable satisfy the criteria for disconnected impervious areas (DIAs).
- B. Roof drains shall not be connected to streets through the curb or to sanitary sewers; and shall only be connected to storm sewer or swales (located within an easement) when designed as part of a stormwater BMP.

Section 26-174. Waste Disposal Prohibitions

No person shall throw, deposit, leave, maintain, keep, or permit to be thrown, deposited, left, or maintained, in or upon any public or private property, driveway, parking area, street, alley, sidewalk, or other component of the Township's separate storm sewer system, any refuse, rubbish, garbage, litter, or other discarded or abandoned objects, articles, and accumulations, so that the same may cause or contribute to pollution. Wastes deposited in streets in proper waste receptacles for the purposes of collection are exempted from this prohibition.

Section 26-175. Alteration of SWM BMPs

- A. No person shall modify, remove, fill, landscape, or alter any existing stormwater management BMP, unless part of an approved maintenance program and written approval of the Township has been obtained.
- B. No person shall place any structure, fill, landscaping or vegetation into a stormwater management BMP or within a drainage easement, which would limit or alter the functioning of the BMP, without the written approval of the Township.

I. ENFORCEMENT AND PENALTIES

Section 26-181. Right-of-Entry

During construction, duly authorized representatives of Plumstead Township may enter at reasonable times upon any property within the Township to investigate whether construction activity is in compliance with this Part.

Section 26-182. Notification

In the event that a person fails to comply with the requirements of this Part, or fails to conform to the requirements of any permit issued hereunder, the Township shall provide written notification of the violation. Such notification shall set forth the nature of the violation(s) and establish a time limit for correction of these violations(s). Failure to comply within the time specified shall subject such person to the penalty provision of this Part. All such penalties shall be deemed cumulative. In addition the Township may pursue any and all other remedies. It shall be the responsibility of the owner of the real property on which any regulated activity is proposed to occur, is occurring, or has occurred, to comply with the terms and conditions of this Part.

In the case where the violation poses an immediate threat to the health, safety, and welfare of the community, no notice under this section shall be required.

Section 26-183. Enforcement

The Board of Supervisors is hereby authorized and directed to enforce all of the provisions of this Part. All inspections regarding compliance with the stormwater management plan shall be the responsibility of the Township Engineer or other qualified persons designated by the Township as directed by the Board of Supervisors.

- A. A set of design plans approved by the Township shall be on file at the site throughout the duration of the construction activity. Periodic inspections may be made by the Township or designee during construction.
- B. Adherence to approved plan

It shall be unlawful for any person, firm, or corporation to undertake any regulated activity under Section 26-104 on any property except as provided for in the approved stormwater management plan and pursuant to the requirements of this Part. It shall be unlawful to alter or remove any control structure required by the stormwater management plan pursuant to this Part or to allow the property to remain in a condition which does not conform to the approved stormwater management plan.

- C. At the completion of the project, and as a prerequisite for the release of the performance guarantee, the owner or his representatives shall:
 - 1. Provide a certification of completion from a professional engineer verifying that all permanent facilities have been constructed according to the plans and specifications and approved revisions thereto.
 - 2. Provide an electronic copy, and two (2) paper prints of as-built drawings.
- D. After receipt of the certification by the Township, a final inspection shall be conducted by the Board of Supervisors or its designee to certify compliance with this Part.

- E. Prior to revocation or suspension of a permit, the Board of Supervisors will schedule a hearing to discuss the non-compliance if there is no immediate danger to life, public health or property.
- F. Suspension and revocation of permits
 - 1. Any permit issued under this Part may be suspended or revoked by the Board of Supervisors for:
 - a) Noncompliance with, or failure to, implement any provision of the permit.
 - b) A violation of any provision of this Part or any other applicable law, ordinance, rule, or regulation relating to the project.
 - c) The creation of any condition or the commission of any act during construction or development which constitutes or creates a hazard or nuisance, pollution or which endangers the life or property of others.
 - 2. A suspended permit shall be reinstated by the Board of Supervisors when:
 - a) The Township Engineer or his designee has inspected and approved the corrections to the stormwater management and erosion and sediment pollution control measure(s), or the elimination of the hazard or nuisance, and/or;
 - b) The Board of Supervisors is satisfied that the violation of the ordinance, law, or rule and regulation has been corrected.
 - 3. A permit that has been revoked by the Board of Supervisors cannot be reinstated. The applicant may apply for a new permit under the procedures outlined in this Part.

G. Occupancy Permit

An occupancy permit shall not be issued unless the certification of compliance has been secured. The occupancy permit shall be required for each lot owner and/or developer for all subdivisions and land developments in the Township.

Section 26-184. Public Nuisance

- A. The violation of any provision of this Part is hereby deemed a public nuisance.
- B. Each day that a violation continues shall constitute a separate violation

Section 26-185. Penalties

Any person, partnership or corporation who or which has violated or permitted the violation of the provisions of this Part shall, upon being found liable therefore in a civil enforcement proceeding commenced by the Township, pay a judgment of not more than \$600.00 plus all court costs, including reasonable attorneys fees incurred by the Township as a result thereof. Each day that a violation continues shall constitute a separate violation.


Section 26-186. Appeals

- A. Appeals from the determination of the Township or its designee, or from the determination of the Township Engineer in the administration of this Part as it relates to stormwater


management of a project shall be made to the Board of Supervisors within thirty (30) days of that determination or decision.

- B. Any person aggrieved by a decision of the Board of Supervisors may appeal to the Zoning Hearing Board within thirty (30) days of the decision.
- C. Any person aggrieved by a decision of the Zoning Hearing Board or Board of Supervisors may appeal to the Bucks County Court of Common Pleas within thirty (30) days of the decision of the Zoning Hearing Board or Board of Supervisors.


ENACTED and ORDAINED at a regular meeting of the Plumstead Township Board of Supervisors on the 3rd day of May, 2011. This Ordinance shall take effect five (5) days after enactment.




Chairperson

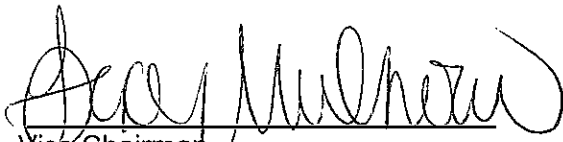


Vice Chairman



Member

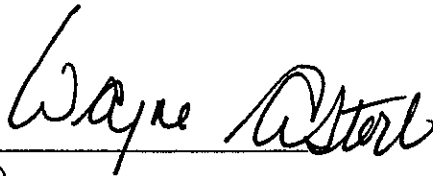

Member

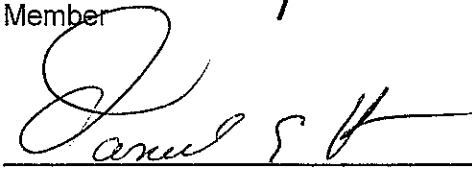


Member

ATTEST:



Manager

I hereby certify that the foregoing Ordinance was advertised in the [The Intelligencer] on [April 13, 2011], a newspaper of general circulation in the Township and was duly enacted and approved as set forth at a regular meeting of the Plumstead Township Board of Supervisors held on [May 3, 2011].

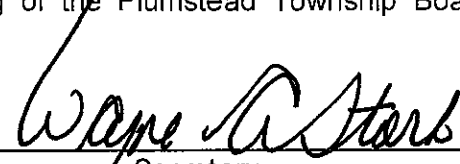

Secretary

APPENDIX A: STORMWATER MANAGEMENT DESIGN CRITERIA

TABLE A-1

DESIGN STORM RAINFALL AMOUNT

Source: NOAA Atlas 14 website, Doylestown Gage (36-2221)
http://hdsc.nws.noaa.gov/hdsc/pfds/orb/pa_pfds.html.

FIGURE A-1

ATLAS 14 TYPE II S-CURVES FOR ALL FREQUENCY STORMS – DOYLESTOWN GAGE (36-2221)

Source: NOAA Atlas 14 website, Doylestown Gage (36-2221)
http://hdsc.nws.noaa.gov/hdsc/pfds/orb/pa_pfds.html.

TABLE A-2

NATURAL RESOURCE PROTECTION STORMWATER MANAGEMENT CONTROLS

Source: PA BMP Manual Chapter 8, pg 33

TABLE A-3

GUIDANCE TO CALCULATE THE 2-YEAR, 24-HOUR VOLUME INCREASE FROM PRE-DEVELOPMENT TO POST-DEVELOPMENT CONDITIONS

Source: PA BMP Manual Chapter 8, pg 37

TABLE A-4

RUNOFF CURVE NUMBERS

Source: NRCS (SCS) TR-55

TABLE A-5

VOLUME CONTROL CALCULATION GUIDANCE FOR NONSTRUCTURAL BMPS

Source: PA BMP Manual Chapter 8, pg 34

TABLE A-6

VOLUME CONTROL CALCULATION GUIDANCE FOR STRUCTURAL BMPS

Source: PA BMP Manual Chapter 8, pg 38

TABLE A-7

RATIONAL RUNOFF COEFFICIENTS

Source: New Jersey Department of Transportation, Technical Manual for Stream Encroachment, August, 1984

TABLE A-8

MANNING ROUGHNESS COEFFICIENTS

**TABLE A-1
DESIGN STORM RAINFALL AMOUNT (INCHES)**

The design storm rainfall amount chosen for design should be obtained from the National Oceanic and Atmospheric Administration Atlas 14 interactive website:
http://hdsc.nws.noaa.gov/hdsc/pfds/orb/pa_pfds.html


Source: NOAA Atlas 14 website, Doylestown Gage (36-2221)
http://hdsc.nws.noaa.gov/hdsc/pfds/orb/pa_pfds.html

Precipitation Frequency Estimates (inches)																		
ARI* (years)	5 min	10 min	15 min	30 min	6 min	120 min	3 hr	6 hr	12 hr	24 hr	48 hr	4 day	7 day	10 day	20 day	30 day	45 day	60 day
1	0.34	0.54	0.68	0.93	1.15	1.38	1.51	1.89	2.30	2.71	3.13	3.48	4.07	4.61	6.23	7.76	9.85	11.81
2	0.40	0.64	0.81	1.12	1.40	1.67	1.83	2.28	2.78	3.26	3.78	4.19	4.87	5.51	7.39	9.14	11.57	13.83
5	0.47	0.76	0.96	1.36	1.75	2.10	2.30	2.86	3.50	4.11	4.76	5.24	6.02	6.71	8.81	10.65	13.30	15.78
10	0.53	0.84	1.06	1.54	2.01	2.42	2.66	3.32	4.11	4.81	5.57	6.09	6.96	7.68	9.93	11.83	14.60	17.23
25	0.59	0.94	1.19	1.76	2.34	2.86	3.15	3.98	4.99	5.83	6.71	7.30	8.30	9.03	11.44	13.36	16.25	19.04
50	0.63	1.00	1.27	1.92	2.60	3.21	3.54	4.52	5.74	6.70	7.66	8.29	9.41	10.11	12.61	14.52	17.46	20.35
100	0.67	1.07	1.35	2.07	2.85	3.56	3.94	5.09	6.55	7.63	8.67	9.33	10.59	11.23	13.79	15.66	18.61	21.57
200	0.71	1.13	1.42	2.21	3.11	3.92	4.35	5.69	7.43	8.64	9.75	10.44	11.83	12.39	14.98	16.79	19.69	22.70
500	0.76	1.20	1.51	2.40	3.44	4.41	4.90	6.54	8.73	10.12	11.30	12.01	13.60	14.00	16.58	18.23	21.02	24.08
1000	0.79	1.24	1.56	2.53	3.69	4.78	5.34	7.23	9.82	11.35	12.57	13.29	15.04	15.28	17.80	19.31	21.96	25.04

* These precipitation frequency estimates are based on a partial duration series. **ARI** is the Average Recurrence Interval.

FIGURE A-1 Atlas 14 Type II S-Curves for All Frequency Storms – Doylestown Gage (36-2221)

Partial duration based Point Precipitation Frequency Estimates - Version: 3
40.3 N 75.1333 W 305 ft

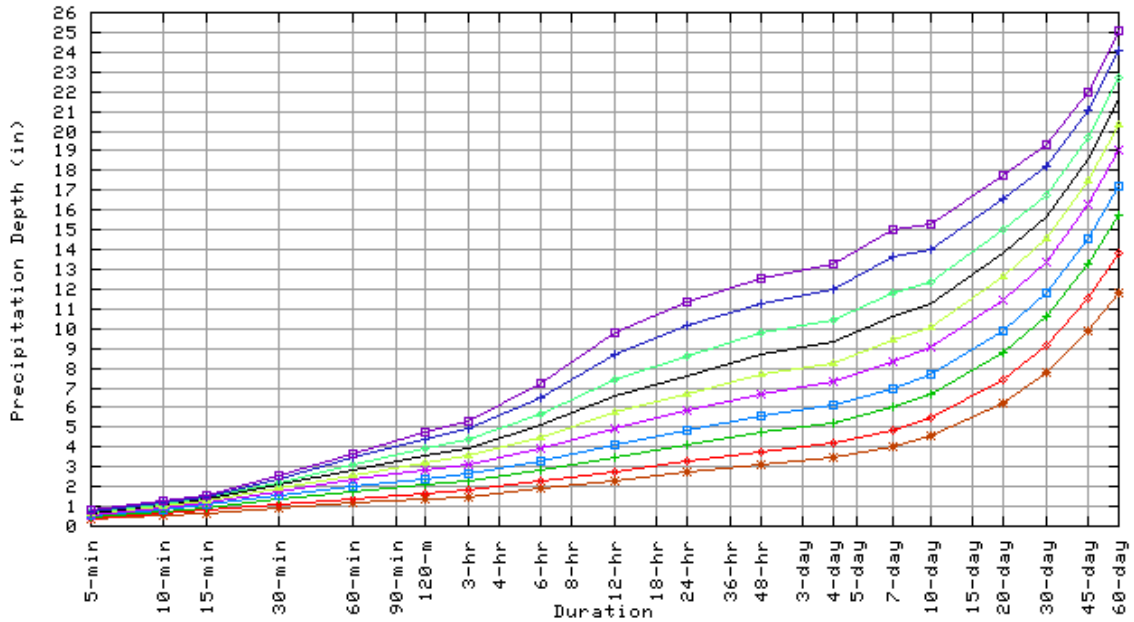

Wed Mar 11 12:14:13 2009

Average Recurrence Interval (years)	
1	*
2	+
5	x
10	□
25	*
50	x
100	+
200	x
500	+
1000	□

**TABLE A-2: NATURAL RESOURCE PROTECTION
STORMWATER MANAGEMENT CONTROLS**

Existing Natural Sensitive Resource	Mapped in the ERSAM? Yes/No/n/a	Total Area (Ac.)	Area to be Protected (Ac.)
Waterbodies			
Floodplains			
Riparian Areas / Buffers			
Wetlands			
Vernal Pools			
Woodlands			
Natural Drainage Ways			
Steep Slopes, 15%-25%			
Steep Slopes, over 25%			
Other:			
Other:			
Total Existing:			

TABLE A-3: GUIDANCE TO CALCULATE THE 2-YEAR, 24-HOUR VOLUME INCREASE FROM PRE-DEVELOPMENT TO POST-DEVELOPMENT CONDITIONS

Existing Conditions: Cover Type/Condition	Soil Type	Area (sf)	Area (ac)	CN	S	la (0.2*S)	Q Runoff (in)	Runoff Volume (ft3)
Woodland								
Meadow								
Impervious								
Total:								

Developed Conditions: Cover Type/Condition	Soil Type	Area (sf)	Area (ac)	CN	S	la (0.2*S)	Q Runoff (in)	Runoff Volume (ft3)
Total:								

2-year Volume Increase (ft3):

TABLE A-4. Runoff Curve Numbers (from NRCS (SCS) TR-55)

LAND USE DESCRIPTION	Hydrologic Condition	HYDROLOGIC SOIL GROUP			
		A	B	C	D
Open Space					
Grass cover < 50%	Poor	68	79	86	89
Grass cover 50% to 75%	Fair	49	69	79	84
Grass cover > 75%	Good	39	61	74	80
Meadow		30	58	71	78
Agricultural					
Pasture, grassland, or range – Continuous forage for grazing	Poor	68	79	86	89
Pasture, grassland, or range – Continuous forage for grazing.	Fair	49	69	79	84
Pasture, grassland, or range – Continuous forage for grazing	Good	39	61	74	80
Brush-weed-grass mixture with brush the major element.	Poor	48	67	77	83
Brush-weed-grass mixture with brush the major element.	Fair	35	56	70	77
Brush-weed-grass mixture with brush the major element.	Good	30	48	65	73
Fallow Bare soil	-----	77	86	91	94
Crop residue cover (CR)	Poor	76	85	90	93
	Good	74	83	88	90
Woods – grass combination (orchard or tree farm)	Poor	57	73	82	86
	Fair	43	65	76	82
	Good	32	58	72	79
Woods	Poor	45	66	77	83
	Fair	36	60	73	79
	Good	30	55	70	77
Commercial (85% Impervious)		89	92	94	95
Industrial (72% Impervious)		81	88	91	93
Institutional (50% Impervious)		71	82	88	90
Residential districts by average lot size:					
	% Impervious				
1/8 acre or less * (town houses)	65	77	85	90	92
1/4 acre	38	61	75	83	87
1/3 acre	30	57	72	81	86
1/2 acre	25	54	70	80	85
1 acre	20	51	68	79	84
2 acres	12	46	65	77	82
Farmstead		59	74	82	86
Smooth Surfaces (Concrete, Asphalt, Gravel or Bare Compacted Soil)		98	98	98	98
Water		98	98	98	98
Mining/Newly Graded Areas (Pervious Areas Only)		77	86	91	94

* Includes Multi-Family Housing unless justified lower density can be provided.

Note: Existing site conditions of bare earth or fallow ground shall be considered as meadow when choosing a CN value.

TABLE A-5: VOLUME CONTROL CALCULATION GUIDANCE FOR NONSTRUCTURAL BMPS

Type of Nonstructural BMP

$$\text{AREA (sq ft)} * \text{Runoff Volume (in)} * 1/12 = \text{Volume Reduction(ft}^3\text{)}$$

Use of Natural Drainage Feature

Utilize natural flow pathways _____sq ft * 1/4" * 1/12 = _____cu ft

Minimum Soil Compaction

Lawn _____sq ft * 1/3" * 1/12 = _____cu ft
Meadow _____sq ft * 1/3" * 1/12 = _____cu ft

Protecting existing trees (not located in protected area)

For trees within 20 feet of impervious cover:

Tree Canopy _____sq ft * 1" * 1/12 = _____cu ft

For trees within 20-100 feet of impervious cover:

Tree Canopy _____sq ft * 1/2" * 1/12 = _____cu ft

Rooftop Disconnection

For runoff directed to pervious and/or vegetative areas where infiltration occurs

Roof Area _____sq ft * 1/4" * 1/12 = _____cu ft

Impervious Disconnection

For runoff from impervious surfaces such as streets and concrete directed to pervious and/or vegetative areas where infiltration occurs

Impervious Area _____sq ft * 1/4" * 1/12 = _____cu ft

Total Volume Reduction

_____cu ft

* represents multiply

TABLE A-6: VOLUME CONTROL CALCULATION GUIDANCE FOR STRUCTURAL BMPS

$$\text{Required Volume Control (ft}^3\text{)} - \text{Nonstructural Volume Control (ft}^3\text{)} = \text{Structural Volume Requirement (ft}^3\text{)}$$

Table B-3
Table B-5

Type	Proposed Structural BMP	Section in BMP Manual	Area (sq ft)	Storage Volume (cu ft)
Infiltration and / or Evapotranspiration	Porous Pavement	6.4.1		
	Infiltration Basin	6.4.2		
	Infiltration Bed	6.4.3		
	Infiltration Trench	6.4.4		
	Rain Garden/Bioretention	6.4.5		
	Dry Well/Seepage Pit	6.4.6		
	Constructed Filter	6.4.7		
	Vegetative Swale	6.4.8		
	Vegetative Filter Strip	6.4.9		
	Infiltration Berm	6.4.10		
Evaporation and / or Reuse	Vegetative Roof	6.5.1		
	Capture and Re-use	6.5.2		
Runoff Quality	Constructed Wetlands	6.6.1		
	Wet Pond / Retention Basin	6.6.2		
	Dry Extended Detention Basin	6.6.3		
	Water Quality Filters	6.6.4		
Restoration	Riparian Buffer Restoration	6.7.1		
	Landscape Restoration / Reforestation	6.7.2		
	Soil Amendment	6.7.3		
Other	Level Spreader	6.8.1		
	Special Storage Areas	6.8.2		
	other			

Total Volume Control from Structural BMPs: _____

TABLE A-7 RATIONAL RUNOFF COEFFICIENTS

By Hydrologic Soils Group and Overland Slope (%)

Land Use	A			B			C			D		
	0-2%	2-6%	6%+	0-2%	2-6%	6%+	0-2%	2-6%	6%+	0-2%	2-6%	6%+
Cultivated Land	0.08s	0.13	0.16	0.11	0.15	0.21	0.14	0.19	0.26	0.18	0.23	0.31
	0.14s	0.18	0.22	0.16	0.21	0.28	0.20	0.25	0.34	0.24	0.29	0.41
Pasture	0.12	0.20	0.30	0.18	0.28	0.37	0.24	0.34	0.44	0.30	0.40	0.50
	0.15	0.25	0.37	0.23	0.34	0.45	0.30	0.42	0.52	0.37	0.50	0.62
Meadow	0.10	0.16	0.25	0.14	0.22	0.30	0.20	0.28	0.36	0.24	0.30	0.40
	0.14	0.22	0.30	0.20	0.28	0.37	0.26	0.35	0.44	0.30	0.40	0.50
Forest	0.05	0.08	0.11	0.08	0.11	0.14	0.10	0.13	0.16	0.12	0.16	0.20
	0.08	0.11	0.14	0.10	0.14	0.18	0.12	0.16	0.20	0.15	0.20	0.25
Residential												
Lot Size 1/8 Acre	0.25	0.28	0.31	0.27	0.30	0.25	0.30	0.33	0.38	0.33	0.36	0.42
	0.33	0.37	0.40	0.35	0.39	0.44	0.38	0.42	0.49	0.41	0.45	0.54
Lot Size 1/4 Acre	0.22	0.26	0.29	0.24	0.29	0.33	0.27	0.31	0.36	0.30	0.34	0.40
	0.30	0.34	0.37	0.33	0.37	0.42	0.36	0.40	0.47	0.38	0.42	0.52
Lot Size 1/3 Acre	0.19	0.23	0.26	0.22	0.26	0.30	0.25	0.29	0.34	0.28	0.32	0.39
	0.28	0.32	0.35	0.30	0.35	0.39	0.33	0.38	0.45	0.36	0.40	0.50
Lot Size 1/2 Acre	0.16	0.20	0.24	0.19	0.23	0.28	0.22	0.27	0.32	0.26	0.30	0.37
	0.25	0.29	0.32	0.28	0.32	0.36	0.31	0.35	0.42	0.34	0.38	0.48
Lot Size 1 Acre	0.14	0.19	0.22	0.17	0.21	0.26	0.20	0.25	0.31	0.24	0.29	0.35
	0.22	0.26	0.29	0.24	0.28	0.34	0.28	0.32	0.40	0.31	0.35	0.46
Industrial	0.67	0.68	0.68	0.68	0.68	0.69	0.68	0.69	0.69	0.69	0.69	0.70
	0.85	0.85	0.86	0.85	0.86	0.86	0.86	0.86	0.87	0.86	0.86	0.88
Commercial	0.71	0.71	0.72	0.71	0.72	0.72	0.72	0.72	0.72	0.72	0.72	0.72
	0.88	0.88	0.89	0.89	0.89	0.89	0.89	0.89	0.90	0.89	0.89	0.90
Streets	0.70	0.71	0.71	0.71	0.72	0.74	0.72	0.73	0.76	0.73	0.75	0.78
	0.76	0.77	0.79	0.80	0.82	0.84	0.84	0.85	0.89	0.89	0.91	0.95
Open Space	0.05	0.10	0.14	0.08	0.13	0.19	0.12	0.17	0.24	0.16	0.21	0.28
	0.11	0.16	0.20	0.14	0.19	0.26	0.18	0.23	0.32	0.22	0.27	0.39
Parking	0.85	0.86	0.87	0.85	0.86	0.87	0.85	0.86	0.87	0.85	0.86	0.87
	0.95	0.96	0.97	0.95	0.96	0.97	0.95	0.96	0.97	0.95	0.96	0.97

^a Runoff coefficients for storm recurrence intervals less than 25 years.

^b Runoff coefficients for storm recurrence intervals of 25 years or more.

Source : Rawls, W.J., S.L. Wong and R.H. McCuen, 1981, "Comparison of Urban Flood Frequency Procedures", Preliminary Draft, U.S. Department

TABLE A-8. MANNING'S ROUGHNESS COEFFICIENTS

DESCRIPTION	Manning's n-value
Smooth-wall Plastic Pipe	0.011
Concrete Pipe	0.012
Smooth-lined Corrugated Metal Pipe	0.012
Corrugated Plastic Pipe	0.024
Annular Corrugated Steel And Aluminum Alloy Pipe (Plain or polymer coated) 68 mm × 13 mm (2 2/3 in × 1/2 in) Corrugations 75 mm × 25 mm (3 in × 1 in) Corrugations 125 mm × 25 mm (5 in × 1 in) Corrugations 150 mm × 50 mm (6 in × 2 in) Corrugations	0.024 0.027 0.025 0.033
Helically Corrugated Steel And Aluminum Alloy Pipe (Plain or polymer coated) 75 mm × 25 mm (3 in × 1 in), 125 mm × 25 mm (5 in × 1 in), or 150 mm × 50 mm (6 in × 2 in) Corrugations	0.024
Helically Corrugated Steel And Aluminum Alloy Pipe (Plain or polymer coated) 68 mm × 13 mm (2 2/3 in × 1/2 in) Corrugations a. Lower Coefficients* 450 mm (18 in) Diameter 600 mm (24 in) Diameter 900 mm (36 in) Diameter 1200 mm (48 in) Diameter 1500 mm (60 in) Diameter or larger b. Higher Coefficients**	0.014 0.016 0.019 0.020 0.021 0.024
Annular or Helically Corrugated Steel or Aluminum Alloy Pipe Arches or Other Non-Circular Metal Conduit (Plain or Polymer coated)	0.024
Vitrified Clay Pipe	0.012
Ductile Iron Pipe	0.013
Asphalt Pavement	0.015
Concrete Pavement	0.014
Grass Medians	0.050
Grass – Residential	0.30
Earth	0.020
Gravel	0.030
Rock	0.035
Cultivated Areas	0.030 - 0.050
Dense Brush	0.070 - 0.140
Heavy Timber (Little undergrowth)	0.100 - 0.150
Heavy Timber (w/underbrush)	0.40
Streams: a. Some Grass And Weeds (Little or no brush) b. Dense Growth of Weeds c. Some Weeds (Heavy brush on banks)	0.030 - 0.035 0.035 - 0.050 0.050 - 0.070

Notes:

* Use the lower coefficient if any one of the following conditions apply:

- a. A storm pipe longer than 20 diameters, which directly or indirectly connects to an inlet or manhole, located in swales adjacent to shoulders in cut areas or depressed medians.
- b. A storm pipe which is specially designed to perform under pressure.

**Use the higher coefficient if any one of the following conditions apply:

- a. A storm pipe which directly or indirectly connects to an inlet or manhole located in highway pavement sections or adjacent to curb or concrete median barrier.
- b. A storm pipe which is shorter than 20 diameters long.
- c. A storm pipe which is partly lined helically corrugated metal pipe.

APPENDIX B

NESHAMINY CREEK WATERSHED **SWM SITE PLAN CHECKLIST**

APPENDIX B NESHAMINY CREEK WATERSHED SWM SITE PLAN CHECKLIST

Project: _____
Municipality: _____
Engineer: _____
Submittal No: _____
Date: _____
Project ID: _____ (for Municipal use ONLY)

SECTION I: REGULATED ACTIVITIES

Reference: Section 26-104

1. Is the Proposed Project within the Neshaminy Creek watershed? Yes No
2. Does the Proposed Project meet the definition of a "Regulated Activity"? Yes No

STOP – If you have checked NO for either of the above questions, you are not required to submit a Stormwater Management Plan under the Neshaminy Creek Stormwater Management Ordinance.

SECTION II: EXEMPTION

Reference: Section 26-105

1. Does the regulated activity create an Impervious Surface less than or equal to 1,000 square feet?
 Yes No
2. Does the regulated activity create an Impervious Surface greater than 1,000 square feet but less than 2,500 square feet? Yes No
3. Does the regulated activity involve an Agricultural Activity? Yes No
4. Does the regulated activity involve Forest Management or Timber Operations? Yes No

Parcel IS Exempt from the SWM Site Plan and Peak Rate Control

Parcel IS Exempt from Peak Rate Control

Parcel IS NOT Exempt

SECTION III: VOLUME CONTROLS

Reference: Section 26-123

A. Site Disturbance Minimization

1. Has an Existing Resource and Site Analysis Map (ERSAM) been prepared?

Yes No, Explain _____

2. Are any of the following environmentally sensitive areas identified on site?

- | | | | |
|-------------------------------|------------------------------|-----------------------------|----------------------------------|
| Steep Slopes | <input type="checkbox"/> Yes | <input type="checkbox"/> No | <input type="checkbox"/> Unknown |
| Ponds / Lakes / Vernal Pools | <input type="checkbox"/> Yes | <input type="checkbox"/> No | <input type="checkbox"/> Unknown |
| Streams | <input type="checkbox"/> Yes | <input type="checkbox"/> No | <input type="checkbox"/> Unknown |
| Wetlands | <input type="checkbox"/> Yes | <input type="checkbox"/> No | <input type="checkbox"/> Unknown |
| Hydric Soils | <input type="checkbox"/> Yes | <input type="checkbox"/> No | <input type="checkbox"/> Unknown |
| Flood plains | <input type="checkbox"/> Yes | <input type="checkbox"/> No | <input type="checkbox"/> Unknown |
| Stream Buffer Zones | <input type="checkbox"/> Yes | <input type="checkbox"/> No | <input type="checkbox"/> Unknown |
| Hydrologic Soil Groups A or B | <input type="checkbox"/> Yes | <input type="checkbox"/> No | <input type="checkbox"/> Unknown |
| Recharge Areas | <input type="checkbox"/> Yes | <input type="checkbox"/> No | <input type="checkbox"/> Unknown |
| Others: _____ | <input type="checkbox"/> Yes | <input type="checkbox"/> No | <input type="checkbox"/> Unknown |

3. Does the site layout plan avoid environmentally sensitive areas identified on site?

- Yes No, Explain _____

B. Post-development Runoff Volume Control

1. What method is used to calculate the required volume control?

- Design-storm method Simplified method

2. What is the level of runoff volume (ft³) required to be controlled from the post-development site?
_____ (ft³)

C. Stormwater runoff control measures

1. What is the level of runoff volume (ft³) controlled through nonstructural BMPs? _____ (ft³)

2. What is the level of runoff volume (ft³) controlled through structural BMPs? _____ (ft³)

3. Have provisions been installed to promote infiltration on site?

- Yes No, Explain _____

4. Have provisions been installed to promote evapotranspiration, capture or reuse on site?

- Yes No, Explain _____

SECTION V: PEAK RATES

Reference: Section 26-122

1. In which of the following Storm Water Management District(s) is the site located?

<input type="checkbox"/>	A
<input type="checkbox"/>	B
<input type="checkbox"/>	C

2. Does the Proposed Conditions Runoff meet the Criteria established in Section 26-122.D?

Yes No, if you answered Yes proceed to Section VI.

SECTION VI: CALCULATION METHODOLOGY

Reference: Section 26-129 and Ordinance Appendix A

1. Which method(s) are utilized in the site stormwater management plan for computing stormwater runoff rates and volumes?

TR-20 PSRM
 TR-55 Rational Method
 HEC-1 /HEC-HMS Other:_____

2. Was Table A-1 or Figure A-1 utilized in rainfall determination?

Yes No, Explain _____

3. Was Table A-4 (Runoff Curve Numbers) or Table A-7 (Rational Runoff Coefficients) utilized in calculations for runoff?

Yes No, Explain _____

SECTION IX: OTHER REQUIREMENTS

Reference: Section 26-130.3

1. Is the proposed activity considered a "Stormwater hot spot" as defined in Ordinance Appendix H?
 Yes No, If yes, what pre-treatment BMPs are planned?
-

2. Have proposed wet detention basins incorporated biologic control consistent with the West Nile Virus Guidelines presented in Ordinance Appendix I?

Yes No Not Applicable

SECTION X: FACILITY OPERATION AND MAINTENANCE PLAN

Reference: Section 26-162

1. Has a Stormwater Control and BMP Operations and Maintenance Plan been approved by the Municipality?

Yes No, Explain _____

2. Who shall assume responsibility for implementing the Stormwater Control and BMP Operations and Maintenance Plan?

<input type="checkbox"/> Municipality	<input type="checkbox"/> Homeowner Association
<input type="checkbox"/> Private Owner	<input type="checkbox"/> Other _____

APPENDIX C

SITE EVALUATION AND SOIL INFILTRATION TESTING

SITE EVALUATION AND SOIL INFILTRATION TESTING PROTOCOL

A. Purpose of this Protocol

The purpose of the *Site Evaluation and Soil Infiltration Testing Protocol* is to describe evaluation and field testing procedures to:

1. Determine if infiltration BMPs are suitable at a site, and at what locations.
2. Obtain the required data for infiltration BMP design.

B. When to Conduct Testing

The site development process outlined in Chapters 4 and 5 of the Pennsylvania Stormwater Management Best Management Practices Manual, December 2006, as amended (“Manual”) describe a process for site development and BMPs. Soil Evaluation and Investigation shall be conducted early in the preliminary design of the project so that information developed in the testing process can be incorporated into the design. The Soil Evaluation and Investigation shall be conducted prior to development of the preliminary plan. The design engineer should possess a preliminary understanding of potential BMP locations prior to testing. Prescreening test may be carried out in advance of site potential BMP locations.

C. Who Should Conduct Testing

Qualified professionals who can substantiate by qualifications/experience their ability to carry out the evaluation shall conduct the test pit soil evaluations. A professional, experienced in observing and evaluating soils conditions is necessary to ascertain conditions that might affect BMP performance, which cannot be thoroughly assessed with the testing procedures. Such professionals must conduct these evaluations in risk areas, and areas indicated in the Manual as non-preferred locations for testing or BMP implementation.

D. Importance of Stormwater BMP Areas

Sites are often defined as unsuitable for infiltration BMPs and soil based BMPs due to proposed grade changes (excessive cut or fill) or lack of suitable areas. Many sites will be constrained and unsuitable for infiltration BMPs. However, if suitable areas exist, these areas must be identified early in the design process and not be subject to a building program that precludes infiltration BMPs. An exemption will not be permitted for development of suitable soils that may be necessary for stormwater infiltration.

E. Safety

As with all field work and testing, attention must be given to all applicable OSHA regulations related to earthwork and excavation. Digging and excavation shall not be conducted without adequate notification through the Pennsylvania One Call system (**PA One Call** 1-

800-242-1776 or www.paonecall.org). Excavations shall not be left unsecured and unmarked, and all applicable authorities must be notified prior to any work.

F. Infiltration Testing: A Multi-Step Process

Infiltration Testing is a four-step process to obtain the necessary data for design of the stormwater management plan. The four steps include:

1. Background Evaluation

- Based on available published and site specific data
- Includes consideration of proposed development plan
- Used to identify potential BMP locations and testing locations
- Prior to field work (desktop)
- On-site screening test

2. Test Pit (Deep Hole) Observation

- Includes Multiple Testing Locations
- Provides an understanding of sub-surface conditions
- Identifies limiting conditions

3. Infiltration Testing

- Must be conducted onsite
- Different testing methods available
- Alternate methods for – additional – Screening and Verification testing

4. Design Considerations

- Determination of suitable infiltration rate for design calculations
- Consideration of BMP drawdown
- Consideration of peak rate attenuation

Step 1. Background Evaluation

Prior to performing testing and developing a detailed site plan, existing conditions at the site must be inventoried and mapped including, but not limited to:

- Existing mapped individual soils and USDA Hydrologic Soil Group classifications.
- Existing geology, including the location of any dikes, faults, fracture traces, solution cavities, landslide prone strata, or other features of note.
- Existing streams (perennial and intermittent, including intermittent swales) water bodies, wetlands, hydric soils, floodplains, alluvial soils, stream classifications, headwaters and 1st order streams.
- Existing topography, slope, and drainage patterns.
- Existing and previous land uses.
- Other natural or man-made features or conditions that may impact design, such as past uses of site, existing nearby structures (building, walls), etc.

In Step 1, the designer should determine the potential location of infiltration BMPs. The approximate location of these BMPs should be identified on the proposed development plan and serve as the basis for the location and number of tests to be performed onsite. A sketch plan or preliminary layout plan for development should be evaluated, including:

- Preliminary grading plan and areas of cut and fill.
- Location and water surface elevation of all existing and location of proposed water supply sources and wells.
- Location of all existing and proposed onsite wastewater systems.
- Location of other features of note such as utility right-of-ways, water and sewer lines, etc.
- Existing data such as structural borings, drillings, and geophysical testing.
- Proposed location of development features (buildings, roads, utilities, walls, etc.).

Important: If the proposed development program is located on areas that may otherwise be suitable for BMP location, or if the proposed grading plan is such that potential BMP locations are eliminated, the designer must revisit the proposed layout and grading plan and adjust the development plan as necessary. Development on areas suitable for infiltration BMPs may *not* preclude the use of BMPs for volume reduction and groundwater recharge.

Step 2. Test Pits (Deep Holes)

A Test Pit (Deep Hole) allows visual observation of the soil horizons and overall soil conditions both horizontally and vertically in that portion of the site. An extensive number of Test Pit observations can be made across a site at a relatively low cost and in a short time period. The use of soil borings as a substitute for Test Pits is not permitted as visual observation is narrowly limited in a soil boring and the soil horizons cannot be observed in-situ, but must be observed from the extracted borings. Borings and other procedures, however, might be suitable for initial screening to develop a plan for testing, or verification testing.

A Test Pit consists of a backhoe-excavated trench, two and one half (2½) to three (3) feet wide, to a depth of between seventy two (72) inches and ninety (90) inches, or until bedrock or fully saturated conditions are encountered. The trench should be benched at a depth of two (2) to three (3) feet for access and/or infiltration testing.

At each Test Pit, the following conditions shall be noted and described. Depth measurements shall be described as depth below the ground surface:

- ___ Soil horizons (upper and lower boundary)
- ___ Soil texture and color for each horizon
- ___ Color patterns
- ___ Depth to water table
- ___ Depth to bedrock
- ___ Observance of pores or roots (size, depth)
- ___ Estimated type and percent coarse fragments
- ___ Hardpan or limiting layers

- ___ Strike and dip of horizons (especially lateral direction of flow at limiting layers)
- ___ Additional comments or observations

The Sample Soil Log Form at the end of this protocol may be used for documentation of each Test Pit. (Refer Appendix C of the Pennsylvania Stormwater Best Management Practices Manual)

At the designer's discretion, soil samples may be collected at various horizons for additional analysis. Following testing, the test pits must be refilled with the original soil and the surface replaced with the original topsoil. A Test Pit should *never* be accessed if soil conditions are unsuitable for safe entry, or if site constraints preclude entry.

It is important that the Test Pit provide information related to conditions at the bottom of the proposed infiltration BMP. If the BMP depth will be greater than ninety (90) inches below existing grade, deeper excavation will be required. However, *such depths are discouraged*. Except for surface discharge BMPs (filter strips, etc.) the designer is cautioned regarding the proposal of systems that are significantly lower than the existing topography. The suitability for infiltration may decrease, and risk factors are likely to increase. *Locations that are not preferred* for testing *and* subsurface infiltration BMPs include swales, the toe of slopes for most sites, and soil mantels of less than three feet.

The designer and contractors shall limit proposed grading and earthwork to reduce site disturbance and compaction so that a greater opportunity exists for testing and stormwater management.

The number of Test Pits varies depending on site conditions and the proposed development plan. General guidelines are as follows:

- For single-family residential subdivisions with on-lot BMPs, one test pit per lot is recommended, preferably within twenty five (25) feet of the proposed BMP area. Verification testing should take place when BMPs area sited at greater distances.
- For multi-family and high density residential developments, one test pit per BMP area or acre is recommended.
- For large infiltration areas (basins, commercial, institutional, industrial, and other proposed land uses), multiple test pits should be evenly distributed at the rate of four (4) to six (6) tests per acre of BMP area.

The recommendations above are guidelines. Additional tests will be required if local conditions indicate significant variability in soil types, geology, water table levels, bedrock, topography, etc. Similarly, uniform site conditions may indicate that fewer test pits are necessary. Excessive testing and disturbance of the site prior to construction is not recommended.

Step 3. Infiltration Tests/Permeability Tests

A variety of field tests exist for determining the infiltration capacity of a soil. Laboratory tests are not permitted, as a homogeneous laboratory sample does not represent field conditions. Infiltration tests shall be conducted in the field. Tests should not be conducted in the rain or within twenty four (24) hours of a significant rainfall events (>0.5 inches), or when the temperature is below freezing. However, the preferred testing *is* between January and June, the wet season. This is the period when infiltration is likely to be

diminished by saturated conditions. Percolation tests carried out between June 1 and December 31 shall use a twenty four (24) hour presoaking before the testing. This procedure is not required for infiltrometer testing, or permeometer testing.

At least one test shall be conducted at the proposed bottom elevation of an infiltration BMP, and a minimum of two tests per Test Pit is recommended. More tests may be warranted if the results for first two tests are substantially different. The highest rate (inches/hour) for test results should be discarded when more than two are employed for design purposes. The geometric mean should be used to determine the average rate following multiple tests.

Based on observed field conditions, the proposed bottom elevation of BMP may be revised. Infiltration testing should be proposed to adjust locations and depths depending upon observed conditions.

Methodologies discussed in this protocol include:

- Double-ring infiltrometer tests.
- Percolation tests (such as for onsite wastewater systems and described in PA Code Chapter 73).

There are differences between the two methods. A double-ring infiltrometer test estimates the vertical movement of water through the bottom of the test area. The outer ring helps to reduce the lateral movement of water in the soil. A percolation test allows water movement through both the bottom and sides of the test area. For this reason, the measured rate of water level drop in a percolation test must be adjusted to represent the discharge that is occurring on both the bottom and sides of the percolation test hole.

For *infiltration basins*, an infiltration test should be completed with an infiltrometer (not percolation test) to determine the saturated hydraulic conductivity rate. This precaution is taken to account for the fact that only the surface of the basin functions to infiltrate, as measured by the test. Alternatively, permeability test procedures that yield a saturated hydraulic conductivity rate can be used (see formulas developed by Elirick and Reynolds (1992), or others for computation of hydraulic conductivity and saturated hydraulic conductivity).

Other testing methodologies and standards that are available but not discussed in detail in this protocol include (but are not limited to):

- Constant head double-ring infiltrometer.
- Testing as described in the Maryland Stormwater Manual Appendix D.1 using five (5) inch diameter casing.
- ASTM 2003 Volume 4.08, Soil and Rock (I): Designation D3385-03, Standard Test Method for Infiltration Rate of Soils in Field Using a Double-Ring Infiltrometer.
- ASTM 2002 Volume 4.09, Soil and Rock (II): Designation D 5093.90, Standard Test Method for Field Measurement of Infiltration Rate Using a Double-Ring Infiltrometer with a Sealed-Inner Ring.
- Guelph Permeameter.
- Constant Head Permeameter (Amoozemeter).

a. Methodology for Double-Ring Infiltrometer Field Test

A Double-ring Infiltrometer consists of two concentric metal rings. The rings are driven into the ground and filled with water. The outer ring helps to prevent divergent flow. The drop in water level or volume in the inner ring is used to calculate an infiltration rate. The infiltration rate is determined as the amount of water per surface area and time unit that penetrates the soils. The diameter of the inner ring should be approximately fifty (50) percent to seventy (70) percent of the diameter of the outer ring, with a minimum inner ring size of four (4) inches, preferably much larger. (Bouwer, 1986).

Equipment for Double-Ring Infiltrometer Test:

- ___ Two concentric cylinder rings six (6) inches or greater in height. Inner ring diameter equal to fifty (50) percent – seventy (70) percent of outer ring diameter (e.g. an eight (8) inch ring and a twelve (12) inch ring).
- ___ Water supply.
- ___ Stopwatch or timer.
- ___ Ruler or metal measuring tape.
- ___ Flat wooden board for driving cylinders uniformly into soil.
- ___ Rubber mallet.
- ___ Log sheets for recording data.

Procedure for Double-Ring Infiltrometer Test:

- ___ Prepare level testing area.
- ___ Place outer ring in place; place flat board on ring and drive ring into soil to a minimum depth of two (2) inches.
- ___ Place inner ring in center of outer ring; place flat board on ring and drive ring into soil a minimum of two (2) inches. The bottom rim of both rings should be at the same level.
- ___ The test area should be presoaked immediately prior to testing. Fill both rings with water to water level indicator mark or rim at thirty (30) minute intervals for one (1) hour. The minimum water depth should be four (4) inches. The drop in water level during the last thirty (30) minutes of the presoaking period should be applied to the following standard to determine the time interval between readings.
 - If water level drop is two (2) inches or more, use ten (10) minute measurement intervals.
 - If water level drop is less than two (2) inches, use thirty (30) minute measurement intervals.
- ___ Obtain a reading of the drop in water level in the center ring at appropriate time intervals. After each reading, refill both rings to water level indicator mark or rim. Measurement to the water level in the center ring shall be made from a fixed reference point and shall continue at the interval determined until a minimum of eight readings are completed or until a stabilized rate of drop is obtained,

whichever occurs first. A stabilized rate of drop means a difference of one quarter ($\frac{1}{4}$) inch or less of drop between the highest and lowest readings of four consecutive readings.

- ___ The drop that occurs in the center ring during the final period or the average stabilized rate, expressed as inches per hour, shall represent the infiltration rate for that test location.

b. Methodology for Percolation Test

Equipment for Percolation Test:

- ___ Post hole digger or auger.
- ___ Water supply.
- ___ Stopwatch or timer.
- ___ Ruler of metal measuring tape.
- ___ Log sheets for recording data.
- ___ Knife blade or sharp pointed instrument (for soil scarification).
- ___ Course sand or fine gravel.
- ___ Object for fixed reference point during measurement (nail, toothpick, etc.).

Procedure for Percolation Test

This percolation test methodology is based largely on the Pennsylvania Department of Environmental Protection (PADEP) criteria for onsite sewage investigation of soils (as described in Chapter 73 of the Pennsylvania Code). This must include the twenty four (24) hour presoak procedure. The presoak is done primarily to simulate saturated conditions in the environment and to minimize the influence of unsaturated flow.

Prepare level testing area.

- ___ Prepare hole having a uniform diameter of six (6) to ten (10) inches and depth of eight (8) to twelve (12) inches. The bottom and sides of the hole should be scarified with a knife blade or sharp pointed instrument to completely remove any smeared soil surfaces and to provide a natural soil interface into which water may percolate. Loose material should be removed from the hole.
- ___ (Optional) two (2) inches of coarse sand or fine gravel may be placed in the bottom of the hole to protect the soil from scouring and clogging of the pores.
- ___ Test holes should be presoaked immediately prior to testing. Water should be placed in the hole to a minimum depth of six (6) inches over the bottom and readjusted every thirty (30) minutes to one (1) hour.
- ___ The drop in the water level during the last thirty (30) minutes of the final presoaking period should be applied to the following standard to determine the time interval between readings for each percolation hole:
 - If water remains in the hole, the interval for readings during the percolation test should be thirty (30) minutes.

- If no water remains in the hole, the interval for readings during the percolation test may be reduced to ten (10) minutes.

- After the final presoaking period, water in the hole should again be adjusted to a minimum depth of six (6) inches and readjusted when necessary after each reading. A nail or marker should be placed at a fixed reference point to indicate the water refill level. The water level depth and hole diameter should be recorded.
- Measurement to the water level in the individual percolation holes should be made from a fixed reference point and should continue at the interval determined from the previous step for each individual percolation hole until a minimum of eight readings are completed or until a stabilized rate of drop means a difference of one quarter (¼) inch or less of drop between the highest and lowest readings of four consecutive readings.
- The drop that occurs in the percolation hole during the final period, expressed as inches per hour, shall represent the percolation rate for that test location.
- The average measured rate must be adjusted to account for the discharge of water from both the sides and bottom of the hole to develop a representative infiltration rate. The average/final percolation rate should be adjusted for each percolation test according to the following formula:

Infiltration Rate = (Percolation Rate) / (Reduction Factor)

Where the Reduction Factor is given**:

$$R_f = \frac{2d_1 - \Delta d + 1}{DIA}$$

With:

- d_1 = Initial Water Depth (in.)
- Δd = Average/Final Water Level Drop (in.)
- DIA = Diameter of the Percolation Hole (in.)

The Percolation Rate is simply divided by the Reduction Factor as calculated above or shown in the table below to yield the representative Infiltration Rate. In most cases, the Reduction Factor varies from about two (2) to four (4) depending on the percolation hole dimensions and water level drop – wider and shallower tests have lower Reduction Factors because proportionately less water exfiltrates through the sides. For design purposes additional safety factors are employed (see Protocol 2, Infiltration Systems Design and Construction Guidelines).

*** The area Reduction Factor accounts for the exfiltration occurring through the sides of percolation hole. It assumes that the percolation rate is affected by the depth of water in the hole and that the percolating surface of the hole is in uniform soil. If there are significant problems with either of these assumptions then other adjustments may be necessary.*

Source: *Pennsylvania Stormwater Best Management Practice Manual, December 2006.*

APPENDIX D

LOW IMPACT DEVELOPMENT TECHNIQUES

APPENDIX D

LOW IMPACT DEVELOPMENT PRACTICES

**ALTERNATIVE APPROACH FOR
MANAGING STORMWATER RUNOFF**

Natural hydrologic conditions may be altered radically by poorly planned development practices. Deleterious activities include introducing unneeded impervious surfaces, destroying existing drainage swales, constructing unnecessary storm sewers, and changing local topography. A traditional drainage approach of development has been to remove runoff from a site as quickly as possible and capture in a detention basin in accordance with the local regulations. This approach leads ultimately to the expenditure of additional resources for detaining and managing concentrated runoff at some downstream locations.

The recommended alternative approach is to promote practices that will minimize postdevelopment runoff rates and volumes, which will minimize needs for artificial conveyance and storage facilities. To simulate predevelopment hydrologic conditions, forced infiltration is often necessary to offset the loss of infiltration by creation of impervious surfaces. The ability of the ground to infiltrate depends upon the soil types and its conditions.

Preserving natural hydrologic conditions requires careful alternative site design considerations. Site design practices include preserving natural drainage features, minimizing impervious surface area, reducing the hydraulic connectivity of impervious surfaces, and protecting natural depression storage. A well designed site will contain a mix of all those features. The following describes various techniques to achieve for the alternative approach:

A. Protect Sensitive and Special Value Resources: (Refer Section 5.4 of the Pennsylvania Stormwater Best Management Practices Manual, Pennsylvania Department of Environmental Protection (PADEP) no. 363-0300-002 (2006)

1. **Preserving Natural Drainage Features.** Protecting natural drainage features, particularly vegetated drainage swales and channels, is desirable because of their ability to infiltrate and attenuate flows and to filter pollutants. However, this objective is often not accomplished in modern developments. In fact, commonly held drainage philosophy encourages just the opposite pattern. Streets and adjacent storm sewers typically are located in the natural headwater valleys and swales, thereby replacing natural drainage functions with a completely impervious system. Runoff and pollutants generated from impervious surfaces flow directly into storm sewers with no opportunity for attenuation, infiltration, or filtration. Developments designed to fit site topography also minimizes the amount of grading onsite.
2. **Protecting Natural Depression Storage Areas.** Depressional storage areas have no surface outlet or drain very slowly following a storm event. They can be commonly seen as ponded areas in farm fields during the wet season or after large runoff events. Traditional development practices eliminate these depressions by filling or draining, thereby obliterating their ability to reduce the surface runoff volumes and trap pollutants. The volume and release rate characteristics of depressions should be protected in the design of the development site. The depressions can be protected by

simply avoiding the depression or by incorporating its storage as additional capacity in required detention facilities.

B. Reduce Impervious Coverage: (Refer Section 5.7 of the Pennsylvania Stormwater Best Management Practices Manual, Pennsylvania Department of Environmental Protection (PADEP) no. 363-0300-002 (2006))

1. **Avoiding Introduction of Impervious Areas.** A careful site planning should consider reducing impervious coverage to the maximum extent possible. Building footprints, sidewalks, driveways, and other features producing impervious surfaces should be evaluated to minimize impacts on runoff.
2. **Disconnecting Impervious Surfaces (DIAs).** Impervious surfaces are significantly less of a problem if they are not directly connected to an impervious conveyance system (such as storm sewer). Two basic ways to reduce hydraulic connectivity are routing of roof runoff over lawns and reducing the use of storm sewers. Site grading should promote increasing travel time of stormwater runoff, and should help reduce concentration of runoff to a single point in the development.

C. Disconnect/Distribute/Decentralize: (Refer Section 5.8 of the Pennsylvania Stormwater Best Management Practices Manual, Pennsylvania Department of Environmental Protection (PADEP) no. 363-0300-002 (2006))

1. **Routing Roof Runoff Over Lawns.** Roof runoff can be easily routed over lawns in most site designs. The practice discourages direct connections of downspouts to storm sewers or parking lots. The practice also discourages sloping driveways and parking lots to the street. By routing roof drains and crowning the driveway to run off to the lawn, the lawn is essentially used as a filter strip.
2. **Reducing the Use of Storm Sewers.** By reducing use of storm sewers for draining streets, parking lots, and backyards, the potential for accelerating runoff from the development can be greatly reduced. The practice requires greater use of swales and may not be practical for some development sites, especially if there are concerns for areas that do not drain in a “reasonable” time. The practice requires educating local citizens and public works officials, who expect runoff to disappear shortly after a rainfall event.
3. **Reducing Street Widths.** Street widths can be reduced by either eliminating on-street parking or by reducing roadway widths. Municipal planners and traffic designers should encourage narrower neighborhood streets which ultimately could lower maintenance.
4. **Limiting Sidewalks to One Side of the Street.** A sidewalk on one side of the street may suffice in low-traffic neighborhoods. The lost sidewalk could be replaced with bicycle/recreational trails that follow back-of-lot lines. Where appropriate, backyard trails should be constructed using pervious materials.
5. **Using Permeable Paving Materials.** These materials include permeable interlocking concrete paving blocks or porous bituminous concrete. Such materials should be considered as alternatives to conventional pavement surfaces, especially for low use surfaces such as driveways, overflow parking lots, and emergency access roads.

6. **Reducing Building Setbacks.** Reducing building setbacks reduces driveway and entry walks and is most readily accomplished along low traffic streets where traffic noise is not a problem.

D. Constructing and Concentrate: (Refer Section 5.5 of the Pennsylvania Stormwater Best Practices Manual, Pennsylvania Department of Environmental Protection (PADEP) no. 363-0300-002 (2006). Cluster developments can also reduce the amount of impervious area for a given number of lots. The biggest savings is in street length, which also will reduce costs of the development. Cluster development clusters the construction activity onto less-sensitive areas without substantially affecting the gross density of development.

In summary, a careful consideration of the existing topography and implementation of a combination of the above mentioned techniques may avoid construction of costly stormwater control measures. Benefits included reduced potential of downstream flooding, water quality degradation of receiving streams/water bodies, and enhancement of aesthetics and reduction of development costs. Other benefits include more stable baseflows in receiving streams, improved groundwater recharge, reduced flood flows, reduced pollutant loads, and reduced costs for conveyance and storage.

APPENDIX E

NONSTRUCTURAL STORMWATER MANAGEMENT BMPs

Non-Structural BMPs

1. Tree Plantings and Preservation

Trees and forests reduce stormwater runoff by capturing and storing rainfall in the canopy and releasing water into the atmosphere through evapotranspiration. Tree roots and leaf litter also create soil conditions that promote the infiltration of rainwater into the soil. In addition, trees and forests reduce pollutants by taking up nutrients and other pollutants from soils and water through their root systems. A development site can reduce runoff volume by planting new trees or by preserving trees which existed on the site prior to development. The volume reduction calculations either determine the cubic feet to be directed to the area under the tree canopy for infiltration or determine a volume reduction credit which can be used to reduce the size of any one of the planned structural BMPs on the site.

Tree Considerations:

- Existing trees must have at least a 4" trunk caliper or larger.
- Existing tree canopy must be within 100 ft. of impervious surfaces.
- A tree canopy is classified as the continuous cover of branches and foliage formed by a single tree or collectively by the crowns of adjacent trees.
- New tree plantings must be at least 6 ft. in height and have a 2" trunk caliper.
- All existing and newly planted trees must be native to Pennsylvania. See <http://www.dcnr.state.pa.us/forestry/commontr/commontrees.pdf> for a guide book titled *Common Trees of Pennsylvania* for a native tree list.
- When using trees as volume control BMPs, runoff from impervious areas should be directed to drain under the tree canopy.

Determining the required number of planted trees to reduce the runoff volume:

1. Determine contributing impervious surface area:

Garage Roof (Right)	6 ft. x 24 ft.	=	144	ft
---------------------	----------------	---	-----	----

2. Calculate the required control volume:

$$(144 \text{ sq. ft.} \times 2 \text{ inches of runoff}) / 12 \text{ inches} = 24 \text{ cu. ft.}$$

3. Determine the number of tree plantings:

- A newly planted deciduous tree can reduce runoff volume by 6 cu. ft.
- A newly planted evergreen tree can reduce runoff volume by 10 cu. ft.

$$24 \text{ cu. ft.} / 6 \text{ cu. ft.} = 4 \text{ Deciduous Trees}$$

Determining the volume reduction for preserving existing trees:

1. Calculate approximate area of the existing tree canopy:

$$\sim 22 \text{ sq. ft.} \times \sim 23 \text{ sq. ft.} = 500 \text{ sq. ft.}$$

2. Measure distance from impervious surface to tree canopy: 35 ft.
3. Calculate the volume reduction credit by preserving existing trees:
 - For Trees within 20 feet of impervious cover:
Volume Reduction cu. ft. = (Existing Tree Canopy sq. ft. x 1 inch) / 12
 - For Trees beyond 20 feet but not farther than 100 feet from impervious cover:
Volume Reduction cu. ft. = (Existing Tree Canopy sq. ft. x 0.5 inch) / 12

$$(500 \text{ sq. ft.} \times 0.5 \text{ inches}) / 12 = 21 \text{ cu. ft.}$$

This volume credit can be utilized in reducing the size of any one of the structural BMPs planned on the site. For example, the 21 cu. ft. could be subtracted from the required infiltration volume when sizing the infiltration trench;

$$510 \text{ cu. ft.} - 21 \text{ cu. ft.} = 489 \text{ cu. ft.}$$

$$489 \text{ cu. ft.} / 3 \text{ ft (Depth)} = 163 / 6 \text{ ft. (Width)} = 27.1 \text{ ft (Length)}$$

Using the existing trees for a volume credit would decrease the length of the infiltration trench to 27.1 ft. instead of 28.3 ft.

2. Minimize Soil Compaction and Replant with Lawn or Meadow

When soil is overly compacted during construction it can cause a drastic reduction in the permeability of the soil and rarely is the soil profile completely restored. Runoff from vegetative areas with highly compacted soils similarly resembles runoff from an impervious surface. Minimizing soil compaction and re-planting with a vegetative cover like meadow or lawn, not only increases the infiltration on the site, but also creates a friendly habitat for a variety of wildlife species.

Design Considerations:

- Area shall not be stripped of topsoil.
- Vehicle movement, storage, or equipment/material lay down shall not be permitted in areas preserved for minimum soil compaction.
- The use of soil amendments and additional topsoil is permitted.
- Meadow should be planted with native grasses. Refer to *Meadows and Prairies: Wildlife-Friendly Alternatives to Lawn* at <http://pubs.cas.psu.edu/FreePubs/pdfs/UH128.pdf> for reference on how to properly plant the meadow and for a list of native species.

Determining the volume reduction by minimizing soil compaction and planting a meadow:

1. Calculate approximate area of preserved meadow:

$$\sim 22 \text{ sq. ft.} \times \sim 23 \text{ sq. ft.} = 500 \text{ sq. ft.}$$

2. Calculate the volume reduction credit by minimizing the soil compaction and planting a lawn/meadow:

- For Meadow Areas: Volume Reduction (cu. ft.) = (Area of Min. Soil Compaction (sq. ft.) x 1/3 inch of runoff) / 12

$$(500 \text{ sq. ft.} \times 1/3 \text{ inch of runoff}) / 12 = 13.8 \text{ cu. ft.}$$

- For Lawn Areas: Volume Reduction (cu. ft.) = (Area of Min. Soil Compaction (sq. ft.) x 1/4 inch of runoff) / 12

$$(500 \text{ sq. ft.} \times 1/4 \text{ inch of runoff}) / 12 = 10.4 \text{ cu. ft.}$$

This volume credit can be used to reduce the size of any one of the structural BMPs on the site. See explanation under the volume credit for preserving existing trees for details.

Alternative BMP to Capture and Reuse Stormwater


Rain Barrels

Rain barrels are large containers that collect drainage from roof leaders and temporarily store water to be released to lawns, gardens, and other landscaped areas after the rainfall has ended. Rain barrels are typically between 50 and 200 gallons in size. It is not recommended for rain barrels to be used as a volume control BMP because infiltration is not guaranteed after each storm event. For this reason, a rain barrel is not utilized in the site plan example. However, the information is included to provide an alternative for a homeowner to utilize when considering capture and reuse stormwater methods.

Design Considerations:

- Rain barrels should be directly connected to the roof gutter/spout.
- There must be a means to release the water stored between storm events to provide the necessary storage volume for the next storm.
- When calculating rain barrel size, rain barrels are typically assumed to be 25% full because they are not always emptied before the next storm.
- Use screens to filter debris and cover lids to prevent mosquitoes.
- An overflow outlet should be placed a few inches below the top with an overflow pipe to divert flow away from structures.
- It is possible to use a number of rain barrels jointly for an area.

Figure 2: Rain Barrel Diagram and Examples

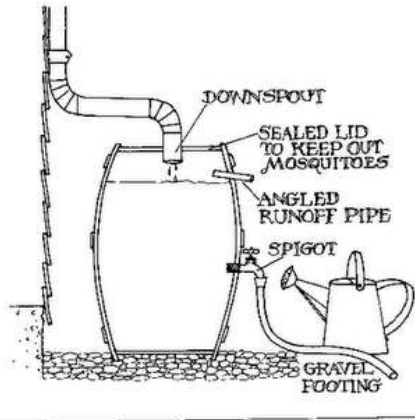

Sources: (top picture) <http://www.citywindsor.ca/DisplayAttach.asp?AttachID=12348>
 (bottom picture on left) <http://repurposinglife.blogspot.com/2009/05/rainwater-harvesting.html>
 (bottom picture on right) <http://www.floridata.com/tracks/transplantedgardener/Rainbarrels.cfm>

Sizing Example for a Rain Barrel

1. Determine contributing impervious surface area:

Garage Roof (Right)	6 ft. x 24 ft.	=	144 sq ft
---------------------	----------------	---	-----------

2. Determine the amount of rainfall to be captured by the Rain Barrel. A smaller storm, no more than 2", is recommended to calculate the runoff to be captured. This example chose the 1" storm event.

3. Calculate the volume to be captured and reused:

$$(144 \text{ sq. ft.} \times 1 \text{ inch of runoff}) / 12 \text{ inches} = 12 \text{ cu. ft.}$$

4. Size the rain barrel:

1 cu. ft. = 7.48 gallons

12 cu. ft. x 7.48 = 90 gallons

90 gallons x (0.25*) = 22.5 gallons (*assuming that the rain barrel is always at least 25% full)

90 gallons + 22.5 gallons = 112 gallons

The rain barrel or barrels should be large enough hold at least 112 gallons of water.

REFERENCES:

Center for Watershed Protection and US Forest Service. (2008). *Watershed Forestry Resource Guide*. Retrieved on May 26, 2010 from <http://www.forestsforwatersheds.org/reduce-stormwater/>.

Department of Environmental Protection. (2006). *Pennsylvania Stormwater Best Management Practices Manual*.

Wissahickon Watershed Partnership. *Pennsylvania Rain Garden Guide*. Retrieved on May 4, 2010 from http://pa.audubon.org/habitat/PDFs/RGBrochure_complete.pdf.



Building a Backyard Rain Garden. North Carolina Cooperative Extension. Retrieved on May 4, 2010 from <http://www.bae.ncsu.edu/topic/raingarden/Building.htm>

Delaware County Planning Commission. (2010). *Draft Crum Creek Watershed Act 167 Stormwater Management Plan. Ordinance Appendix B. Simplified Approach to Stormwater Management for Small Projects*.

Solebury Township. (2008). *Solebury Township Stormwater Management Ordinance. "Appendix J Simplified Stormwater Management Procedures for Existing Single Family Dwelling Lots"*


APPENDIX F

CHAPTER 93 DESIGNATED USE

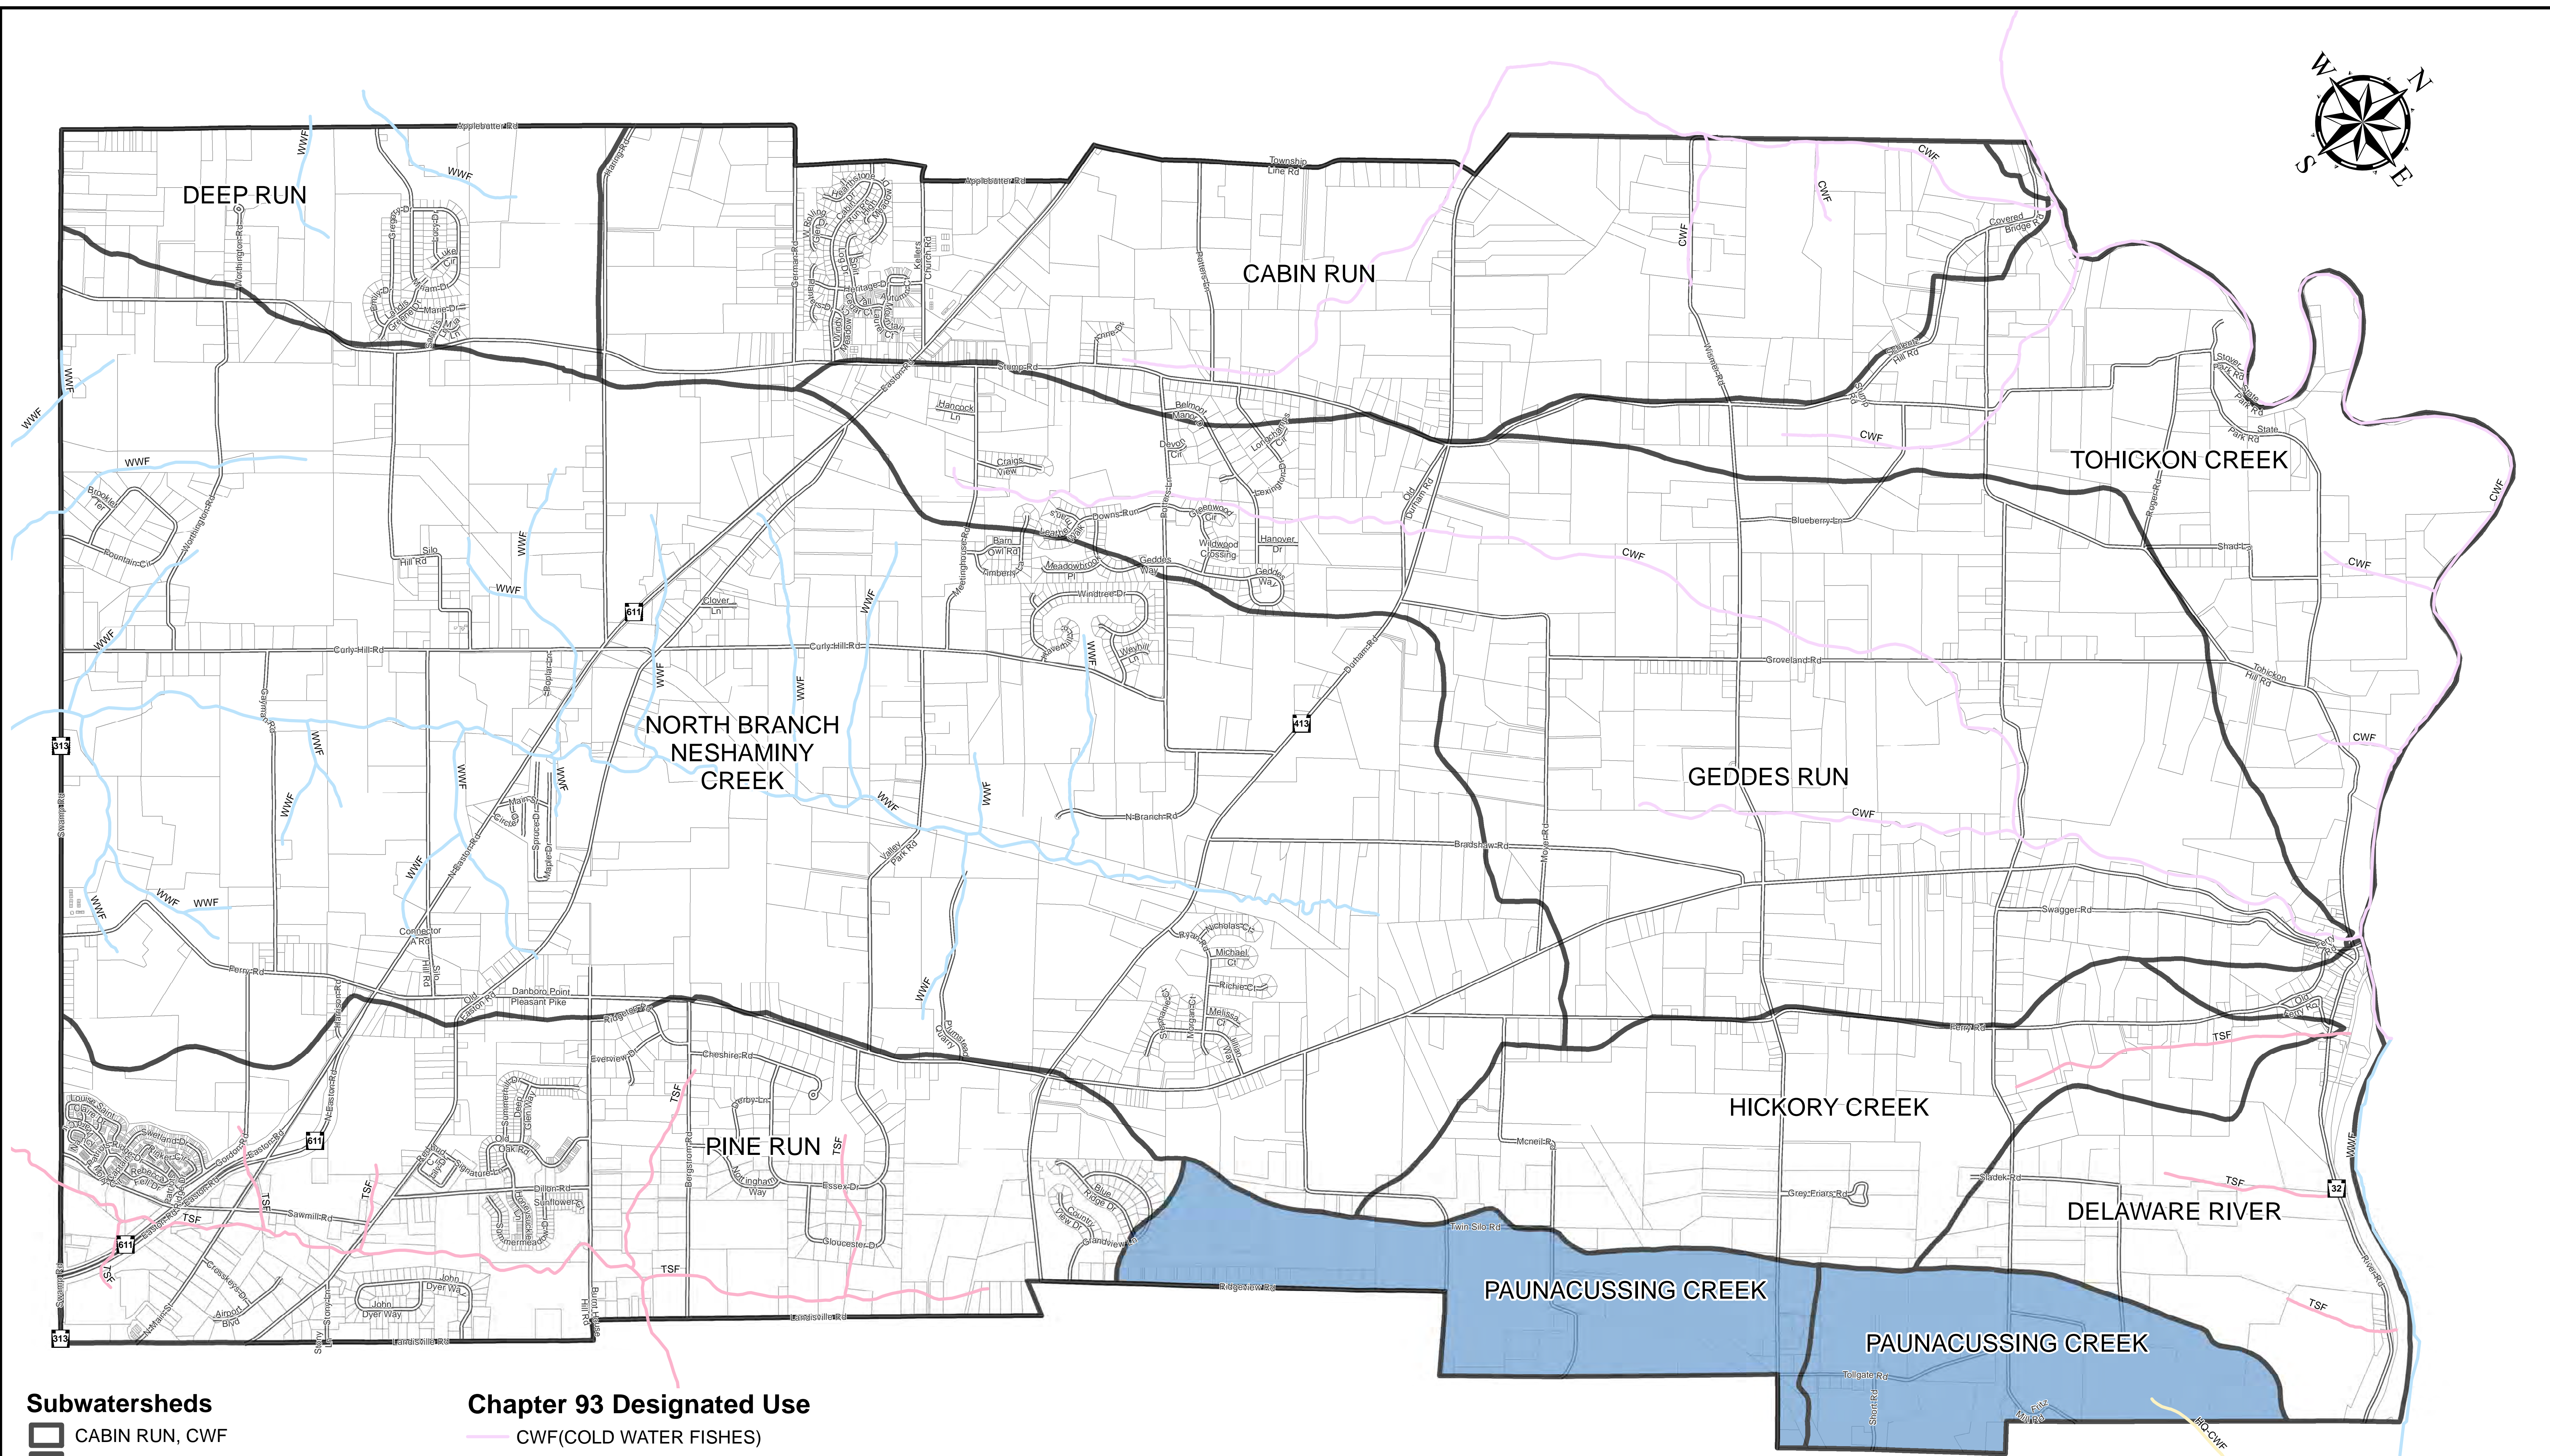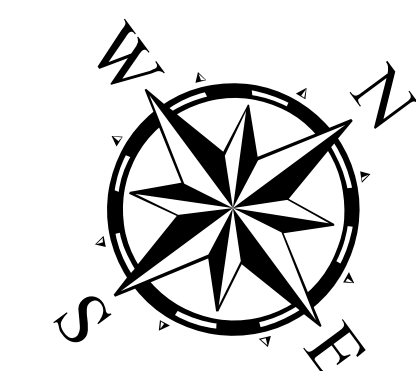

- Subwatersheds**
- CABIN RUN, CWF
 - DEEP RUN, WWF
 - DELAWARE RIVER, TSF
 - GEDDES RUN, CWF
 - HICKORY CREEK, TSF
 - NORTH BRANCH NESHAMINY CREEK, WWF
 - PAUNACUSSING CREEK, HQ-CWF
 - PINE RUN, TSF
 - TOHICKON CREEK, CWF

- Chapter 93 Designated Use**
- CWF(COLD WATER FISHES)
 - HQ-CWF(HIGH QUALITY-COLD WATER FISHES)
 - TSF(TROUT STOCKING)
 - WWF(WARM WATER FISHES)

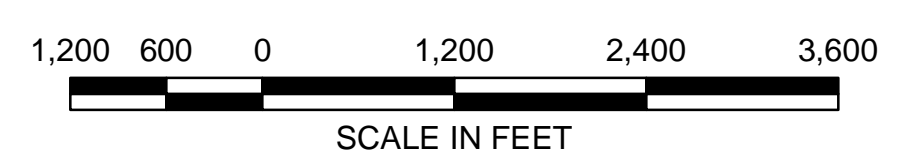


SCALE IN FEET
 Source: Pennsylvania Spatial Data Access - Chapter 93 Streams, Designated Use & Pennsylvania Small Sheds.
 Map is not intended to replace site specific investigations

PLUMSTEAD TOWNSHIP
 CHAPTER 93 DESIGNATED USE MAP

C. ROBERT WYNN ASSOCIATES, INC.
 CONSULTING ENGINEERING
 211 W. Broad Street
 Blue Bell, PA 19005
 (215) 536-2336
 DATE: 1/10/2011
 SCALE: 1" = 1200'
 SHEET NUMBER: 103-000
 OF 1

APPENDIX G

DELAWARE RIVER SOUTH, TOHICKON CREEK, AND NESHAMINY CREEK WATERSHED MANAGEMENT DISTRICT MAP

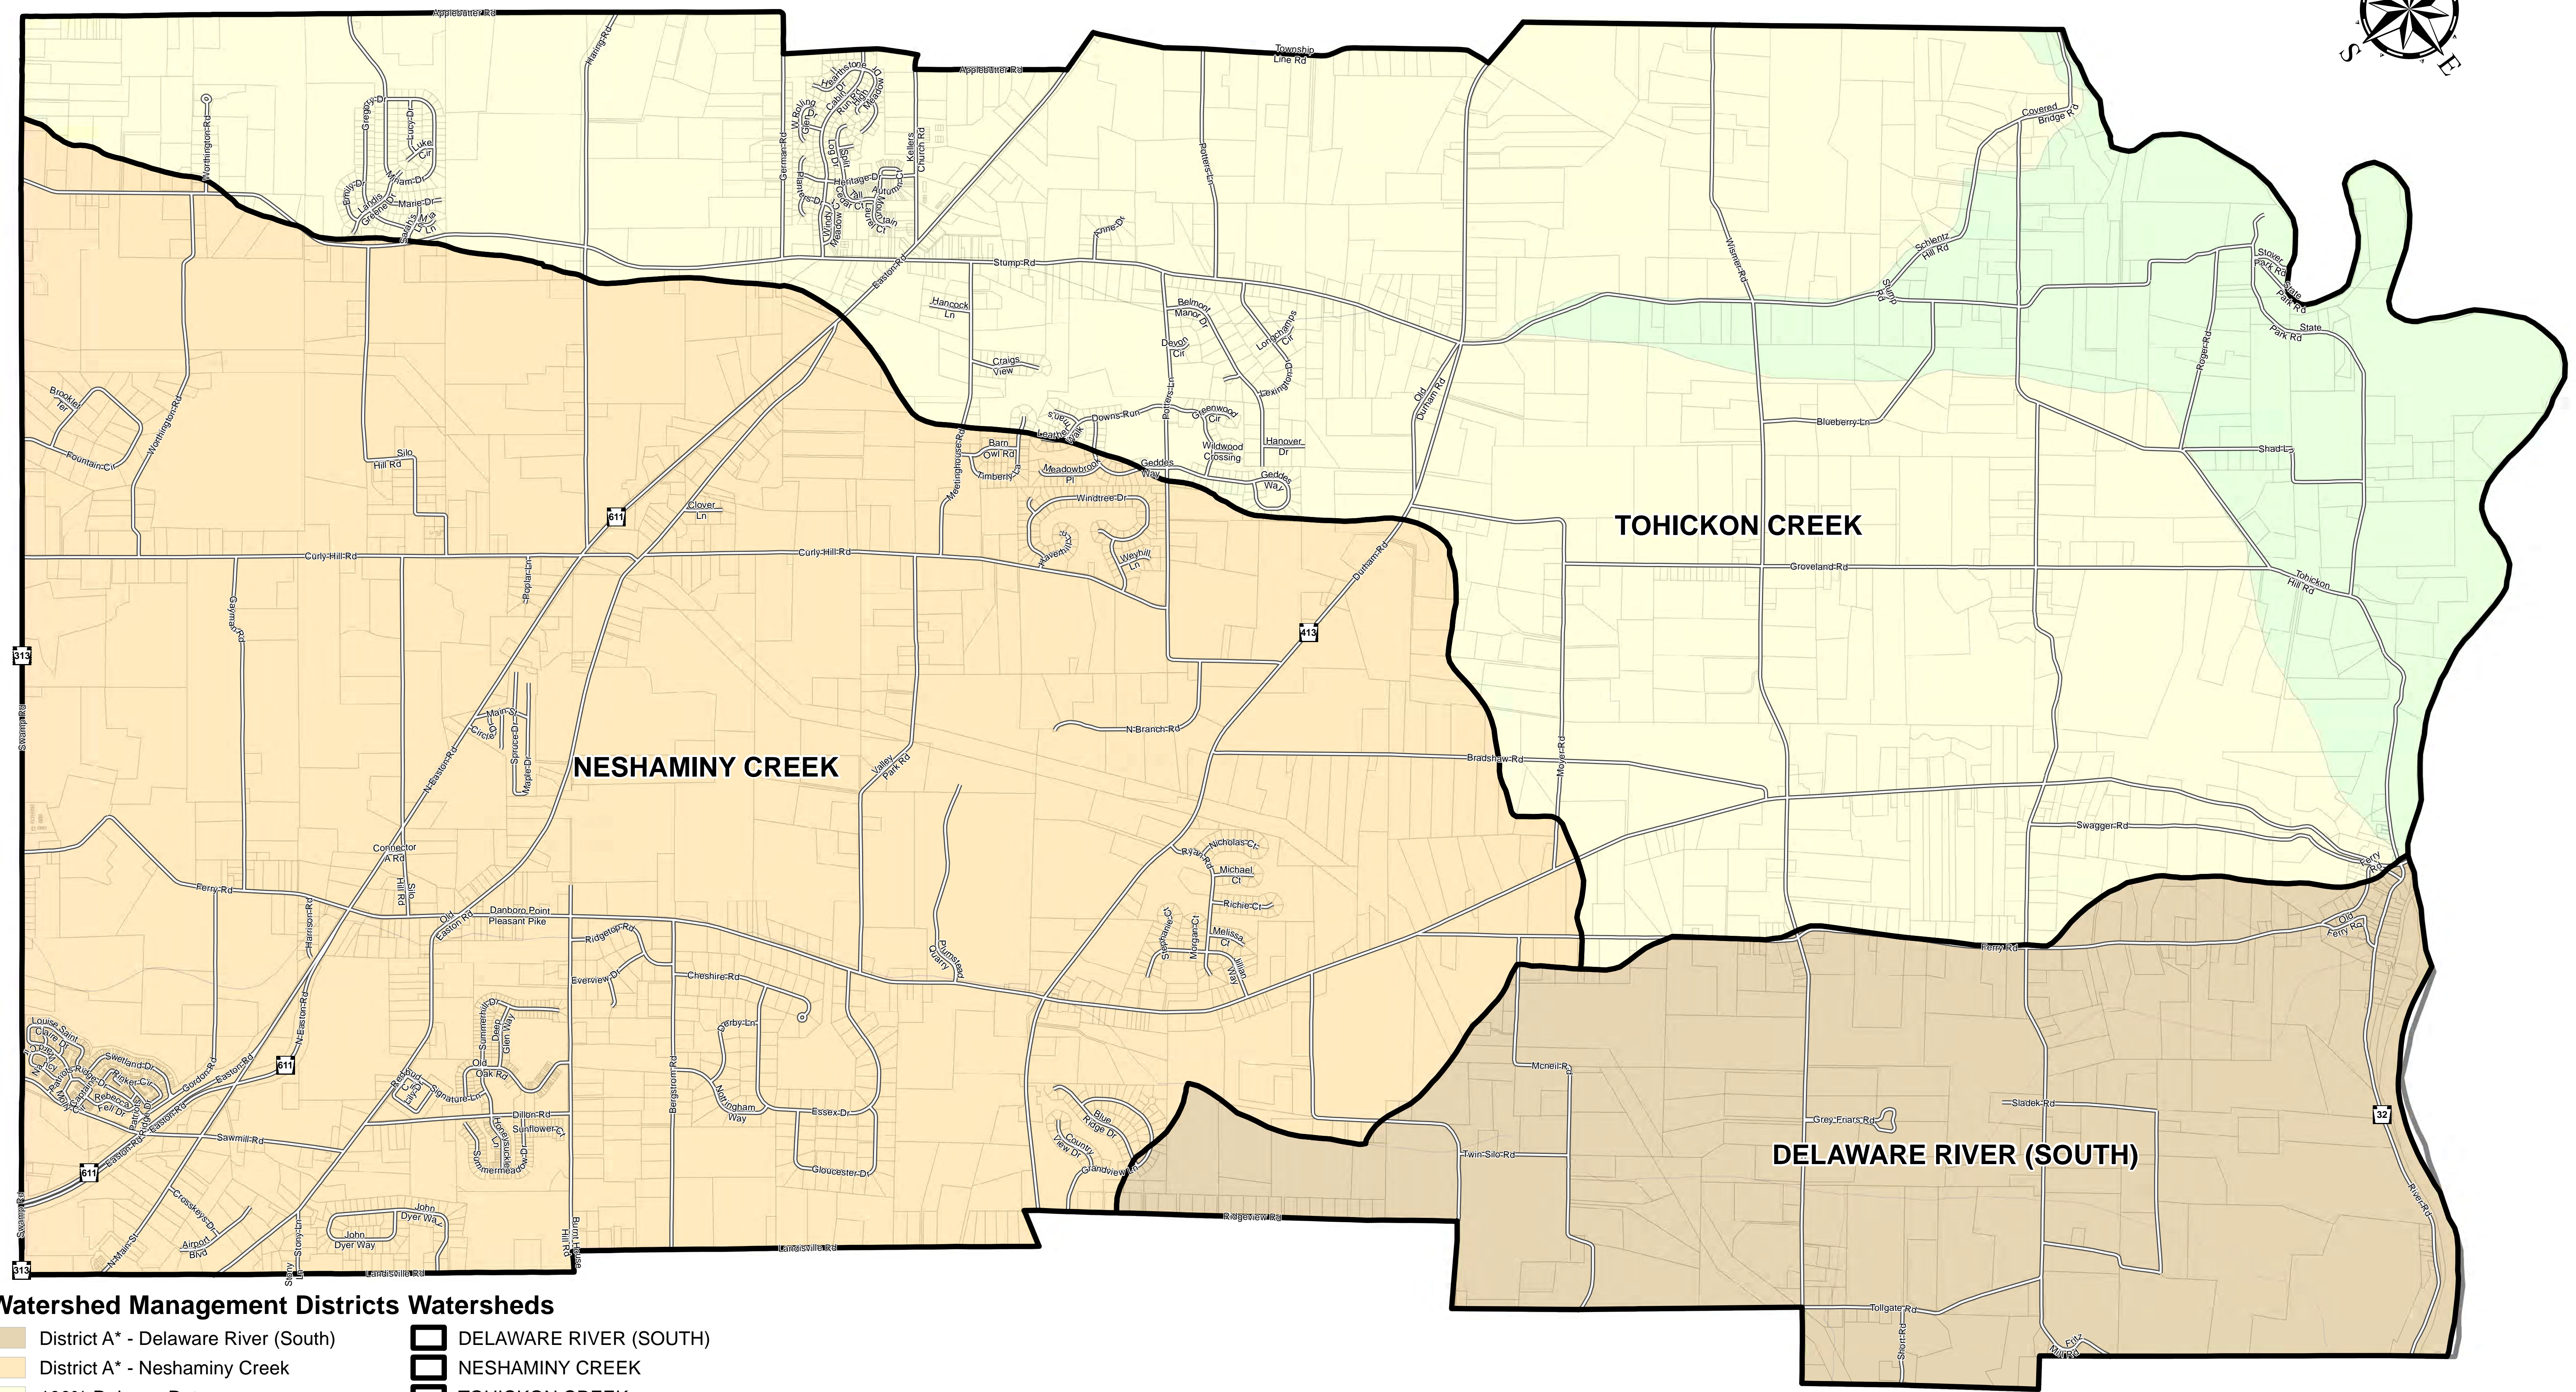


Watershed Management Districts Watersheds

- District A* - Delaware River (South)
- District A* - Neshaminy Creek
- 100% Release Rate
- Direct Discharge
- DELAWARE RIVER (SOUTH)
- NESHAMINY CREEK
- TOHICKON CREEK

*** Release Rate Requirements for District A:**

Design Storm Proposed Conditions	to	Design Storm Existing Conditions
2-year		1-year
5-year		5-year
10-year		10-year
25-year		25-year
50-year		50-year
100-year		100-year

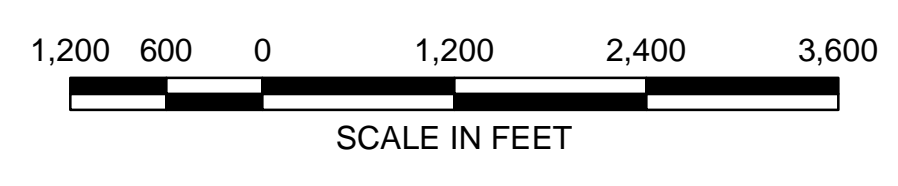

Source: Pennsylvania Spatial Data Access - Chapter 93 Streams, Designated Use & Pennsylvania Small Sheds.
Map is not intended to replace site specific investigations

**PLUMSTEAD TOWNSHIP
WATERSHED MANAGEMENT DISTRICT MAP**

C. ROBERT WYNN ASSOCIATES, INC. CONSULTING ENGINEERING 211 W. Broad Street Buckle town, PA 19051		(315) 536-2336
DWG. NO. CJG	CHK. BY CRW	DATE 1/10/2011
SCALE 1" = 1200'	JOB NUMBER 103-000	DRAWING NO. 1

APPENDIX H

HOT SPOTS

APPENDIX H: HOT SPOTS

Hot spots are sites where the land use or activity produces a higher concentration of trace metals, hydrocarbons, or priority pollutants than normally found in urban runoff.

1. EXAMPLES OF STORMWATER HOT SPOTS

- vehicle salvage yards and recycling facilities
- vehicle fueling stations
- vehicle service and maintenance facilities
- vehicle and equipment cleaning facilities
- fleet storage areas (bus, truck, etc.)
- industrial sites (based on Standard Industrial Codes defined by the U.S. Department of Labor)
- marinas (service and maintenance)
- outdoor liquid container storage
- outdoor loading/unloading facilities
- public works storage areas
- facilities that generate or store hazardous materials
- commercial container nursery
- other land uses and activities as designated by an appropriate review authority

2. LAND USE AND ACTIVITIES NOT NORMALLY CONSIDERED HOT SPOTS

- residential streets and rural highways
- residential development
- institutional development
- office developments
- nonindustrial rooftops
- pervious areas, except golf courses and nurseries (which may need an Integrated Pest Management (IPM) Plan).

- 3. LIST OF ACCEPTABLE BMPs for Hot Spot Treatment:** The following BMP's listed under the Best Management Practice column are BMPs appropriate for application on hot spot sites. BMPs which facilitate infiltration are prohibited by this ordinance. In many design manuals the BMPs with a * designation are designed with infiltration, however it is possible to design these without infiltration.

The numbers listed under the Design Reference Number column correlate with the Reference Table which lists materials that can be used for design guidance.

Best Management Practice	Design Reference Number
Bioretention*	4, 5, 11, 16
Capture/Reuse	4, 14
Constructed Wetlands	4, 5, 8, 10, 16
Dry Extended Detention Ponds	4, 5, 8, 12, 18
Best Management Practice	Design Reference Number
Minimum Disturbance/ Minimum Maintenance Practices	1, 9

Significant Reduction of Existing Impervious Cover	N/A
Stormwater Filters* (Sand, Peat, Compost, etc.)	4, 5, 10, 16
Vegetated Buffers/Filter Strips	2, 3, 5, 11, 16, 17
Vegetated Roofs	4, 13
Vegetated Swales*	2, 3, 5, 11, 16, 17
Water Quality Inlets (Oil/Water Separators, Sediment Traps/Catch Basin Sumps, and Trash/Debris Collectors in Catch Basins)	4, 7, 15, 16, 19
Wet Detention Ponds	4, 5, 6, 8

Reference Table

Number	Design Reference Title
1	"Conservation Design For Stormwater Management – A Design Approach to Reduce Stormwater Impacts From Land Development and Achieve Multiple Objectives Related to Land Use", Delaware Department of Natural Resources and Environmental Control, The Environmental Management Center of the Brandywine Conservancy, September 1997
2	"A Current Assessment of Urban Best Management Practices: Techniques for Reducing Nonpoint Source Pollution in the Coastal Zone", Schueler, T. R., Kumble, P. and Heraty, M., Metropolitan Washington Council of Governments, 1992.
3	"Design of Roadside Channels with Flexible Linings", Federal Highway Administration, Chen, Y. H. and Cotton, G. K., Hydraulic Engineering Circular 15, FHWA-IP-87-7, McLean, Virginia, 1988.
4	"Draft Stormwater Best Management Practices Manual", Pennsylvania Department of Environmental Protection, January 2005.
5	"Evaluation and Management of Highway Runoff Water Quality", Federal Highway Administration, FHWA-PD-96-032, Washington, D.C., 1996.
6	"Evaporation Maps of the United States", U.S. Weather Bureau (now NOAA/National Weather Service) Technical Paper 37, Published by Department of Commerce, Washington D.C., 1959.
7	"Georgia Stormwater Manual", AMEC Earth and Environmental, Center for Watershed Protection, Debo and Associates, Jordan Jones and Goulding, Atlanta Regional Commission, Atlanta, Georgia, 2001.
8	"Hydraulic Design of Highway Culverts", Federal Highway Administration, FHWA HDS 5, Washington, D.C., 1985 (revised May 2005).
9	"Low Impact Development Design Strategies <i>An Integrated Design Approach</i> , Prince Georges County, Maryland Department of Environmental Resources, June 1999.

Number	Design Reference Title
10	"Maryland Stormwater Design Manual", Maryland Department of the Environment, Baltimore, Maryland, 2000.
11	"Pennsylvania Handbook of Best Management Practices for Developing Areas", Pennsylvania Department of Environmental Protection, 1998.
12	"Recommended Procedures for Act 167 Drainage Plan Design", LVPC, Revised 1997.
13	"Roof Gardens History, Design, and Construction", Osmundson, Theodore. New York: W.W. Norton & Company, 1999.
14	"The Texas Manual on Rainwater Harvesting", Texas Water Development Board, Austin, Texas, Third Edition, 2005.
15	"VDOT Manual of Practice for Stormwater Management", Virginia Transportation Research Council, Charlottesville, Virginia, 2004.
16	"Virginia Stormwater Management Handbook", Virginia Department of Conservation and Recreation, Richmond, Virginia, 1999.
17	"Water Resources Engineering", Mays, L. W., John Wiley & Sons, Inc., 2005.
18	"Urban Hydrology for Small Watersheds", Technical Report 55, US Department of Agriculture, Natural Resources Conservation Service, 1986.
19	US EPA, Region 1 New England web site (as of August 2005) http://www.epa.gov/NE/assistance/ceitts/stormwater/techs/html .

4. RECOMMENDED PRE-TREATMENT METHODS FOR "HOT SPOT" LAND USES:

The following table recommends what is considered the best pre-treatment option for the listed land use. These methods are either a BMP or can be applied in conjunction with BMPs.

Hot Spot Land Use	Pre-treatment Method(s)
Vehicle Maintenance and Repair Facilities including Auto Parts Stores	-Water Quality Inlets -Use of Drip Pans and/or Dry Sweep Material Under Vehicles/Equipment -Use of Absorbent Devices to Reduce Liquid Releases -Spill Prevention and Response Program
Vehicle Fueling Stations	-Water Quality Inlets -Spill Prevention and Response Program
Storage Areas for Public Works	-Water Quality Inlets -Use of Drip Pans and/or Dry Sweep Material Under Vehicles/Equipment -Use of Absorbent Devices to Reduce Liquid Releases -Spill Prevention and Response Program -Diversion of Stormwater away from Potential Contamination Areas
Outdoor Storage of Liquids	-Spill Prevention and Response Program
Commercial Nursery Operations	-Vegetated Swales/Filter Strips -Constructed Wetlands -Stormwater Collection and Reuse

Hot Spot Land Use	Pre-treatment Method(s)
Salvage Yards and Recycling Facilities*	-BMPs that are a part of a Stormwater Pollution Prevention Plan under an NPDES Permit
Fleet Storage Yards and Vehicle Cleaning Facilities*	-BMPs that are a part of a Stormwater Pollution Prevention Plan under an NPDES Permit
Facilities that Store or Generate Regulated Substances*	-BMPs that are a part of a Stormwater Pollution Prevention Plan under an NPDES Permit
Marinas*	-BMPs that are a part of a Stormwater Pollution Prevention Plan under an NPDES Permit
Certain Industrial Uses (listed under NPDES)*	-BMPs that are a part of a Stormwater Pollution Prevention Plan under an NPDES Permit

*Regulated under the NPDES Stormwater Program

APPENDIX I

WEST NILE VIRUS GUIDANCE

APPENDIX I: WEST NILE VIRUS GUIDANCE

(This source is from the Monroe County, PA Conservation District, who researched the potential of West Nile Virus problems from BMPs due to a number of calls they were receiving.)

Monroe County Conservation District Guidance: Stormwater Management and West Nile Virus

Source: Brodhead McMichaels Creeks Watershed Act 167 Stormwater Management Ordinance Final Draft 2/23/04

The Monroe County Conservation District recognizes the need to address the problem of nonpoint source pollution impacts caused by runoff from impervious surfaces. The new stormwater policy being integrated into Act 167 Stormwater Management regulations by the PA Department of Environmental Protection (PADEP) will make nonpoint pollution controls an important component of all future plans and updates to existing plans. In addition, to meet post-construction anti-degradation standards under the state National Pollution Discharge Elimination System (NPDES) permitting program, applicants will be required to employ Best Management Practices (BMPs) to address non-point pollution concerns.

Studies conducted throughout the United States have shown that wet basins and in particular constructed wetlands are effective in traditional stormwater management areas such as channel stability and flood control, and are one of the most effective ways to remove stormwater pollutants (United States Environmental Protection Agency 1991, Center for Watershed Protection 2000). From Maryland to Oregon, studies have shown that as urbanization and impervious surface increase in a watershed, the streams in those watersheds become degraded (CWP 2000). Although there is debate over the threshold of impervious cover when degradation becomes apparent (some studies show as little as 6% while others show closer to 20%), there is agreement that impervious surfaces cause non-point pollution in urban and urbanizing watersheds, and that degradation is ensured if stormwater BMPs are not implemented.

Although constructed wetlands and ponds are desirable from a water quality perspective there may be concerns about the possibility of these stormwater management structures becoming breeding grounds for mosquitoes. The Conservation District feels that although it may be a valid concern, **municipalities should not adopt ordinance provisions prohibiting wet basins for stormwater management.**

Mosquitoes

The questions surrounding mosquito production in wetlands and ponds have intensified in recent years by the outbreak of the mosquito-borne West Nile Virus. As is the case with all vector-borne maladies, the life cycle of West Nile Virus is complicated, traveling from mosquito to bird, back to mosquito and then to other animals including humans. *Culex pipiens* was identified as the vector species in the first documented cases from New York in 1999. This species is still considered the primary transmitter of the disease across its range. Today there are some 60 species of mosquitoes that inhabit Pennsylvania. Along with *C. pipiens*, three other species have been identified as vectors of West Nile Virus while four more have been identified as potential vectors.

The four known vectors in NE Pennsylvania are *Culex pipiens*, *C. restuans*, *C. salinarius* and *Ochlerotatus japonicus*. All four of these species prefer, and almost exclusively use, artificial

containers (old tires, rain gutters, birdbaths, etc.) as larval habitats. In the case of *C. pipiens*, the most notorious of the vector mosquitoes, the dirtier the water the better they like it. The important factor is that these species do not thrive in functioning wetlands where competition for resources and predation by larger aquatic and terrestrial organisms is high.

The remaining four species, *Aedes vexans*, *Ochlerotatus Canadensis*, *O. triseriatus* and *O. trivittatus* are currently considered potential vectors due to laboratory tests (except the *O. trivittatus*, which did have one confirmed vector pool for West Nile Virus in PA during 2002). All four of these species prefer vernal habitats and ponded woodland areas following heavy summer rains. These species may be the greatest threat of disease transmission around stormwater basins that pond water for more than four days. This can be mitigated however by establishing ecologically functioning wetlands.

Stormwater Facilities

If a stormwater wetland or pond is constructed properly and a diverse ecological community develops, mosquitoes should not become a problem. Wet basins and wetlands constructed as stormwater management facilities, should be designed to attract a diverse wildlife community. If a wetland is planned, proper hydrologic soil conditions and the establishment of hydrophytic vegetation will promote the population of the wetland by amphibians and other mosquito predators. In natural wetlands, predatory insects and amphibians are effective at keeping mosquito populations in check during the larval stage of development while birds and bats prey on adult mosquitoes.

The design of a stormwater wetland must include the selection of hydrophytic plant species for their pollutant uptake capabilities and for not contributing to the potential for vector mosquito breeding. In particular, species of emergent vegetation with little submerged growth are preferable. By limiting the vegetation growing below the water surface, larvae lose protective cover and there is less chance of anaerobic conditions occurring in the water.

Stormwater ponds can be designed for multiple purposes. When incorporated into an open space design a pond can serve as a stormwater management facility and a community amenity. Aeration fountains and stocked fish should be added to keep larval mosquito populations in check.

Publications from the PA Department of Health and the Penn State Cooperative Extension concerning West Nile Virus identify aggressive public education about the risks posed by standing water in artificial containers (tires, trash cans, rain gutters, bird baths) as the most effective method to control vector mosquitoes.

Conclusion

The Conservation District understands the pressure faced by municipalities when dealing with multifaceted issues such as stormwater management and encourages the incorporation of water quality management techniques into stormwater designs. As Monroe County continues to grow, conservation design, groundwater recharge and constructed wetlands and ponds should be among the preferred design options to reduce the impacts of increases in impervious surfaces. When designed and constructed appropriately, the runoff mitigation benefits to the community from these design options will far out-weigh their potential to become breeding grounds for mosquitoes.

APPENDIX J

SIMPLIFIED STORMWATER MANAGEMENT PROCEDURES FOR EXISTING SINGLE FAMILY DWELLING LOTS

**SIMPLIFIED STORMWATER MANAGEMENT PROCEDURES
FOR EXISTING SINGLE FAMILY DWELLING LOTS**

Projects eligible for this procedure

Individual home construction projects on single family lots which result in less than two thousand five hundred (2,500) square feet of new impervious area (including the building footprint, driveway, sidewalks, and parking areas) and less than five thousand (5,000) square feet of earth disturbance may utilize the simplified procedure contained in this Appendix to meet volume requirements of this Part and are not required to submit detailed stormwater management plans as required by Article IV to the Township. This procedure may not be utilized for proposed subdivisions or land developments.

Are professional services necessary to meet these requirements?

This Appendix has been developed to assist the individual homeowner in meeting the water quality and groundwater recharge goals of the Stormwater Management Ordinance. If the guidelines are followed, the homeowner will not require professional services to comply with these water quality and groundwater recharge goals.

What do I need to submit to Plumstead Township?

Even though a formal stormwater management plan is not required for individual lot owners, a brief description of the proposed infiltration facilities, including types of material to be used, total impervious areas and volume calculations, and a simple sketch plan showing the following information shall be submitted to the Township prior to construction:

- Location of proposed structures, driveways or other paved areas with approximate surface area in square feet.
- Location of any existing or proposed onsite septic system and/or potable water wells showing proximity to infiltration facilities.
- Bucks County Conservation District erosion and sediment control “Adequacy” letter.

Determination of Recharge Volume

The amount of recharge volume that must be provided is determined by following the simple steps below. Impervious area calculations must include all areas on the lot proposed to be covered by roof area or pavement which would prevent rain from naturally percolating into the ground, including sidewalks, driveways or parking areas. Sidewalks, driveways or patios that are constructed with turf pavers are not included in this calculation.

Example Recharge Volume:

STEP 1 – Determine Total Impervious Surfaces:

House Roof (Front)	12 ft. x 48 ft.	=	576 sq. ft.
House Roof (Rear)	12 ft. x 48 ft.	=	576 sq. ft.
Driveway	12 ft. x 50 ft.	=	600 sq. ft.
Parking Pad	12 ft. x 12 ft.	=	144 sq. ft.
Walkway	4 ft. x 20 ft.	=	80 sq. ft.

			1,976 sq. ft.

STEP 2 – Determine Required Infiltration Volume (Rv) Using the Following Equation

$$Rv = \frac{2.04 \text{ inches} \times (\text{total impervious area in square feet})}{12} = \text{_____ cubic feet of recharge}$$

$$Rv = \frac{2.04 \times 1,976 \text{ sq. ft.}}{12} = 336 \text{ cu. ft.}$$


STEP 3 – Sizing of Selected Infiltration Method

The following pages identify several methods to infiltrate stormwater runoff. Their appropriateness depends on the amount of required infiltration volume and amount of available land. More than one method may be implemented on a site, depending on site constraints. Dry wells may be used only for receiving runoff from roof drains. Infiltration trenches are appropriate for receiving runoff from driveways, sidewalk or parking areas. Other methods may be appropriate, but these must be reviewed with the Township Engineer prior to installation.

Dry Wells

Dry wells are effective methods to infiltrate runoff from roof leaders. These facilities must be located based upon a determination by the design professional to reduce potential basement seepage problems but not less than a minimum of twenty (20) feet from the building foundation. A dry well may be either a structural prefabricated chamber or an excavated pit filled with aggregate. Dry well shall not be constructed until all other areas of the site are stabilized, to avoid clogging. During construction, compaction of the subgrade soil shall be avoided, and construction may be performed with only light machinery. Depth of dry wells in excess of three and one-half (3 ½) feet should be avoided unless warranted by soil conditions. “Clean” gravel fill should average one and one half to three (1.5 – 3.0) inches in diameter. Dry wells should be inspected at least four (4) times annually as well as after large storm events.

**FIGURE 1
TYPICAL DRY WELL CONFIGURATION**

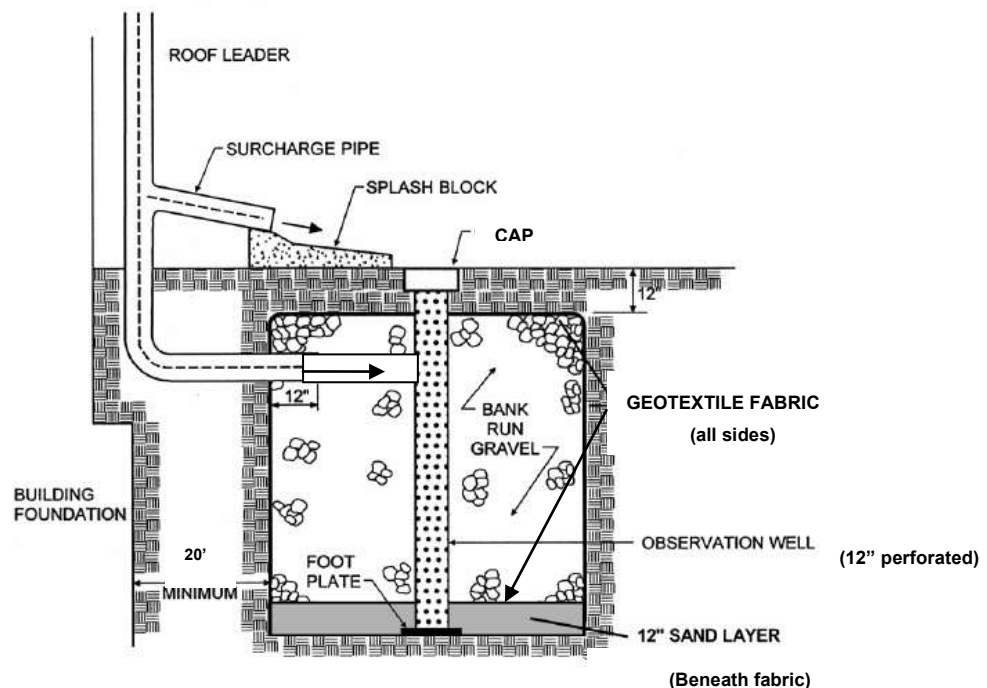

Source: Maryland Stormwater Design Manual

Example Sizing For Drywells:

STEP 1 – Determine Total Impervious Surfaces

House Roof Area: 12 ft. x 48 ft. = 576 sq. ft.

STEP 2 – Determine Required Infiltration Volume using Equation

$$\frac{2.04 \text{ in.} \times 576 \text{ sq. ft.}}{12} = 98 \text{ cu. ft.}$$

$$\frac{98 \text{ cu. ft.}}{0.4^*} = 245 \text{ cu. ft. (*assumes 40% void ratio in gravel bed)}$$

STEP 3 – Sizing of Selected Infiltration Method

Volume of facility = Depth x Width x Length

Set D = 3.5 ft; Set W = L for a square chamber


$$245 \text{ cu. ft.} = 3.5 \times L \times L ; L = 8.4 \text{ ft.}$$

Final Facility Dimensions: 3.5 ft. (D) x 8.4 ft. (W) x 8.4 ft. (L)

Infiltration Trenches

An infiltration trench is a long, narrow, rock-filled trench with no outlet that receives stormwater runoff. Runoff is stored in the void space between the stones and infiltrates through the bottom and into the soil matrix. Infiltration trenches perform well for removal of fine sediment and associated pollutants. Pretreatment using buffer strips, swales, or detention basins is important for limiting amounts of coarse sediment entering the trench which can clog and render the trench ineffective.

**FIGURE 2
TYPICAL INFILTRATION TRENCH CONFIGURATION**

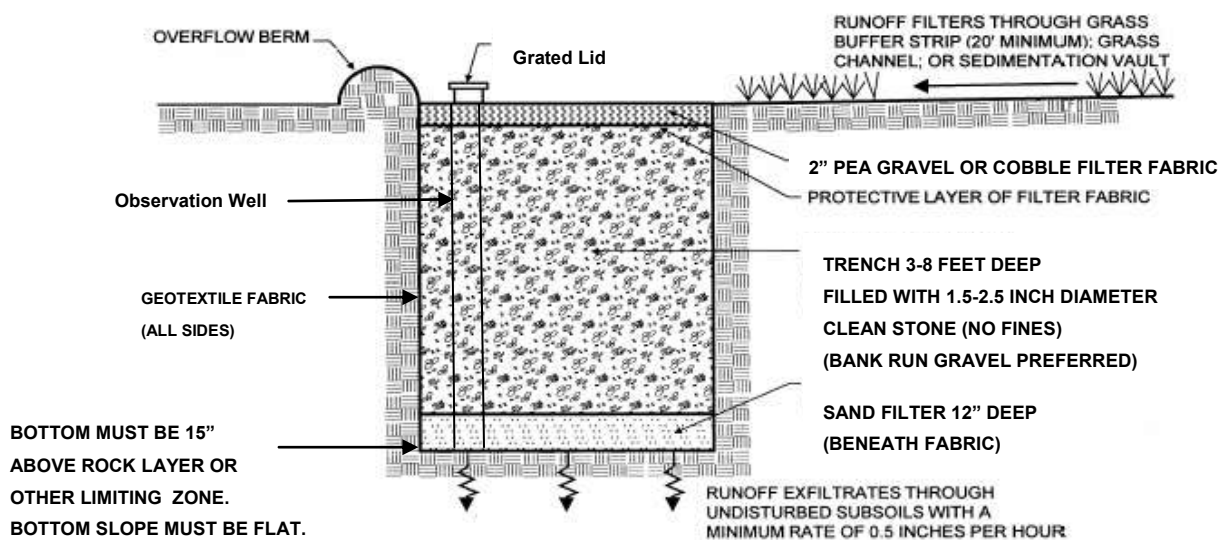

Source: Maryland Stormwater Design Manual, 2000

Example Sizing For Infiltration Trenches:

STEP 1 – Determine Total Impervious Surfaces

Driveway	12 ft. x 50 ft.	=	600 sq. ft.
Parking Pad	12 ft. x 12 ft.	=	144 sq. ft.
Walkway	4 ft. x 20 ft.	=	80 sq. ft.

			824 sq. ft.

STEP 2 – Determine Required Infiltration Volume using Equation

$$\frac{2.04 \text{ in.} \times 824 \text{ sq. ft.}}{12} = 140 \text{ cu. ft.}$$

$$\frac{140 \text{ cu. ft.}}{0.4^*} = 350 \text{ cu. ft. (*assumes 40% void ratio in gravel bed)}$$

STEP 3 – Sizing of Selected Infiltration Method

Volume of facility = Depth x Width x Length

Set D = 3 ft; determine required surface area of trench

$$350 \text{ cu. ft.} / 3 \text{ ft.} = 117 \text{ sq. ft.}$$

The width of the trench should be greater than 2 times its depth (2 x D); therefore, in this example a trench width of 6 feet is selected;

$$\text{Determine trench length: } L = 117 \text{ sq. ft.} / 6 \text{ ft.} = 20 \text{ ft.}$$

Final trench dimensions: 3 ft. (D) x 6 ft. (W) x 20 ft. (L)

Rain Gardens

A Rain Garden is a planted shallow depression designed to catch and filter rainfall runoff. The garden captures rain from a downspout or a paved surface. The water sinks into the ground, aided by deep rooted plants that like both wet and dry conditions. The ideal location for a rain garden is between the source of runoff (roofs and driveways) and the runoff destination (drains, stream, low spots, etc).

Design Considerations:


- A maximum of 3:1 side slope is recommended.
- The depth of a rain garden can range from 6 - 8 inches. Ponded water should not exceed 6 inches.
- The rain garden should drain within 72 hours.
- The garden should be at least 10-20 feet from a building's foundation and 25 feet from septic system drainfields and wellheads.
- If the site has clay soils, soil should be amended with compost or organic material.
- Choose native plants. See http://pa.audubon.org/habitat/PDFs/RGBrochure_complete.pdf for a native plant list. To find native plant sources go to www.pawildflower.org.

- At the rain garden location, the water table should be at least 2' below the soil level. If water stands in an area for more than one day after a heavy rain you can assume it has a higher water table and is not a good choice for a rain garden.

Maintenance:

- Water plants regularly until they become established.
- Inspect twice a year for sediment buildup, erosion and vegetative conditions.
- Mulch with hardwood when erosion is evident and replenish annually.
- Prune and remove dead vegetation in the spring season.
- Weed as you would any garden.
- Move plants around if some plants would grow better in the drier or wetter parts of the garden.

Figure 3: Rain Garden Diagram

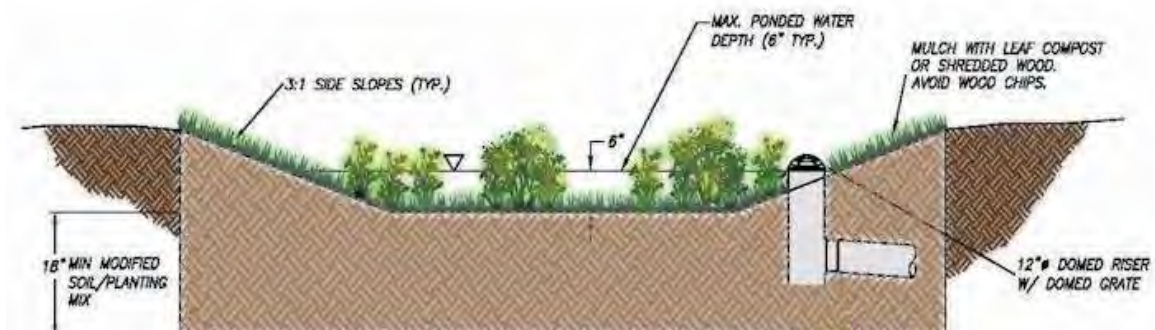

Source: PA BMP Guidance Manual, Chapter 6 Page 50

Sizing Example for Rain Garden

1. Pick a site for the rain garden between the source of runoff and between a low lying area, a.k.a., a drainage area.
2. Perform an infiltration test to determine the depth of the rain garden:
 - Dig a hole 8" x 8"
 - Fill with water and put a popsicle stick at the top of the water level.
 - Measure how far it drains down after a few hours (ideally 4).
 - Calculate the depth of water that will drain out over 24 hours.
3. Determine total impervious surface area to drain to rain garden:

House Roof (Front)	14 ft. x 48 ft.	=	672 sq ft
--------------------	-----------------	---	-----------

4. Sizing the rain garden:

For this example the infiltration test determined 6" of water drained out of a hole in 24 hours. The depth of the rain garden should be set to the results of the infiltration test so 6" is the depth of the rain garden. The sizing calculation below is based on controlling 1" of runoff. First divide the impervious surface by the depth of the rain garden.

$$(672 \text{ sq ft} / 6 \text{ ft.}) = 112 \text{ sq. ft.}$$

In order to control 2" of runoff volume, the rain garden area needs to be multiplied by 2.

$$112 \text{ sq. ft.} * 2 = 224 \text{ sq. ft.}$$


The rain garden should be about 225 sq. ft. in size and 6" deep.

Field Conditions/Construction

Construction of the stormwater management facility must be observed by the Township Engineer pursuant to Section 26-141 of this Part. If soil conditions indicate a limiting zone (e.g. high water table, depth to bedrock) will encroach within the infiltration/dry well, the stormwater management facility construction details (width/depth/length) must be be revised as determined by the Township Engineer and field documented.

FIGURE 4

SAMPLE SITE SKETCH PLAN

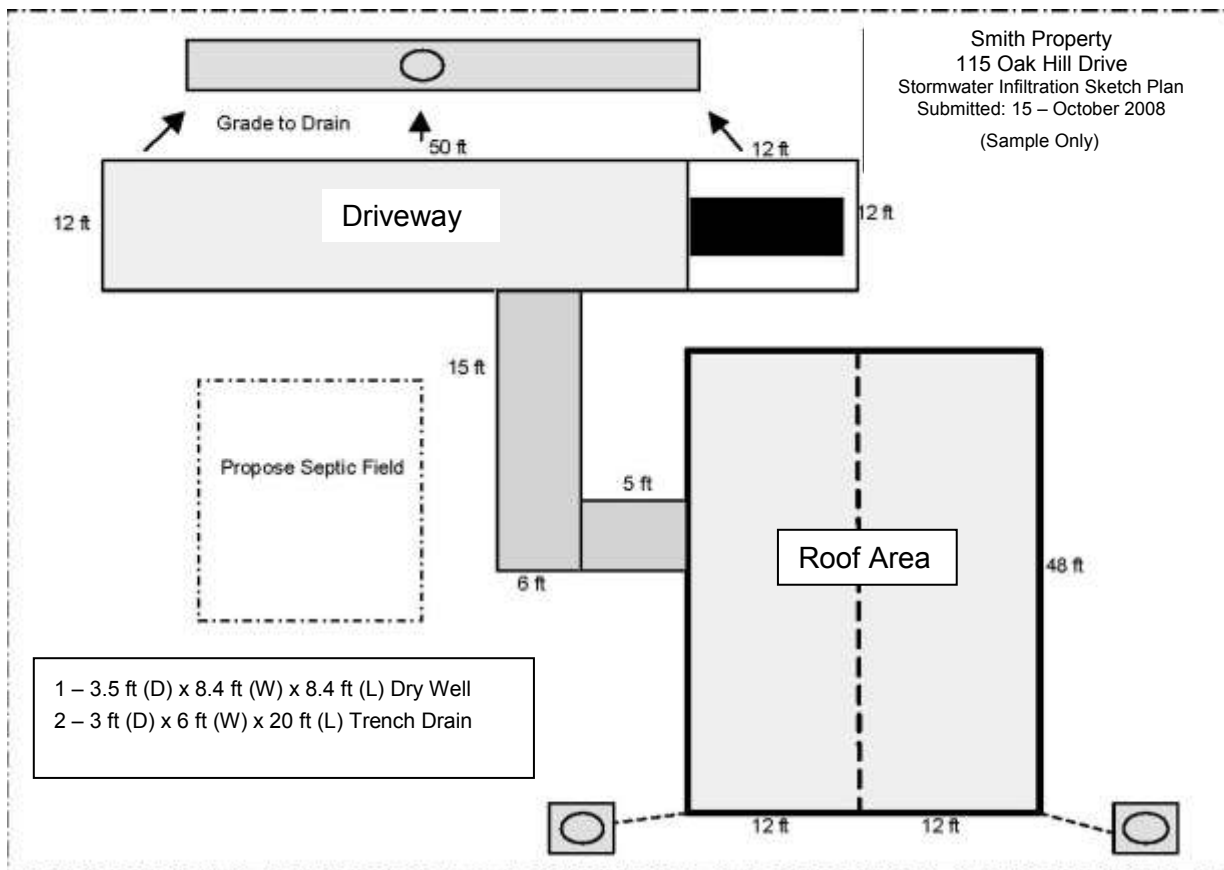

APPENDIX K

STANDARD STORMWATER FACILITIES MAINTENANCE AND MONITORING AGREEMENT

**STANDARD STORMWATER FACILITIES MAINTENANCE AND MONITORING
AGREEMENT**

THIS AGREEMENT, made and entered into this _____ day of _____, 20__, by and between _____, (hereinafter the "Landowner"), and Plumstead Township, Bucks County; Pennsylvania, (hereinafter "Municipality");

WITNESSETH

WHEREAS, the Landowner is the owner of certain real property (TMP # _____) as recorded by deed in the land records of Bucks County, Pennsylvania, Deed Book _____ at Page _____, (hereinafter "Property").

WHEREAS, the Landowner is proceeding to build and develop the Property; and

WHEREAS, the Stormwater Controls and BMP Operation and Maintenance Plan (hereinafter "Plan") for the property identified herein, as approved or to be approved by the Municipality, provides for management of stormwater within the confines of the Property through the use of Best Management Practices (BMPs); and

WHEREAS, the Municipality and the Landowner, his successors and assigns agree that the health, safety, and welfare of the residents of the Municipality require that on-site stormwater management facilities be constructed and maintained on the Property: and

WHEREAS, for the purposes of this agreement, the following definitions shall apply:

BMP - "Best Management Practice;" activities, facilities, designs, measures or procedures used to manage stormwater impacts from land development, to protect and maintain water quality and groundwater recharge and to otherwise meet the purposes of the Municipal Stormwater Management Ordinance, including, but not limited to, infiltration trenches, seepage pits, filter strips, bioretention, wet ponds, permeable paving, rain gardens, grassed swales, forested buffers, sand filters, and detention basins.

WHEREAS, the Municipality requires, through the implementation of the plan that stormwater management facilities BMPs as required by the Plan and Municipal Stormwater Management Ordinance be constructed and adequately operated and maintained by the Landowner, his successors and assigns.

NOW, THEREFORE, in consideration of the foregoing premises, the mutual covenants contained herein, and the following terms and conditions, the parties hereto agree as follows:

- 1. The BMPs shall be constructed by the Landowner, his successors and assigns, in accordance with the terms, conditions and specifications identified in the Plan.**
- 2. The Landowner, his successors and assigns, shall operate and maintain the BMPs as shown on the plan in good working condition, acceptable to the Municipality so that they are performing their design functions, and in accordance with the specific maintenance requirements noted on the plan.**
- 3. The Landowner, his successors and assigns, hereby grants permission to the Municipality, his authorized agents and employees, to enter upon the Property at reasonable times, such as following a storm of the intensity for which the facility was designed to control, and to inspect the stormwater management facilities whenever the Municipality deems necessary. The purpose of the inspection is to ensure safe and proper functioning of the facilities. The inspection shall cover the entire facilities, berms, outlet structures, pond areas, access roads, etc. When inspections are conducted, the Municipality shall give the Landowner, his successors and assigns, copies of the inspection report with findings and evaluations. At a minimum, maintenance inspections shall be performed in accordance with the following schedule:**
 - Twelve (12) months after completion of the facility and acceptance by the Township,**
 - At least once every three (3) years thereafter, and**
 - During or immediately upon the cessation of a 100-year or greater precipitation event.**
- 4. All reasonable costs for said inspections shall be borne by the Landowner and payable to the Municipality.**
- 5. The owner shall convey to the municipality easements and/or rights-of-way to ensure access for periodic inspections by the Municipality and maintenance, if required.**
- 6. In the event the Landowner, his successors and assigns, fails to maintain the BMPs in good working condition acceptable to the Municipality, the Municipality may enter upon the property and take such necessary and prudent action to maintain said stormwater management facilities and to charge the costs of the maintenance and/or repairs to the Landowner, his successors and assigns. This provision shall not be construed as to allow the Municipality to erect any structure of a permanent nature on the land of the Landowner, outside of any easement belonging to the Municipality. It is expressly understood and agreed that the Municipality is under no obligation to maintain or repair said facilities, and in no event shall this Agreement be construed to impose any such obligation on the Municipality.**

7. The Landowner, his successors and assigns, will perform maintenance in accordance with the maintenance schedule for the stormwater management facilities including sediment removal as outlined on the approved schedule and/or drainage plan.
8. In the event the Municipality, pursuant to this Agreement, performs work of any nature, or expends any funds in performance of said work for labor, use of equipment, supplies, materials, and the like on account of the Landowner's or his successors' and assigns' failure to perform such work, the Landowner, his successors and assigns, shall reimburse the Municipality upon demand, within 30 days of receipt of invoice thereof, for all costs incurred by the Municipality hereunder. If not paid within said 30-day period, the Municipality may enter a lien against the property in the amount of such costs, or may proceed to recover his costs through proceedings in equity or at law as authorized under the provisions of the Second Class Township Code.
9. The Landowner, his successors and assigns, shall indemnify the Municipality and its agents and employees against any and all damages, accidents, casualties, occurrences or claims that might arise or be asserted against the Municipality for the construction, presence, existence or maintenance of the stormwater management facilities by the Landowner and his successors and assigns.
10. In the event a claim is asserted against the Municipality, its agents, or employees, the Municipality shall promptly notify the Landowner and his successors and assigns, and they shall defend, at their own expense, any suit based on such claim. If any judgment or claims against the Municipality, his agents or employees shall be allowed, the Landowner and his successors and assigns shall pay all costs and expenses in connection therewith.
11. In the advent of an emergency or the occurrence of special or unusual circumstances or situations, the Municipality may enter the property, if the Landowner is not immediately available, without notification or identification, to inspect and perform necessary maintenance and repairs, if needed, when the health, safety or welfare of the citizens is at jeopardy. However, the Municipality shall notify the Landowner of any inspection, maintenance, or repair undertaken within five days of the activity. The Landowner shall reimburse the Municipality for its costs.

This Agreement shall be recorded among the land records of Bucks County, Pennsylvania and shall constitute a covenant running with the Property and/or equitable servitude, and shall be binding on the Landowner, his administrators, executors, assigns, heirs, and any other successors in interests, in perpetuity.

ATTEST:

WITNESS the following signatures and seals:

(SEAL) For the Municipality:

(SEAL) For the Landowner:

ATTEST:

County of Bucks, Pennsylvania

I, _____, a Notary Public in and for the
County and State aforesaid, whose commission expires on the _____
day of _____, 20__, do hereby certify that
_____ whose name(s) is/are signed
to the foregoing Agreement bearing date of the _____ day of
_____, 20__, has acknowledged the same before me in my
said county and state.


GIVEN UNDER MY HAND THIS _____ day of
_____, 20__.

NOTARY PUBLIC

(SEAL)

APPENDIX L

STORMSEWER BEDDING/BACKFILL REQUIREMENTS

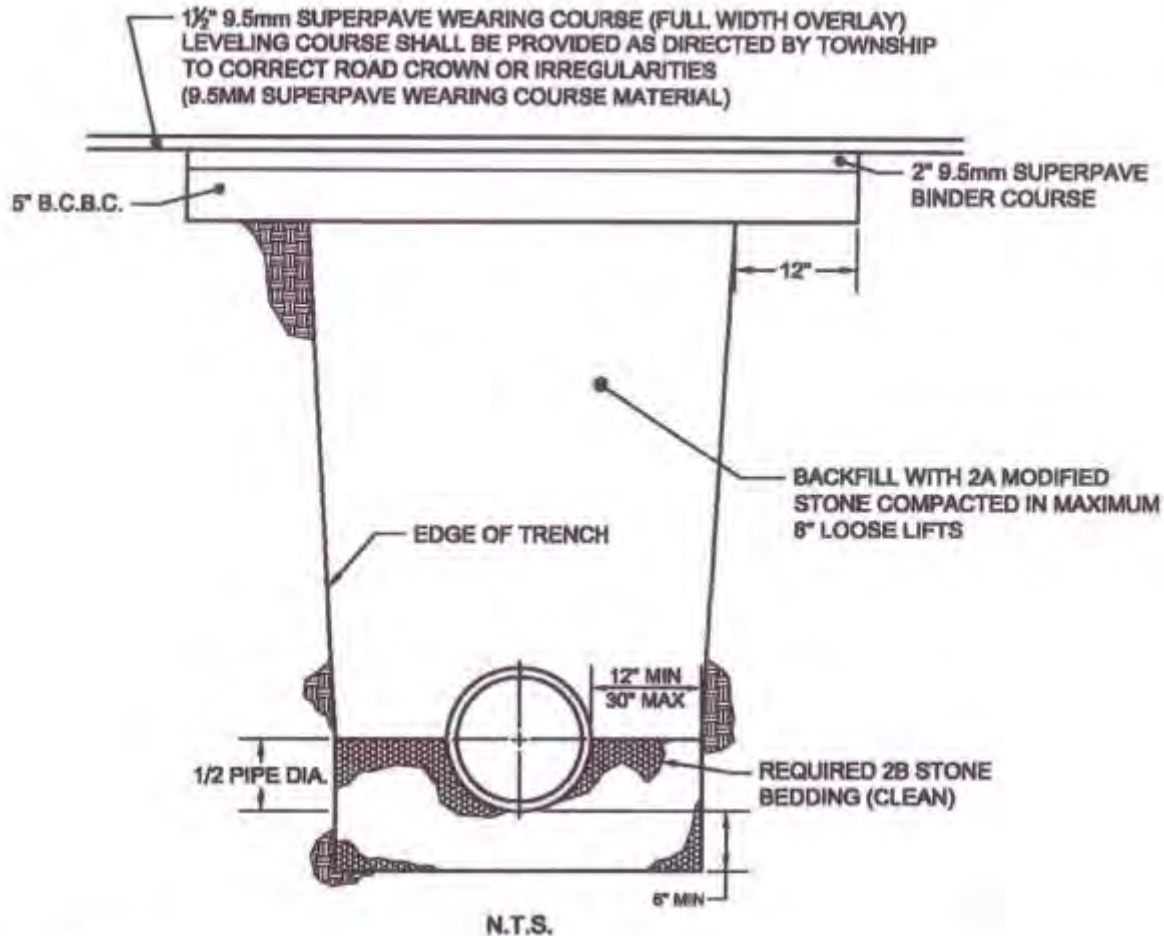


NOTES:

1. Developer/Contractor shall be responsible for proper implementation of safety requirements in conformance to all Federal and State Department of Labor and Occupational Safety and Hazard Administrative Regulations.
2. Backfill for new road construction may be select earth backfill when suitable material is available as determined by the Township.
3. Full depth 2A stone backfill shall be required for all storm sewer, sanitary sewer and utility trenching when edge of trench is within 15 feet of existing roadway edge of paving; and for all trenching within area of roadway widening.
4. Roadway crown shall be 3/8 inch per foot.
5. 3 inch temporary patch of BCBC shall be provided and maintained for less than 30 days prior to final restoration of existing roadway or driveway. Temporary patch shall be removed with final restoration performed no more than 90 days from date of sewer installation providing testing has been satisfactorily accomplished and no settlement has occurred.
6. All work and materials shall conform to PennDot Publication 408, latest edition.

STORM SEWER BEDDING DETAIL

(WITHIN RIGHT-OF-WAY, BENEATH ALL EXISTING ROADWAYS AND DRIVEWAYS, PUBLIC OR PRIVATE)

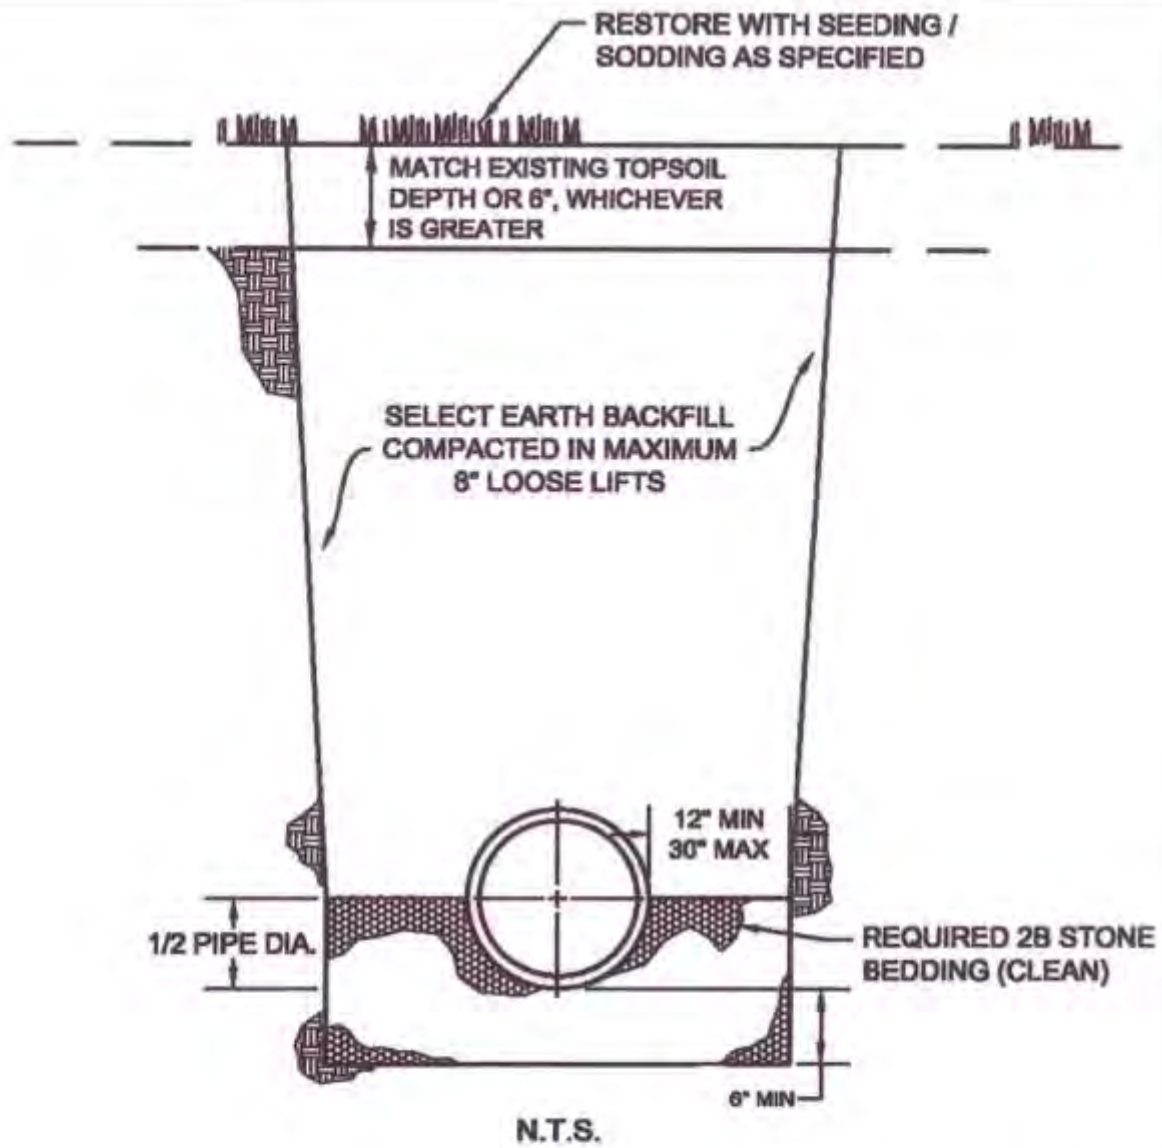

STORM SEWER BEDDING DETAIL

(EARTHEN AREA)

APPENDIX M

PERVIOUS HARDSCAPING DESIGN AND CREDIT CRITERIA

**PERVIOUS HARDSCAPING SYSTEM DESIGN &
IMPERVIOUS SURFACE AREA CREDIT CRITERIA**

Applicants for Erosion and Sedimentation Control and Grading Permit, Subdivision, and Land Development may request approval of an impervious surface area credit for construction of pervious hardscaping systems provided they comply with the design guidelines herein and approval is received from Plumstead Township.

An impervious surface credit shall only be considered by the Township for driveways, parking areas, and other hardscaping surfaces that are constructed at a slope greater than 1%, but less than 5%.

Numbers shown in the following table are the percentage of hardscaping surface area (proposed) that must be considered "IMPERVIOUS" based on factors such as paver block open void area and the material installed in the voids/openings of these surfaces.

**TABLE 1.0
HARDSCAPING SURFACE AREA THAT MUST BE CONSIDERED IMPERVIOUS SURFACE:**

FILL MATERIAL IN PAVER BLOCK VOIDS	HARDSCAPING MATERIAL				
	PAVER/ BLOCK	→	→	CLEAN STONE OR STRUCTURAL "GEOWEB"(1)	
	SURFACE OPEN AREA PERCENTAGE (%)				
	50-59.99	60-69.99	70-79.99	80-89.99	90-100
SOIL/GRASS	67%	60%	54%	48%	NOT PERMITTED
CLEAN STONE (no fines) or other CLEAN, NON-ERODIBLE FILL	52%	43%	33%	24%	14%

TABLE FOOTNOTE:

- (1) Driveways and parking areas must either be bituminous paving, stone (residential driveways, only), or some other combination of load bearing paver block backfilled with stone or soil. Geoweb, alone, with earth backfill may not be used for driveways and parking areas; therefore, is not eligible for an impervious surface area credit.

NOTES:

1. An impervious surface area credit, if approved by the Township, will only be valid if a proper sub-base is used and when filter fabric is installed to separate all soil/stone interfaces and clean stone/sand leveling bed surfaces, as more particularly shown on the attached conceptual installation detail.
2. Pervious hardscaping systems with less than 50% open surface void percentage is not eligible for an impervious surface credit and the entire surface of such hardscaping will be considered 100% impervious for the purpose of calculating on-site impervious

surface area and stormwater runoff. However, such systems may be considered a “Best Management Practice” if constructed in compliance with the criteria herein.

3. The hardscaping surface area which is intended and approved for impervious credit must be fully protected (by super silt fence) during the entire construction process to prevent compaction of the underlying soils by construction equipment and vehicles. A note must be added to the plan indicating this requirement.
4. The sequence of construction must specify the area of pervious hardscaping may only be constructed upon stabilization of the remainder of the site to prevent sediment from contaminating the surface.
5. General design and construction of these surfaces must conform to the attached construction detail and installation and maintenance procedures for the designated pervious hardscaping system must be identified on the plan.
6. Each request for impervious credit must include the manufacturer, style/product number, surface open area percentage (as identified by the manufacturer), and product data sheets. This information must also be shown on the plan including a notation that hardscaping system may only be modified with the written approval of the Township. No other “paver” block or stone may be substituted for that approved.
7. If the impervious surface credit is approved by the Township, the resulting (“net”) total of impervious surface area from the “paver” must be included in the impervious surface tabulation which must also identify the total area of “paver” block and percentage of hardscaping area that must be considered impervious (refer Table 1.0). The calculation of impervious surface area (refer sample herein) must be shown on the plan.
8. All applications for impervious surface area credit shall be reviewed by the Township Engineer for completeness and technical content to satisfy the above requirements and any other applicable ordinance requirements. Design and installation must be permanent and will be evaluated based on criteria herein, feasibility, effectiveness, and longevity. The Township retains the right to require infiltration testing at pervious paver locations, as well as the right to deny any application due to unforeseen circumstances unique to the site or application. Finally, construction of the pervious hardscaping system must be inspected by the Township Engineer with advance notice of 48-hours to schedule required inspections.

CALCULON OF HARDSCAPING SURFACE THAT MUST BE CONSIDERED IMPERVIOUS SURFACE AREA:

Proposed Pervious Hardscaping Surface Area = PHSA

Percentage of (Hardscaping) surface that must be considered Impervious (from **Table 1.0**)= PI

Total Area of Hardscaping Surface that must be considered Impervious = TI

$TI = PHSA \times (PI \div 100)$

SAMPLE CALCULATIONS:

1. If 1,250 SF of lot area is covered with “Hastings Checkerblock” (70% open area) with voids backfilled with clean stone, the quantity of hardscaping area that must be considered impervious surface area is:

$1,250 \text{ SF} \times (33\% \div 100)$ (from **Table 1.0**) = 413 SF = TI; therefore the “impervious surface credit” would be: $1,250 \text{ SF} - 413 \text{ SF} = 837 \text{ SF}$

2. If 1,436 SF of lot area is covered with “Presto Geoweb” and backfilled with clean stone, the quantity of hardscaping area that must be considered impervious surface is:

$1,436 \text{ SF} \times (14\% \div 100)$ (from **Table 1.0**) = 201 SF; therefore the “impervious surface credit” would be: $1,436 \text{ SF} - 201 \text{ SF} = 1,235 \text{ SF}$